



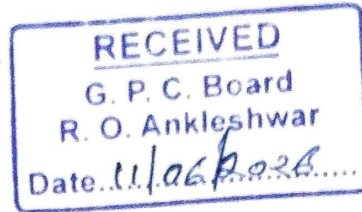
O/C copy

ENVIRO TECHNOLOGY LIMITED

Reference No.: ETL/ANK/JUN/2026-27/186

Date: 09th June 2026

To,
Ministry of Environment, Forest & Climate Change,
Integrated Regional Office,
Room no. 407, Aranya Bhawan,
Near CH-3 Circle, Sector 10A,
Gandhinagar- 382010



Subject: Half yearly EC Compliance Status of Environmental clearance for expansion of M/s Enviro Technology Limited Common Effluent Treatment Plant for the period **October-2025 to March-2026**

Ref.:

1. Environmental Clearance No. 10-2/2008-IA-III dated 23rd July 2009.
2. Environmental Clearance No. 10-82/2018-IA-III dated 16th December 2019

Respected Sir,

ETL is operating a CETP consisting of primary, secondary, and tertiary treatment located at plot No 2413/14 GIDC estate, Ankleshwar-393002, Dist.Bharuch,Gujarat.

We have two ECs referred under 1&3 and an EC validity extension referred under 2 We would like to draw your kind attention on the following:

1. EC referred under 1&2 i.e., EC dated 2009 & its validity extension dated 2017; we have not implemented any expansion as per this EC due to moratorium imposed on the critically polluted area which included Ankleshwar, and the validity of this EC is over on 22.07.2019. Non-implementation of this project is also mentioned in our EC dated 16.12.2019. Therefore, as the validity of this over, compliance report of this EC is not submitted.
2. EC dated 16.12.2019, referred under 3 for expansion (from 1.8 MLD to 3.5 MLD effluent) with modification is also not yet implemented. We have obtained a CTE from GPCB on 22.04.20 but due to Pandemic Covid-19, the project was delayed. Currently construction work for the said project is completed and plant is ready for commissioning.

We have not implemented EC 10-82/2018-IA-III dated 2019, but with this we are submitting its current compliance status along with all the required documents.

Kindly note that ETL is currently operating on effluent inlet of 2.2 MLD as per its CCA amendment no.AWH-137705 dated 11.02.2025.

CIN NO. :

U72200GJ1994PLC023786

1 of 2

Works Office :

2413/2414 & 2211, GIDC Estate, Ankleshwar - 393 002 Dist. : Bharuch (Gujarat)

Phone : (02646) 223569, 252768, 253104

Email : dalwadibd@bell.co.in, akhilkarkhanis@bell.co.in

Reg. Office :

9701-16, GIDC Estate, Ankleshwar - 393 002 Dist. : Bharuch (Gujarat)



AnyScanner



ENVIRO TECHNOLOGY LIMITED

ETL inlet and discharge quantities for the said period are as below which are within limits as per CCA dated 11.02.2025:

Period	Average Inlet effluent (MLD)	Average Sewage (MLD)	Average Discharge Quantity along with sewage (MLD)
October-2025 to March-2026	1.432	0.497	2.086
Capacity as per CCA No.AWH-137705 dated 11.02.2025	2.2	1.1	3.5

We would like to bring to your kind attention that the treated effluent is discharged to FETP operated by NCT for further treatment and disposal to deep sea.

Thanking you,
Yours faithfully,
For Enviro Technology Limited


Authorized Signatory

C.C: (1) Gujarat Pollution Control Board, Ankleshwar
(2) Central pollution Control Board, Vadodara

CIN NO. : U72200GJ1994PLC023786 2 of 2
Works Office : 2413/2414 & 2211, GIDC Estate, Ankleshwar - 393 002 Dist. : Bharuch (Gujarat)
Phone : (02646) 223569, 252768, 253104
Email : dalwadibd@beil.co.in, akhilkarkhanis@beil.co.in
Reg. Office : 9701-16, GIDC Estate, Ankleshwar - 393 002 Dist. : Bharuch (Gujarat)

Compliance Status for the period of October'25 to March'26, of Environment clearance to M/s Enviro Technology Ltd for expansion of Common Effluent Treatment Plant at plot no 2413/14, Notified G.I.D.C. Estate, Ankleshwar. In category B- 7(h) of schedule with EIA notification, 2006.

Environmental Clearance No. 10-2/2008-IA.III dated 23rd July, 2009.

1. This has reference to your letter No ETL/ANK/2007 dated 14.12.2007 and subsequent letter date 19.11.2008 on the subject mentioned above, seeking prior environment Impact Assessment Clearance for the above project under EIA notification 2006. The proposal has been appraised as per prescribed procedure in the light of provision under the EIA notification, 2006 on the basis of the mandatory documents enclosed with the application viz., the Questionnaire, EIA, EMP and the additional clarification furnished in response to the observation of the Expert Appraisal Committee constituted by the competent authority in its meeting held on 23rd – 25th January 2008. The information was provided by the Gujarat Pollution Control Board vide their letter No. BRCH/CCA/128/6/2009 dated 4.4.2009.

: Noted

2. It is inter-alia, noted that the project involves expansion of existing common effluent treatment plant at plot No 2413/14, Notified GIDC Estate, Ankleshwar where there is an existing CETP with 1.8 MLD capacity to cater small scale industries and proposed to enhance the capacity to 3.5 MLD. The effluent from the member unit is transported by rubber-lined tanker to the CETP. The effluent after checking the quality is unloaded in equalization tanks. The equalized effluent is neutralized with the lime solution and pH is increased to 9-10 to precipitate the heavy metal present in the effluent. After this, the effluent is sent to the primary clarifier, where solids settle in the bottom of the clarifier. The supernatant from the clarifier goes to the secondary treatment. The sludge from the bottom of the primary clarifier is sent to the Rotary vacuum Drum Filters/Decanter for the removal of moisture. The sludge cake from the Filters/decanter is sold to the cement industries or is sent to the landfill site. After the tertiary treatment, the effluent is sent to the FETP for the further treatment and disposed into sea. Existing consumption pattern of raw water is 600 m³/day, and proposed consumption pattern of raw water is 1445 m³/day. Total power requirement for the project will be 1100 KVA, which will be met from GEB and DG set (for emergency use only). The total cost of the project is Rs.9.0 crore.

: Noted

3. The project falls under category 'B'-7(h) of EIA Notification, 2006, but as the project is located at Ankleshwar which is notified as critically Polluted area by Central Pollution Control Board. Because of above, General Condition (GC) shall apply, and the project is treated as category A and appraised at central level.

: Noted

4. The Expert Appraisal Committee, after due consideration of the relevant document submitted by the project proponent and additional clarifications furnished in response to its observation, have recommended for grant of Environment Clearance. Accordingly, the Ministry hereby accords necessary Clearance as per the provision of Environment Impact Assessment notification, 2006, subject to strict compliance of the terms and conditions as follows.

: Noted

5. SPECIFIC CONDITION:

Sr. No	Description	Status																																																																																																																																																							
I.	The effluent shall be discharged in accordance with the standards laid down by Gujarat pollution control board.	Complied. Our treated effluent is discharged through dedicated line for further treatment at FETP, Namely, NCT (Narmada Clean Tech) before deep sea discharge. <table><tr><th colspan="8">Monthly Average of Final Discharge Quality for 2.2 MLD (Internal)</th></tr><tr><th>Month</th><th>Oct' 25</th><th>Nov' 25</th><th>Dec' 25</th><th>Jan' 26</th><th>Feb' 26</th><th>Mar' 26</th><th>GPCB Permissible Limits</th></tr><tr><td>pH</td><td>7.6</td><td>7.98</td><td>7.2</td><td>7.6</td><td>6.9</td><td>6.8</td><td>6.5 to 8.5</td></tr><tr><td>COD</td><td>810</td><td>800</td><td>798.4</td><td>840</td><td>798.4</td><td>792</td><td>1000 mg/L</td></tr><tr><td>BOD</td><td>14</td><td>18</td><td>18</td><td>21</td><td>18</td><td>21</td><td>200 mg/L</td></tr><tr><td>TSS</td><td>132</td><td>116</td><td>105</td><td>98</td><td>101</td><td>98</td><td>150 mg/L</td></tr><tr><td>NH4-N</td><td>33.6</td><td>28</td><td>27.44</td><td>29.68</td><td>29.12</td><td>28</td><td>50 mg/L</td></tr></table> The monthly NCT qualitative and quantitative data of our effluent discharge is as below. <table><tr><th>Date</th><th>pH</th><th>COD</th><th>NH4-N</th><th>TSS</th></tr><tr><td>NCT Norms</td><td>6.5-8.5</td><td>1000</td><td>75</td><td>150</td></tr><tr><td>02.10.2025</td><td>6.84</td><td>752</td><td>19</td><td>41</td></tr><tr><td>01.10.2025</td><td>6.72</td><td>736</td><td>15</td><td>36</td></tr><tr><td>03.10.2025</td><td>6.85</td><td>690</td><td>22</td><td>41</td></tr><tr><td>05.10.2025</td><td>6.79</td><td>656</td><td>19</td><td>41</td></tr><tr><td>09.10.2025</td><td>6.58</td><td>685</td><td>14</td><td>38</td></tr><tr><td>18.10.2025</td><td>7.25</td><td>674</td><td>8</td><td>39</td></tr><tr><td>19.10.2025</td><td>6.94</td><td>637</td><td>10</td><td>42</td></tr><tr><td>23.10.2025</td><td>6.8</td><td>727</td><td>BDL</td><td>72</td></tr><tr><td>27.10.2025</td><td>7.19</td><td>656</td><td>BDL</td><td>57</td></tr><tr><td>30.10.2025</td><td>7.21</td><td>624</td><td>4</td><td>47</td></tr><tr><td>02.11.2025</td><td>7.13</td><td>688</td><td>BDL</td><td>42</td></tr><tr><td>01.11.2025</td><td>6.94</td><td>624</td><td>6</td><td>45</td></tr><tr><td>04.11.2025</td><td>7.13</td><td>672</td><td>BDL</td><td>46</td></tr><tr><td>05.11.2025</td><td>7.24</td><td>640</td><td>BDL</td><td>45</td></tr><tr><td>12.11.2025</td><td>7.08</td><td>741</td><td>4</td><td>42</td></tr><tr><td>13.11.2025</td><td>7.04</td><td>628</td><td>7</td><td>46</td></tr><tr><td>13.11.2025</td><td>6.88</td><td>573</td><td>BDL</td><td>39</td></tr></table>	Monthly Average of Final Discharge Quality for 2.2 MLD (Internal)								Month	Oct' 25	Nov' 25	Dec' 25	Jan' 26	Feb' 26	Mar' 26	GPCB Permissible Limits	pH	7.6	7.98	7.2	7.6	6.9	6.8	6.5 to 8.5	COD	810	800	798.4	840	798.4	792	1000 mg/L	BOD	14	18	18	21	18	21	200 mg/L	TSS	132	116	105	98	101	98	150 mg/L	NH4-N	33.6	28	27.44	29.68	29.12	28	50 mg/L	Date	pH	COD	NH4-N	TSS	NCT Norms	6.5-8.5	1000	75	150	02.10.2025	6.84	752	19	41	01.10.2025	6.72	736	15	36	03.10.2025	6.85	690	22	41	05.10.2025	6.79	656	19	41	09.10.2025	6.58	685	14	38	18.10.2025	7.25	674	8	39	19.10.2025	6.94	637	10	42	23.10.2025	6.8	727	BDL	72	27.10.2025	7.19	656	BDL	57	30.10.2025	7.21	624	4	47	02.11.2025	7.13	688	BDL	42	01.11.2025	6.94	624	6	45	04.11.2025	7.13	672	BDL	46	05.11.2025	7.24	640	BDL	45	12.11.2025	7.08	741	4	42	13.11.2025	7.04	628	7	46	13.11.2025	6.88	573	BDL	39
Monthly Average of Final Discharge Quality for 2.2 MLD (Internal)																																																																																																																																																									
Month	Oct' 25	Nov' 25	Dec' 25	Jan' 26	Feb' 26	Mar' 26	GPCB Permissible Limits																																																																																																																																																		
pH	7.6	7.98	7.2	7.6	6.9	6.8	6.5 to 8.5																																																																																																																																																		
COD	810	800	798.4	840	798.4	792	1000 mg/L																																																																																																																																																		
BOD	14	18	18	21	18	21	200 mg/L																																																																																																																																																		
TSS	132	116	105	98	101	98	150 mg/L																																																																																																																																																		
NH4-N	33.6	28	27.44	29.68	29.12	28	50 mg/L																																																																																																																																																		
Date	pH	COD	NH4-N	TSS																																																																																																																																																					
NCT Norms	6.5-8.5	1000	75	150																																																																																																																																																					
02.10.2025	6.84	752	19	41																																																																																																																																																					
01.10.2025	6.72	736	15	36																																																																																																																																																					
03.10.2025	6.85	690	22	41																																																																																																																																																					
05.10.2025	6.79	656	19	41																																																																																																																																																					
09.10.2025	6.58	685	14	38																																																																																																																																																					
18.10.2025	7.25	674	8	39																																																																																																																																																					
19.10.2025	6.94	637	10	42																																																																																																																																																					
23.10.2025	6.8	727	BDL	72																																																																																																																																																					
27.10.2025	7.19	656	BDL	57																																																																																																																																																					
30.10.2025	7.21	624	4	47																																																																																																																																																					
02.11.2025	7.13	688	BDL	42																																																																																																																																																					
01.11.2025	6.94	624	6	45																																																																																																																																																					
04.11.2025	7.13	672	BDL	46																																																																																																																																																					
05.11.2025	7.24	640	BDL	45																																																																																																																																																					
12.11.2025	7.08	741	4	42																																																																																																																																																					
13.11.2025	7.04	628	7	46																																																																																																																																																					
13.11.2025	6.88	573	BDL	39																																																																																																																																																					

17.11.2025	7.07	768	13	39
22.11.2025	6.98	730	7	44
25.11.2025	7.54	725	BDL	18
26.11.2025	7.29	771	BDL	31
27.11.2025	6.89	704	6	35
29.11.2025	7.34	720	BDL	29
04.12.2025	7.33	720	BDL	32
07.12.2025	7.26	704	BDL	40
11.12.2025	7.09	792	BDL	42
15.12.2025	7.14	752	7	28
16.12.2025	7.15	832	6	36
21.12.2025	7.54	832	BDL	57
27.12.2025	7.12	800	BDL	32
30.12.2025	7.54	832	BDL	45
02.01.2026	7.51	851	BDL	31
04.01.2026	7.3	832	BDL	54
11.01.2026	7.26	800	BDL	31
13.01.2026	7.32	800	BDL	39
15.01.2026	7.4	816	BDL	28
18.01.2026	7.41	800	BDL	34
27.01.2026	7.77	800	BDL	34
31.01.2026	7.27	864	BDL	58
01.02.2026	7.45	832	BDL	39
31.01.2026	7.5	851	BDL	74
08.02.2026	7.37	928	BDL	33
13.02.2026	7.18	888	BDL	60
12.02.2026	7.59	793	38	28
16.02.2026	7.33	872	BDL	65
17.02.2026	7.34	869	BDL	40
20.02.2026	7.36	865	BDL	32
24.02.2026	7.25	853	BDL	51
26.02.2026	7.63	860	BDL	56
02.03.2026	7.12	809	BDL	40
04.03.2026	7.26	768	BDL	30
13.03.2026	7.26	832	BDL	44
18.03.2026	7.5	796	BDL	36
21.03.2026	7.4	777	BDL	42
24.03.2026	7.48	825	BDL	57
27.03.2026	7.28	806	BDL	56
27.03.2026	7.83	822	BDL	54

Test Reports of NCT attached as Annexure – 1 (A)

II.	The ammonia levels in the effluent shall be monitored.	Complied. We regularly monitoring ammonia level of effluent in ETL laboratory. Our laboratory is NABL accredited. Also, the same are monitored by our GPCB Recognized Schedule – I Environment Auditors. The average lab analysis results and Environment Audit results of Ammonical Nitrogen for the period of April’25 to September’25 is as below: <table><tr><th colspan="4">Analysis results of Ammonical Nitrogen (mg/L)</th></tr><tr><th>Month</th><th>Avg. Internal Results</th><th>Environment Audit Results</th><th>GPCB Permissible Limit (mg/L)</th></tr><tr><td>October’25</td><td>33.6</td><td></td><td rowspan="6">50</td></tr><tr><td>November’25</td><td>28</td><td>6</td></tr><tr><td>December’25</td><td>27.44</td><td></td></tr><tr><td>January’26</td><td>29.68</td><td></td></tr><tr><td>February’26</td><td>29.12</td><td></td></tr><tr><td>March’26</td><td>28</td><td>3</td></tr></table> NABL certificate of ETL laboratory attached as Annexure-1(B). Test Reports of Environment Audit attached as Annexure –1(C).	Analysis results of Ammonical Nitrogen (mg/L)				Month	Avg. Internal Results	Environment Audit Results	GPCB Permissible Limit (mg/L)	October’25	33.6		50	November’25	28	6	December’25	27.44		January’26	29.68		February’26	29.12		March’26	28	3
Analysis results of Ammonical Nitrogen (mg/L)																													
Month	Avg. Internal Results	Environment Audit Results	GPCB Permissible Limit (mg/L)																										
October’25	33.6		50																										
November’25	28	6																											
December’25	27.44																												
January’26	29.68																												
February’26	29.12																												
March’26	28	3																											
III.	No ground water shall be tapped for the project.	Not applicable No ground water is utilized at site; water supply is from GIDC Notified Area Authority.																											
IV.	A land area of 10 acres shall be earmarked for the development for green belt.	Noted for compliance. Currently 18% is the green belt area. Layout Attached as Annexure – 1(D)																											
V.	The project proponent shall ensure that chemicals/solvents such as Methyl chloride and other toxic solvents are not allowed to enter CETP.	Complied. This is a CETP for small scale industries and the effluent is conveyed through dedicated rubber lined tankers from each industry, each tanker is tested as per the inlet parameters given by GPCB, therefore there are no chances of methyl chloride or other toxic solvents entering CETP.																											

VI.	There shall be no disposal of effluents into the water bodies or anywhere outside the project premises.	Complied. We are disposing treated effluent to NCT-FETP through pipeline for further treatment & disposal to deep sea. Treated effluent characteristics of FETP inlet norms as under: <table><tr><th>Date</th><th>pH</th><th>COD</th><th>NH4-N</th><th>TSS</th></tr><tr><td>NCT Norms</td><td>6.5-8.5</td><td>1000</td><td>75</td><td>150</td></tr><tr><td>02.10.2025</td><td>6.84</td><td>752</td><td>19</td><td>41</td></tr><tr><td>01.10.2025</td><td>6.72</td><td>736</td><td>15</td><td>36</td></tr><tr><td>03.10.2025</td><td>6.85</td><td>690</td><td>22</td><td>41</td></tr><tr><td>05.10.2025</td><td>6.79</td><td>656</td><td>19</td><td>41</td></tr><tr><td>09.10.2025</td><td>6.58</td><td>685</td><td>14</td><td>38</td></tr><tr><td>18.10.2025</td><td>7.25</td><td>674</td><td>8</td><td>39</td></tr><tr><td>19.10.2025</td><td>6.94</td><td>637</td><td>10</td><td>42</td></tr><tr><td>23.10.2025</td><td>6.8</td><td>727</td><td>BDL</td><td>72</td></tr><tr><td>27.10.2025</td><td>7.19</td><td>656</td><td>BDL</td><td>57</td></tr><tr><td>30.10.2025</td><td>7.21</td><td>624</td><td>4</td><td>47</td></tr><tr><td>02.11.2025</td><td>7.13</td><td>688</td><td>BDL</td><td>42</td></tr><tr><td>01.11.2025</td><td>6.94</td><td>624</td><td>6</td><td>45</td></tr><tr><td>04.11.2025</td><td>7.13</td><td>672</td><td>BDL</td><td>46</td></tr><tr><td>05.11.2025</td><td>7.24</td><td>640</td><td>BDL</td><td>45</td></tr><tr><td>12.11.2025</td><td>7.08</td><td>741</td><td>4</td><td>42</td></tr><tr><td>13.11.2025</td><td>7.04</td><td>628</td><td>7</td><td>46</td></tr><tr><td>13.11.2025</td><td>6.88</td><td>573</td><td>BDL</td><td>39</td></tr><tr><td>17.11.2025</td><td>7.07</td><td>768</td><td>13</td><td>39</td></tr><tr><td>22.11.2025</td><td>6.98</td><td>730</td><td>7</td><td>44</td></tr><tr><td>25.11.2025</td><td>7.54</td><td>725</td><td>BDL</td><td>18</td></tr><tr><td>26.11.2025</td><td>7.29</td><td>771</td><td>BDL</td><td>31</td></tr><tr><td>27.11.2025</td><td>6.89</td><td>704</td><td>6</td><td>35</td></tr><tr><td>29.11.2025</td><td>7.34</td><td>720</td><td>BDL</td><td>29</td></tr><tr><td>04.12.2025</td><td>7.33</td><td>720</td><td>BDL</td><td>32</td></tr><tr><td>07.12.2025</td><td>7.26</td><td>704</td><td>BDL</td><td>40</td></tr><tr><td>11.12.2025</td><td>7.09</td><td>792</td><td>BDL</td><td>42</td></tr><tr><td>15.12.2025</td><td>7.14</td><td>752</td><td>7</td><td>28</td></tr><tr><td>16.12.2025</td><td>7.15</td><td>832</td><td>6</td><td>36</td></tr><tr><td>21.12.2025</td><td>7.54</td><td>832</td><td>BDL</td><td>57</td></tr><tr><td>27.12.2025</td><td>7.12</td><td>800</td><td>BDL</td><td>32</td></tr><tr><td>30.12.2025</td><td>7.54</td><td>832</td><td>BDL</td><td>45</td></tr><tr><td>02.01.2026</td><td>7.51</td><td>851</td><td>BDL</td><td>31</td></tr><tr><td>04.01.2026</td><td>7.3</td><td>832</td><td>BDL</td><td>54</td></tr><tr><td>11.01.2026</td><td>7.26</td><td>800</td><td>BDL</td><td>31</td></tr><tr><td>13.01.2026</td><td>7.32</td><td>800</td><td>BDL</td><td>39</td></tr></table>	Date	pH	COD	NH4-N	TSS	NCT Norms	6.5-8.5	1000	75	150	02.10.2025	6.84	752	19	41	01.10.2025	6.72	736	15	36	03.10.2025	6.85	690	22	41	05.10.2025	6.79	656	19	41	09.10.2025	6.58	685	14	38	18.10.2025	7.25	674	8	39	19.10.2025	6.94	637	10	42	23.10.2025	6.8	727	BDL	72	27.10.2025	7.19	656	BDL	57	30.10.2025	7.21	624	4	47	02.11.2025	7.13	688	BDL	42	01.11.2025	6.94	624	6	45	04.11.2025	7.13	672	BDL	46	05.11.2025	7.24	640	BDL	45	12.11.2025	7.08	741	4	42	13.11.2025	7.04	628	7	46	13.11.2025	6.88	573	BDL	39	17.11.2025	7.07	768	13	39	22.11.2025	6.98	730	7	44	25.11.2025	7.54	725	BDL	18	26.11.2025	7.29	771	BDL	31	27.11.2025	6.89	704	6	35	29.11.2025	7.34	720	BDL	29	04.12.2025	7.33	720	BDL	32	07.12.2025	7.26	704	BDL	40	11.12.2025	7.09	792	BDL	42	15.12.2025	7.14	752	7	28	16.12.2025	7.15	832	6	36	21.12.2025	7.54	832	BDL	57	27.12.2025	7.12	800	BDL	32	30.12.2025	7.54	832	BDL	45	02.01.2026	7.51	851	BDL	31	04.01.2026	7.3	832	BDL	54	11.01.2026	7.26	800	BDL	31	13.01.2026	7.32	800	BDL	39
Date	pH	COD	NH4-N	TSS																																																																																																																																																																																							
NCT Norms	6.5-8.5	1000	75	150																																																																																																																																																																																							
02.10.2025	6.84	752	19	41																																																																																																																																																																																							
01.10.2025	6.72	736	15	36																																																																																																																																																																																							
03.10.2025	6.85	690	22	41																																																																																																																																																																																							
05.10.2025	6.79	656	19	41																																																																																																																																																																																							
09.10.2025	6.58	685	14	38																																																																																																																																																																																							
18.10.2025	7.25	674	8	39																																																																																																																																																																																							
19.10.2025	6.94	637	10	42																																																																																																																																																																																							
23.10.2025	6.8	727	BDL	72																																																																																																																																																																																							
27.10.2025	7.19	656	BDL	57																																																																																																																																																																																							
30.10.2025	7.21	624	4	47																																																																																																																																																																																							
02.11.2025	7.13	688	BDL	42																																																																																																																																																																																							
01.11.2025	6.94	624	6	45																																																																																																																																																																																							
04.11.2025	7.13	672	BDL	46																																																																																																																																																																																							
05.11.2025	7.24	640	BDL	45																																																																																																																																																																																							
12.11.2025	7.08	741	4	42																																																																																																																																																																																							
13.11.2025	7.04	628	7	46																																																																																																																																																																																							
13.11.2025	6.88	573	BDL	39																																																																																																																																																																																							
17.11.2025	7.07	768	13	39																																																																																																																																																																																							
22.11.2025	6.98	730	7	44																																																																																																																																																																																							
25.11.2025	7.54	725	BDL	18																																																																																																																																																																																							
26.11.2025	7.29	771	BDL	31																																																																																																																																																																																							
27.11.2025	6.89	704	6	35																																																																																																																																																																																							
29.11.2025	7.34	720	BDL	29																																																																																																																																																																																							
04.12.2025	7.33	720	BDL	32																																																																																																																																																																																							
07.12.2025	7.26	704	BDL	40																																																																																																																																																																																							
11.12.2025	7.09	792	BDL	42																																																																																																																																																																																							
15.12.2025	7.14	752	7	28																																																																																																																																																																																							
16.12.2025	7.15	832	6	36																																																																																																																																																																																							
21.12.2025	7.54	832	BDL	57																																																																																																																																																																																							
27.12.2025	7.12	800	BDL	32																																																																																																																																																																																							
30.12.2025	7.54	832	BDL	45																																																																																																																																																																																							
02.01.2026	7.51	851	BDL	31																																																																																																																																																																																							
04.01.2026	7.3	832	BDL	54																																																																																																																																																																																							
11.01.2026	7.26	800	BDL	31																																																																																																																																																																																							
13.01.2026	7.32	800	BDL	39																																																																																																																																																																																							

		<table><tr><td>15.01.2026</td><td>7.4</td><td>816</td><td>BDL</td><td>28</td></tr><tr><td>18.01.2026</td><td>7.41</td><td>800</td><td>BDL</td><td>34</td></tr><tr><td>27.01.2026</td><td>7.77</td><td>800</td><td>BDL</td><td>34</td></tr><tr><td>31.01.2026</td><td>7.27</td><td>864</td><td>BDL</td><td>58</td></tr><tr><td>01.02.2026</td><td>7.45</td><td>832</td><td>BDL</td><td>39</td></tr><tr><td>31.01.2026</td><td>7.5</td><td>851</td><td>BDL</td><td>74</td></tr><tr><td>08.02.2026</td><td>7.37</td><td>928</td><td>BDL</td><td>33</td></tr><tr><td>13.02.2026</td><td>7.18</td><td>888</td><td>BDL</td><td>60</td></tr><tr><td>12.02.2026</td><td>7.59</td><td>793</td><td>38</td><td>28</td></tr><tr><td>16.02.2026</td><td>7.33</td><td>872</td><td>BDL</td><td>65</td></tr><tr><td>17.02.2026</td><td>7.34</td><td>869</td><td>BDL</td><td>40</td></tr><tr><td>20.02.2026</td><td>7.36</td><td>865</td><td>BDL</td><td>32</td></tr><tr><td>24.02.2026</td><td>7.25</td><td>853</td><td>BDL</td><td>51</td></tr><tr><td>26.02.2026</td><td>7.63</td><td>860</td><td>BDL</td><td>56</td></tr><tr><td>02.03.2026</td><td>7.12</td><td>809</td><td>BDL</td><td>40</td></tr><tr><td>04.03.2026</td><td>7.26</td><td>768</td><td>BDL</td><td>30</td></tr><tr><td>13.03.2026</td><td>7.26</td><td>832</td><td>BDL</td><td>44</td></tr><tr><td>18.03.2026</td><td>7.5</td><td>796</td><td>BDL</td><td>36</td></tr><tr><td>21.03.2026</td><td>7.4</td><td>777</td><td>BDL</td><td>42</td></tr><tr><td>24.03.2026</td><td>7.48</td><td>825</td><td>BDL</td><td>57</td></tr><tr><td>27.03.2026</td><td>7.28</td><td>806</td><td>BDL</td><td>56</td></tr><tr><td>27.03.2026</td><td>7.83</td><td>822</td><td>BDL</td><td>54</td></tr></table> NCT reports are attached as an Annexure – 1(A).	15.01.2026	7.4	816	BDL	28	18.01.2026	7.41	800	BDL	34	27.01.2026	7.77	800	BDL	34	31.01.2026	7.27	864	BDL	58	01.02.2026	7.45	832	BDL	39	31.01.2026	7.5	851	BDL	74	08.02.2026	7.37	928	BDL	33	13.02.2026	7.18	888	BDL	60	12.02.2026	7.59	793	38	28	16.02.2026	7.33	872	BDL	65	17.02.2026	7.34	869	BDL	40	20.02.2026	7.36	865	BDL	32	24.02.2026	7.25	853	BDL	51	26.02.2026	7.63	860	BDL	56	02.03.2026	7.12	809	BDL	40	04.03.2026	7.26	768	BDL	30	13.03.2026	7.26	832	BDL	44	18.03.2026	7.5	796	BDL	36	21.03.2026	7.4	777	BDL	42	24.03.2026	7.48	825	BDL	57	27.03.2026	7.28	806	BDL	56	27.03.2026	7.83	822	BDL	54
15.01.2026	7.4	816	BDL	28																																																																																																												
18.01.2026	7.41	800	BDL	34																																																																																																												
27.01.2026	7.77	800	BDL	34																																																																																																												
31.01.2026	7.27	864	BDL	58																																																																																																												
01.02.2026	7.45	832	BDL	39																																																																																																												
31.01.2026	7.5	851	BDL	74																																																																																																												
08.02.2026	7.37	928	BDL	33																																																																																																												
13.02.2026	7.18	888	BDL	60																																																																																																												
12.02.2026	7.59	793	38	28																																																																																																												
16.02.2026	7.33	872	BDL	65																																																																																																												
17.02.2026	7.34	869	BDL	40																																																																																																												
20.02.2026	7.36	865	BDL	32																																																																																																												
24.02.2026	7.25	853	BDL	51																																																																																																												
26.02.2026	7.63	860	BDL	56																																																																																																												
02.03.2026	7.12	809	BDL	40																																																																																																												
04.03.2026	7.26	768	BDL	30																																																																																																												
13.03.2026	7.26	832	BDL	44																																																																																																												
18.03.2026	7.5	796	BDL	36																																																																																																												
21.03.2026	7.4	777	BDL	42																																																																																																												
24.03.2026	7.48	825	BDL	57																																																																																																												
27.03.2026	7.28	806	BDL	56																																																																																																												
27.03.2026	7.83	822	BDL	54																																																																																																												
VII.	In the event of the CETPs not functioning as proposed/breakdown of the CETPs, the units shall closedown immediately and stop discharging the effluent.	Noted for compliance. During breakdown of the FETP, we are not discharging the effluent. We store the effluent in existing guard pond. There was no breakdown during the compliance period. Further, we have a preventive maintenance plan to avoid any breakdowns leading to closing.																																																																																																														
VIII.	The units and the CETP shall maintain daily logbook of the quantity and quality of discharge from units, quantity of inflow into the CETP, details of the treatment at each stage of the CETP including the raw materials used, quantity of the treatment water sent back to the units, quantity of the salts extracted from the	Complied. ETL is maintaining logbook (for existing operation 1.8 MLD) of - Quantity and Quality of discharge of Effluent. - Record of Inflow to CETP. - Record of raw materials used, Details are attached as below: It may be noted that ETL is not sending back treated water to member units and is also not extracting salt. EC Compliance report containing the above information is uploaded on website.																																																																																																														

treatment process and detail of the selling of such salts. All the above information shall be provided on the line of the website exclusive prepared from the purpose by the CETP owner. The website shall be accessible by the public. The financial and energy details of the CETP will also be provided along with details of the workers of the CETP.	We are having a digital display board in front of CETP, and all the required details are displayed. Details of the website are www.tatvaglobal.com.
--	--

Industrial Effluent Inlet Quantity and Discharge quantity & quality: - (In-house Laboratory's results)

Month	Average Inlet Effluent (MLD) (1.8 MLD Industrial Effluent)	Final Discharge Quantity Along with 1.7 MLD sewage (Avg. MLD)	Final Discharge Effluent Quality				
			pH	COD	BOD	TSS	NH4-N
October'25	1.445	2.205	7.6	810	14	132	33.6
November'25	1.608	2.295	7.98	800	18	116	28
December'25	1.480	2.200	7.2	798	18	105	27.44
January'26	1.301	1.887	7.6	840	21	98	29.68
February'26	1.441	2.044	6.9	798.4	18	101	29.12
March'26	1.317	1.881	6.8	792	21	98	28

All parameters are in mg/l except pH.

Raw Material Consumption: unit- Kgs

Chemicals	Oct'25	Nov'25	Dec'25	Jan'26	Feb'26	Mar'26
Lime	40735.48	45491.4	47640.67	43067.32	43960.01	43573.82
FeSO4 (solid)	660	765	1020	1230	1120	1101
Polyelectrolyte	0	0	0	0	0	0
De foaming Agent	199	80	45	0	0	200
Fin Deform-18	3860	5080	5220	5580	5950	5720
Phosphoric Acid	225	450	400	500	450	450
Poly Aluminum Chloride (PAC)	1364	1450	1533	1538	1400	1299

		Sodium Tripolyphosphate (STTP)	171	174	163	186	168	176
		MgCl ₂	666	676	704	659	660	604
		Caustic Soda (NaOH)	181.15	382.08	362.08	362.08	362.08	362.08
IX.	The CETP shall have adequate power backup facility, to meet the energy requirement in case of the power failure from the grid.	Complied. As power back ETL has installed D G Set of 1010 KVA for smooth operation during power failure. Existing Certificate attached as Annexure-1(E)						
X.	The CETP owner shall study the water quality of the sea where the unit were earlier discharging the effluents. For the purpose, the CETP owner shall also monitor the sea water quality on daily basis as per CPCB norms. The information shall also be put on the above-mentioned site along with reasons for changes in seawater quality if any.	Not applicable. ETL is sending their entire treated effluent to NCT-FETP for further treatment.						
XI.	The ground water at the site shall also be monitored and information made available on the above website of the company.	No ground water is utilized at site, water supply is from GIDC Notified Area Authority.						
XII.	The CETP shall be accessible by the public to monitor the functioning the CETP.	Complied						

XIII.	The solid waste from CETP/units shall be disposed off as per the norms laid down by Gujarat pollution control board.	Complied. Unit is disposing sludge to Common TSDF – BEIL. Sludge disposal quantity for existing facility is under: (October-24 to March-25). <table border="1"> <thead> <tr> <th>Month</th><th>Sludge Quantity (MT)</th><th>Consented Qty. in MT/Year</th></tr> </thead> <tbody> <tr> <td>October 2025</td><td>337.21</td><td rowspan="6">36500</td></tr> <tr> <td>November 2025</td><td>309.31</td></tr> <tr> <td>December 2025</td><td>394.57</td></tr> <tr> <td>January 2026</td><td>480.84</td></tr> <tr> <td>February 2026</td><td>239.16</td></tr> <tr> <td>March 2026</td><td>282.90</td></tr> </tbody> </table> Membership certificate of BEIL to send sludge attached as Annexure -1(F)	Month	Sludge Quantity (MT)	Consented Qty. in MT/Year	October 2025	337.21	36500	November 2025	309.31	December 2025	394.57	January 2026	480.84	February 2026	239.16	March 2026	282.90
Month	Sludge Quantity (MT)	Consented Qty. in MT/Year																
October 2025	337.21	36500																
November 2025	309.31																	
December 2025	394.57																	
January 2026	480.84																	
February 2026	239.16																	
March 2026	282.90																	
XIV.	All the above information shall be complied, and a report shall be submitted to Gujarat pollution control board and regional office of MoEF at Bhopal.	Complied. EC compliance report is submitted to Gujarat Pollution Control Board and also uploaded on MOEF& CC Website.																
XV.	The project proponent shall ensure that the facilities constructed for the project will not cause any inconvenience or disturbance to the local communities including the fisherman.	Agree to Comply We will take care to ensure that our facility constructed will not cause any inconvenience or disturbance to the local communities including the fisherman.																
XVI.	A modification of the project shall be taken up only after obtaining necessary approvals from the concerned agencies.	Noted for compliance.																

6. GENERAL CONDITION:

Sr. No	Description	Status
I.	Construction of the proposed CETP should be undertaken meticulously confirming to the existing central/local rules and regulations. All the construction designs/drawings reacting to the proposed construction activities must have	Noted. All the existing drawings have been approved from GIDC and Factory Inspector's office. All the drawings for the proposed 3.5 MLD will also be approved from the GIDC as well as factory inspector's office.

	approvals of the concerned State Government Department/Agencies.																													
II.	The project authorities should take appropriate community development and welfare measures for the villagers in the vicinity of the project site, including drinking waste facilities, a separate fund should be allocated for this purpose and same indicated to regional office at Bhopal.	We are taking up CSR activities. We are supporting Schools / Colleges																												
III.	To meet any emergency, appropriate fire-fighting system should be installed. Appropriate arrangements for uninterrupted power supply to the environment protection equipment and continuous water supply for the fire- fighting system should be made.	Complied. Fire-fighting system is already installed for existing facilities. D G Set of 1010 KVA is also available for use during power cut.																												
IV.	A separate Environment management Cell with suitable qualified staff to carry out various environment related functions should be set up under the change of senior Executive who will report directly to the Chief Executive of the company.	Complied. Details are as under: <table><tr><th>Sr. No.</th><th>Name of the employee</th><th>Designation</th><th>Educational Qualification</th></tr><tr><td>1.</td><td>Mr. B. D. Dalwadi</td><td>C.E.O.</td><td>B.E. Chemical</td></tr><tr><td>2.</td><td>Mr. A. M. Darji</td><td>Unit Head</td><td>M.Sc.-Biochemistry, LL. B</td></tr><tr><td>3.</td><td>Mr. Narendra B Patel</td><td>Sr. Manager (Q.A)</td><td>M. Sc & PG Dip in Env. Mgt. & Tech.</td></tr><tr><td>4.</td><td>Mr. Akhil P. Karkhanis</td><td>Unit Head</td><td>M.E. Chemical</td></tr><tr><td>5.</td><td>Ms. Rakshita Vyas</td><td>DGM (Env.)</td><td>M.Sc. Environment</td></tr><tr><td>6.</td><td>Ms. Priya Patel</td><td>Officer (Env.)</td><td>B.E. Environment</td></tr></table>	Sr. No.	Name of the employee	Designation	Educational Qualification	1.	Mr. B. D. Dalwadi	C.E.O.	B.E. Chemical	2.	Mr. A. M. Darji	Unit Head	M.Sc.-Biochemistry, LL. B	3.	Mr. Narendra B Patel	Sr. Manager (Q.A)	M. Sc & PG Dip in Env. Mgt. & Tech.	4.	Mr. Akhil P. Karkhanis	Unit Head	M.E. Chemical	5.	Ms. Rakshita Vyas	DGM (Env.)	M.Sc. Environment	6.	Ms. Priya Patel	Officer (Env.)	B.E. Environment
Sr. No.	Name of the employee	Designation	Educational Qualification																											
1.	Mr. B. D. Dalwadi	C.E.O.	B.E. Chemical																											
2.	Mr. A. M. Darji	Unit Head	M.Sc.-Biochemistry, LL. B																											
3.	Mr. Narendra B Patel	Sr. Manager (Q.A)	M. Sc & PG Dip in Env. Mgt. & Tech.																											
4.	Mr. Akhil P. Karkhanis	Unit Head	M.E. Chemical																											
5.	Ms. Rakshita Vyas	DGM (Env.)	M.Sc. Environment																											
6.	Ms. Priya Patel	Officer (Env.)	B.E. Environment																											
V.	The funds earmarked for environment protection measures shall be maintained in a separate account and there shall be no diversion of these funds for any other purpose. A year-wise expenditure on environment safeguards shall be reported to this Ministry's regional office at Bhopal.	Noted for compliance. Our unit is a CETP and hence all the expenditure is for the purpose of environment protection measures.																												

VI.	Full support shall be extended to the officers of the Ministry's Regional Office at Bhopal and the officer of the central and State pollution control Board by the project proponent during their inspection for monitoring purpose, but furnishing full details and action plans including the action taken reports in respect of mitigative measures another environment protection activities.	Complied.
VII.	In case of deviation or alternation in the project including the implementing agency, a fresh reference should be made to this Ministry for modification in the clearance conditions or imposition of new one for ensuring environmental protection.	In case of deviation or alteration in the project including the implementing agency, we agree to give a fresh reference to the Ministry for modification in the clearance conditions or imposition of new one for ensuring environmental protection.
VIII.	This Ministry reserves the right to revoke this clearance, if any of the conditions stipulated are not complies with to the satisfaction of this ministry.	Noted.
IX.	This ministry or any other competent authority any stipulate any other additional conditions subsequently, if deemed necessary for environment protection, which shall be complied with.	Noted.
X.	State Pollution Control Board/Committee shall display a copy of the clearance letter at the District Industries Center and Collector's office/ Tehsildar's office for 30 days.	We have given copies to DIC/Notified Area office/ other offices.
XI.	The project proponent shall inform regional Office Bhopal as well as the Ministry, the date of financial approval of the project by the concerned	Noted

	authorities and the date of start of work.	
7.	The above-mentioned stipulations shall be enforced among others under the water(prevention and control of pollution) Act 1974, the Air (prevention and control of pollution) Act 1981, the Environment(protection) Act 1986, the Hazardous Chemicals (manufacture, Storage and Import) Rules, 1986, the Coastal Regulation Zone Notification, 1991 and its subsequent amendments and the public liability Insurance act,1991 and the Rules made under from time to time. The proponent shall also ensure that proposal complies with the provisions of the approved Costal Regional Zone Management Plan of Gujarat and the supreme court's order dated 18 th April 1996 in the writ petition N.664 of 1993 to the extent the same are applicable to the proposal.	Noted for compliance
8.	All other statutory clearance such as the approvals for the storage of diesel from chief Controller of Explosive, Fire Department, Civil Aviation Department, Forest Conservation Act, 1972 etc. shall be obtained, as applicable by project proponent from the respective competent authorities.	. Complied
9.	The project proponent should advertise in at least two local Newspaper widely circulated in the region, one of which shall be in vernacular language informing that the project has been accorded Environment Clearance and copies of clearance letter are	Complied. We have advertised in two local newspapers (Times of India and Gujarat Mitra) on date 09 th August 2009 informing that the "project has been accorded EC". Copy is attached as Annexure - 1 (G)

	available with Maharashtra pollution Control Board and may also been seen on the website of the Ministry of Environment and Forests at http://www.envfor.nic.in . the advertisement should be made within 10 days from the date of receipt of the clearance letter and a copy of the same should be forwarded to the regional office of this Ministry at Bhopal.	
10.	A copy of the clearance letter shall be sent by the proponent to concerned panchayat, Zilla Parisad/municipal Corporation, Urban Local body and the local NGO, if any from whom suggestions/representations, if any, were received while the proposal. The clearance letter shall also be put on the website of the company by the proponent	Complied. We have submitted the copy of EC to concerned panchayat, Zilla Parisad/municipal Corporation, Urban Local body, and the local NGO Acknowledgement attached as Annexure-1 (H)
11.	The proponent shall upload the status of compliance of the stipulated EC conditions, including results of monitored data on their website and shall update the same periodically. It shall simultaneously be sent to Regional Office of MoEF, the respective Zonal Office of CPCB and the SPCB. The criteria pollutant level namely; SPM, RSPM, SO₂, NO_x (ambient levels as well as stack emissions) or critical sectoral parameters, indicated for the project shall be monitored and displayed at a convenient location near the main gate of the company in the public domain,	Complied. We are regularly submitting Half yearly compliance report.
12.	The project proponent shall also submit six-monthly reports on the status of the compliance of stipulated environmental conditions	Complied

	including results of monitored data (both in hard copies as well as by e-mail) to the respective regional office of MoEF, the respective Zonal Office of CPCB and the SPCB.	
13.	The environmental statement for each financial year ending 31 st March in Form-V as is mandated to be submitted by the project proponent to the Environment (Protection) Rules, 1986, as amended the status of compliance of EC Conditions and shall also be sent to the respective Regional offices of MoEF by e-mail.	Complied Copy of Environmental statement for the year of 2024-2025 is attached as Annexure – (I) and also we mailed our EC Compliance Report to respective regional office.



ANNEXURE-1 (A)
Analytical Laboratory
NARMADA CLEAN TECH
(A Subsidiary of GIDC)



Report No : NCT/MIAR/2025/OCT/N-12

Issue Date : 03/10/2025

URL No. : TC1159825000017867F

To :

ENVIRO TECHNOLOGY LIMITED

Plot No. 2413/14, GIDC ESTATE

ANKLESHWAR 393 002.

TEST REPORT

Kindly find here with the Test report.

Sample Description:	Waste Water	Sample Quantity:	750 ml
Sampling Location:	Free flow sample from Final Discharge Point	Sample Received Date:	02/10/2025
Sample Received By:	Mr. Upendra Rout	Sampling Plan & Procedure:	N.A.
Packing Details:	Preserved (250ml) and Unpreserved (500ml) sample in Plastic bottle	Analysis Start Date:	02/10/2025
Customer Sample Id	N-12	Analysis Completion Date:	02/10/2025
Sampling Start Date & Time:	02/10/2025 & 1:05	Sampling done By:	NCT Monitoring Team

Sr No.	Parameter	Unit	Results	Method Ref.
1	pH at Room Temperature	~	6.84	APHA 24th ed. 4500 H+B
2	Chemical Oxygen Demand	mg/L	752	APHA 24th ed. 5220 B
3	Ammonical Nitrogen	mg/L	19	APHA 24th ed. 4500 NH3C
4	Total Dissolved Solids Dried at 180°C	mg/L	16866	APHA 24th ed. 2540 C
5	Total Suspended Solids Dried from 103-105°C	mg/L	41	APHA 24th ed. 2540 D

Note: Joint Analysis will be entertained within 15 days from the date of sampling.

Abbreviation: BDL – Below Detection Limit

Any addition to , deviations, or exclusions from the method : Not Applicable

Remarks :

Terms and conditions governing the test report issued

1. Sample is drawn by Narmada Clean Tech ; the results are applicable only to the Received samples from Customer.
2. The test report shall not be reproduced in full or part without the written approval of the Analytical Laboratory Narmada Clean Tech.
3. The test report in full or part shall not be used for promotional or publicity purpose without the written consent of Analytical Laboratory Narmada Clean Tech.
4. Waste water samples shall be stored for the period of Fifteen days after the date of issue of Report.

For Narmada Clean Tech

Twinkle Modi

Authorized By

Twinkle Modi
Sr. Executive QCD

End of Report

Format No. F/OPN/01/01 Issue no. 01 Issue date 01/04/2022 Rev no. 01 Rev date : 02/04/2024 Page 1 Of 2

Surti Bhagor, Nr. Gujarat Gas Office, Umarwada Road, Ankleshwar-393 001, Dist. Bharuch (Gujarat)
Tele : 8469745285, Email : info@nctc.co.in; website : www.nctc.co.in, CIN : U140101GJ2000NPL037236



AnyScanner



Analytical Laboratory
NARMADA CLEAN TECH
(A Subsidiary of GIDC)



Report No : NCT/MIAR/2025/OCT/N-8

Issue Date : 03/10/2025

URL No. : TC1159825000017863F

To :

ENVIRO TECHNOLOGY LIMITED

Plot No. 2413/14, GIDC ESTATE

ANKLESHWAR 393 002.

TEST REPORT

Kindly find here with the Test report.

Sample Description:	Waste Water	Sample Quantity:	750 ml
Sampling Location:	Free flow sample from Final Discharge Point	Sample Received Date:	02/10/2025
Sample Received By:	Mr. Upendra Rout	Sampling Plan & Procedure:	N.A.
Packing Details:	Preserved (250ml) and Unpreserved (500ml) sample in Plastic bottle	Analysis Start Date:	02/10/2025
Customer Sample Id	N-8	Analysis Completion Date:	02/10/2025
Sampling Start Date & Time:	01/10/2025 & 19:27	Sampling done By:	NCT Monitoring Team

Sr No.	Parameter	Unit	Results	Method Ref.
1	pH at Room Temperature	~	6.72	APHA 24th ed. 4500 H+B
2	Chemical Oxygen Demand	mg/L	736	APHA 24th ed. 5220 B
3	Ammonical Nitrogen	mg/L	15	APHA 24th ed. 4500 NH3C
4	Total Dissolved Solids Dried at 180°C	mg/L	17338	APHA 24th ed. 2540 C
5	Total Suspended Solids Dried from 103-105°C	mg/L	36	APHA 24th ed. 2540 D

Note: Joint Analysis will be entertained within 15 days from the date of sampling

Abbreviation: BDL – Below Detection Limit

Any addition to , deviations, or exclusions from the method : Not Applicable

Remarks :

Terms and conditions governing the test report issued

1. Sample is drawn by Narmada Clean Tech ; the results are applicable only to the Received samples from Customer.
2. The test report shall not be reproduced in full or part without the written approval of the Analytical Laboratory Narmada Clean Tech.
3. The test report in full or part shall not be used for promotional or publicity purpose without the written consent of Analytical Laboratory Narmada Clean Tech.
4. Waste water samples shall be stored for the period of Fifteen days after the date of Issue of Report.

For Narmada Clean Tech

Authorized By

Twinkle Modi
Sr. Executive QCD

----- End of Report -----



Analytical Laboratory
NARMADA CLEAN TECH
(A Subsidiary of GIDC)



Report No : NCT/MIAR/2025/OCT/N-67

Issue Date : 05/10/2025

URL No. : TC1159825000017931F

To :

ENVIRO TECHNOLOGY LIMITED

Plot No. 2413/14, GIDC ESTATE

ANKLESHWAR 393 002.

TEST REPORT

Kindly find here with the Test report.

Sample Description:	Waste Water	Sample Quantity:	750 ml
Sampling Location:	Sample collected from Autosampler	Sample Received Date:	04/10/2025
Sample Received By:	Mr. Upendra Rout	Sampling Plan & Procedure:	N.A.
Packing Details:	Preserved (250ml) and Unpreserved (500ml) sample in Plastic bottle	Analysis Start Date:	04/10/2025
Customer Sample Id	N-5	Analysis Completion Date:	04/10/2025
Sampling Start Date & Time:	03/10/2025 & 8:57	Sampling done By:	NCT Monitoring Team

Sr No.	Parameter	Unit	Results	Method Ref.
1	pH at Room Temperature	~	6.85	APHA 24th ed. 4500 H+B
2	Chemical Oxygen Demand	mg/L	690	APHA 24th ed. 5220 B
3	Ammonical Nitrogen	mg/L	22	APHA 24th ed. 4500 NH3C
4	Total Dissolved Solids Dried at 180°C	mg/L	3682	APHA 24th ed. 2540 C
5	Total Suspended Solids Dried from 103-105°C	mg/L	41	APHA 24th ed. 2540 D

Note: Joint Analysis will be entertained within 15 days from the date of sampling

Abbreviation: BDL – Below Detection Limit

Any addition to , deviations, or exclusions from the method : Not Applicable

Remarks :

Terms and conditions governing the test report issued

1. Sample is drawn by Narmada Clean Tech ; the results are applicable only to the Received samples from Customer.
2. The test report shall not be reproduced in full or part without the written approval of the Analytical Laboratory Narmada Clean Tech.
3. The test report in full or part shall not be used for promotional or publicity purpose without the written consent of Analytical Laboratory Narmada Clean Tech.
4. Waste water samples shall be stored for the period of Fifteen days after the date of Issue of Report.

For Narmada Clean Tech

Twinkle Modi

Authorized By

Twinkle Modi
Sr. Executive QCD

End of Report

Format No. F/OPN/01/01 Issue no. 01 Issue date 01/04/2022 Rev no. 01 Rev date : 02/04/2024 Page 1 Of 1

Surti Bhagor, Nr. Gujarat Gas Office, Umarwada Road, Ankleshwar-393 001, Dist. Bharuch (Gujarat)
Tele : 8469745285, Email : info@nctc.co.in; website : www.nctc.co.in, CIN : U140101GJ2000NPL037236



AnyScanner



Analytical Laboratory
NARMADA CLEAN TECH
(A Subsidiary of GIDC)



Report No : NCT/MIAR/2025/OCT/N-115

Issue Date : 06/10/2025

URL No. : TC1159825000017079F

To :

ENVIRO TECHNOLOGY LIMITED

Plot No: 2413/14, GIDC ESTATE

ANKLESHWAR 393 002.

TEST REPORT

Kindly find here with the Test report.

Sample Description:	Waste Water	Sample Quantity:	750 ml
Sampling Location:	Free flow sample from Final Discharge Point	Sample Received Date:	05/10/2025
Sample Received By:	Mr. Upendra Rout	Sampling Plan & Procedure:	N.A.
Packing Details:	Preserved (250ml) and Unpreserved (500ml) sample in Plastic bottle	Analysis Start Date:	05/10/2025
Customer Sample Id	N-16	Analysis Completion Date:	05/10/2025
Sampling Start Date & Time:	05/10/2025 & 2:25	Sampling done By:	NCT Monitoring Team

Sr No.	Parameter	Unit	Results	Method Ref.
1	pH at Room Temperature	~	6.79	APHA 24th ed. 4500 H+B
2	Chemical Oxygen Demand	mg/L	656	APHA 24th ed. 5220 B
3	Ammonical Nitrogen	mg/L	19	APHA 24th ed. 4500 NH3C
4	Total Dissolved Solids Dried at 180°C	mg/L	16986	APHA 24th ed. 2540 C
5	Total Suspended Solids Dried from 103-105°C	mg/L	41	APHA 24th ed. 2540 D

Note: Joint Analysis will be entertained within 15 days from the date of sampling

Abbreviation: BDL – Below Detection Limit

Any addition to , deviations, or exclusions from the method : Not Applicable

Remarks :

Terms and conditions governing the test report issued

1. Sample is drawn by Narmada Clean Tech ; the results are applicable only to the Received samples from Customer.
2. The test report shall not be reproduced in full or part without the written approval of the Analytical Laboratory Narmada Clean Tech.
3. The test report in full or part shall not be used for promotional or publicity purpose without the written consent of Analytical Laboratory Narmada Clean Tech.
4. Waste water samples shall be stored for the period of Fifteen days after the date of issue of Report.

For Narmada Clean Tech

Twinkle Modi

Authorized By

Twinkle Modi
Sr. Executive QCD

----- End of Report -----

Format No. F/OPN/01/01 Issue no. 01 Issue date 01/04/2022 Rev no. 01 Rev date : 02/04/2024 Page 1 Of 1

Surti Bhagor, Nr. Gujarat Gas Office, Umarwada Road, Ankleshwar-393 001, Dist. Bharuch (Gujarat)
Tele : 8469745285, Email : info@nctc.co.in; website : www.nctc.co.in, CIN : U140101GJ2000NPL037236



AnyScanner



Analytical Laboratory
NARMADA CLEAN TECH
(A Subsidiary of GIDC)



Report No : NCT/MIAR/2025/OCT/N-275

Issue Date : 11/10/2025

URL No. : TC1159825000018139F

To :

ENVIRO TECHNOLOGY LIMITED

Plot No. 2413/14, GIDC ESTATE

ANKLESHWAR 393 002

TEST REPORT

Kindly find here with the Test report.

Sample Description:	Waste Water	Sample Quantity:	750 ml
Sampling Location:	Free flow sample from Final Discharge Point	Sample Received Date:	10/10/2025
Sample Received By:	Mr. Upendra Rout	Sampling Plan & Procedure:	N.A.
Packing Details:	Preserved (250ml) and Unpreserved (500ml) sample in Plastic bottle	Analysis Start Date:	10/10/2025
Customer Sample Id	N-10	Analysis Completion Date:	10/10/2025
Sampling Start Date & Time:	09/10/2025 & 19:16	Sampling done By:	NCT Monitoring Team

Sr No.	Parameter	Unit	Results	Method Ref.
1	pH at Room Temperature	~	6.58	APHA 24th ed. 4500 H+B
2	Chemical Oxygen Demand	mg/L	685	APHA 24th ed. 5220 B
3	Ammonical Nitrogen	mg/L	14	APHA 24th ed. 4500 NH3C
4	Total Dissolved Solids Dried at 180°C	mg/L	14932	APHA 24th ed. 2540 C
5	Total Suspended Solids Dried from 103-105°C	mg/L	38	APHA 24th ed. 2540 D

Note: Joint Analysis will be entertained within 15 days from the date of sampling

Abbreviation: BDL – Below Detection Limit

Any addition to , deviations, or exclusions from the method : Not Applicable

Remarks :

Terms and conditions governing the test report issued

1. Sample is drawn by Narmada Clean Tech ; the results are applicable only to the Received samples from Customer.
2. The test report shall not be reproduced in full or part without the written approval of the Analytical Laboratory Narmada Clean Tech.
3. The test report in full or part shall not be used for promotional or publicity purpose without the written consent of Analytical Laboratory Narmada Clean Tech.
4. Waste water samples shall be stored for the period of Fifteen days after the date of issue of Report.

For Narmada Clean Tech

Twinkle Modi

Authorized By

Twinkle Modi
Sr. Executive QCD

End of Report

Format No. F/OPN/01/01 Issue no. 01 Issue date 01/04/2022 Rev no. 01 Rev date : 02/04/2024 Page 1 Of 1

Surti Bhagor, Nr. Gujarat Gas Office, Umarwada Road, Ankleshwar-393 001, Dist. Bharuch (Gujarat)
Tele : 8469745285, Email : info@nctc.co.in; website : www.nctc.co.in, CIN : U140101GJ2000NPL037236



AnyScanner



Analytical Laboratory
NARMADA CLEAN TECH
(A Subsidiary of GIDC)



Report No : NCT/MIAR/2025/OCT/N-564

Issue Date : 20/10/2025

URL No. : TC1159825000018439F

To :

ENVIRO TECHNOLOGY LIMITED

Plot No: 2413/14, GIDC ESTATE

ANKLESHWAR 393 002.

TEST REPORT

Kindly find here with the Test report.

Sample Description:	Waste Water	Sample Quantity:	750 ml
Sampling Location:	Free flow sample from Final Discharge Point	Sample Received Date:	19/10/2025
Sample Received By:	Mr. Upendra Rout	Sampling Plan & Procedure:	N.A.
Packing Details:	Preserved (250ml) and Unpreserved (500ml) sample in Plastic bottle	Analysis Start Date:	19/10/2025
Customer Sample Id	N-11	Analysis Completion Date:	19/10/2025
Sampling Start Date & Time:	18/10/2025 & 19:15	Sampling done By:	NCT Monitoring Team

Sr No.	Parameter	Unit	Results	Method Ref.
1	pH at Room Temperature	~	7.25	APHA 24th ed. 4500 H+B
2	Chemical Oxygen Demand	mg/L	674	APHA 24th ed. 5220 B
3	Ammonical Nitrogen	mg/L	8	APHA 24th ed. 4500 NH3C
4	Total Dissolved Solids Dried at 180°C	mg/L	14938	APHA 24th ed. 2540 C
5	Total Suspended Solids Dried from 103-105°C	mg/L	39	APHA 24th ed. 2540 D

Note: Joint Analysis will be entertained within 15 days from the date of sampling

Abbreviation: BDL – Below Detection Limit

Any addition to , deviations, or exclusions from the method : Not Applicable

Remarks :

Terms and conditions governing the test report issued

1. Sample is drawn by Narmada Clean Tech ; the results are applicable only to the Received samples from Customer.
2. The test report shall not be reproduced in full or part without the written approval of the Analytical Laboratory Narmada Clean Tech.
3. The test report in full or part shall not be used for promotional or publicity purpose without the written consent of Analytical Laboratory Narmada Clean Tech.
4. Waste water samples shall be stored for the period of Fifteen days after the date of issue of Report.

For Narmada Clean Tech

Twinkle Modi

Authorized By

Twinkle Modi
Sr. Executive QCD

End of Report

Format No. F/OPN/01/01 Issue no. 01 Issue date 01/04/2022 Rev no. 01 Rev date : 02/04/2024 Page 1 Of 1

Surti Bhagor, Nr. Gujarat Gas Office, Umarwada Road, Ankleshwar-393 001, Dist. Bharuch (Gujarat)
Tele : 8469745285, Email : info@nctc.co.in; website : www.nctc.co.in, CIN : U140101GJ2000NPL037236



AnyScanner



Analytical Laboratory
NARMADA CLEAN TECH
(A Subsidiary of GIDC)



Report No : NCT/MIAR/2025/OCT/N-587

Issue Date : 21/10/2025

URL No. : TC1159825000018462F

To :

ENVIRO TECHNOLOGY LIMITED

Plot No: 2413/14, GIDC ESTATE

ANKLESHWAR 393 002.

TEST REPORT

Kindly find here with the Test report.

Sample Description:	Waste Water	Sample Quantity:	750 ml
Sampling Location:	Free flow sample from Final Discharge Point	Sample Received Date:	20/10/2025
Sample Received By:	Mr. Upendra Rout	Sampling Plan & Procedure:	N.A.
Packing Details:	Preserved (250ml) and Unpreserved (500ml) sample in Plastic bottle	Analysis Start Date:	20/10/2025
Customer Sample Id	N-8	Analysis Completion Date:	20/10/2025
Sampling Start Date & Time:	19/10/2025 & 17:22	Sampling done By:	NCT Monitoring Team

Sr No.	Parameter	Unit	Results	Method Ref.
1	pH at Room Temperature	~	6.94	APHA 24th ed. 4500 H+B
2	Chemical Oxygen Demand	mg/L	637	APHA 24th ed. 5220 B
3	Ammonical Nitrogen	mg/L	10	APHA 24th ed. 4500 NH3C
4	Total Dissolved Solids Dried at 180°C	mg/L	13986	APHA 24th ed. 2540 C
5	Total Suspended Solids Dried from 103-105°C	mg/L	42	APHA 24th ed. 2540 D

Note: Joint Analysis will be entertained within 15 days from the date of sampling

Abbreviation: BDL – Below Detection Limit

Any addition to , deviations, or exclusions from the method : Not Applicable

Remarks :

Terms and conditions governing the test report issued

1. Sample is drawn by Narmada Clean Tech ; the results are applicable only to the Received samples from Customer.
2. The test report shall not be reproduced in full or part without the written approval of the Analytical Laboratory Narmada Clean Tech.
3. The test report in full or part shall not be used for promotional or publicity purpose without the written consent of Analytical Laboratory Narmada Clean Tech.
4. Waste water samples shall be stored for the period of Fifteen days after the date of issue of Report.

For Narmada Clean Tech

Authorized By

Twinkle Modi
Sr. Executive QCD

----- End of Report -----

Format No. F/OPN/01/01 Issue no. 01 Issue date 01/04/2022 Rev no. 01 Rev date : 02/04/2024 Page 1 Of 1

Surti Bhagor, Nr. Gujarat Gas Office, Umarwada Road, Ankleshwar-393 001, Dist. Bharuch (Gujarat)
Tele : 8469745285, Email : info@nctc.co.in; website : www.nctc.co.in, CIN : U140101GJ2000NPL037236



AnyScanner



Analytical Laboratory
NARMADA CLEAN TECH
(A Subsidiary of GIDC)



Report No : NCT/MIAR/2025/OCT/N-671

Issue Date : 25/10/2025

URL No. : TC1159825000018555F

To :

ENVIRO TECHNOLOGY LIMITED

Plot No: 2413/14, GIDC ESTATE

ANKLESHWAR 393 002.

TEST REPORT

Kindly find here with the Test report.

Sample Description:	Waste Water	Sample Quantity:	750 ml
Sampling Location:	Sample collected from Autosampler	Sample Received Date:	24/10/2025
Sample Received By:	Mr. Upendra Rout	Sampling Plan & Procedure:	N.A.
Packing Details:	Preserved (250ml)and Unpreserved (500ml) sample in Plastic bottle	Analysis Start Date:	24/10/2025
Customer Sample Id	N-3	Analysis Completion Date:	24/10/2025
Sampling Start Date & Time:	23/10/2025 & 10:51	Sampling done By:	NCT Monitoring Team

Sr No.	Parameter	Unit	Results	Method Ref.
1	pH at Room Temperature	~	6.8	APHA 24th ed. 4500 H+B
2	Chemical Oxygen Demand	mg/L	727	APHA 24th ed. 5220 B
3	Ammonical Nitrogen	mg/L	BDL	APHA 24th ed. 4500 NH3C
4	Total Dissolved Solids Dried at 180°C	mg/L	14222	APHA 24th ed. 2540 C
5	Total Suspended Solids Dried from 103-105°C	mg/L	72	APHA 24th ed. 2540 D

Note: Joint Analysis will be entertained within 15 days from the date of sampling

Abbreviation: BDL – Below Detection Limit

Any addition to , deviations, or exclusions from the method : Not Applicable

Remarks :

Terms and conditions governing the test report issued

1. Sample is drawn by Narmada Clean Tech ; the results are applicable only to the Received samples from Customer.
2. The test report shall not be reproduced in full or part without the written approval of the Analytical Laboratory Narmada Clean Tech.
3. The test report in full or part shall not be used for promotional or publicity purpose without the written consent of Analytical Laboratory Narmada Clean Tech.
4. Waste water samples shall be stored for the period of Fifteen days after the date of issue of Report.

For Narmada Clean Tech

Twinkle Modi

Authorized By

Twinkle Modi
Sr. Executive QCD

----- End of Report -----

Format No. F/OPN/01/01 Issue no. 01 Issue date 01/04/2022 Rev no. 01 Rev date : 02/04/2024 Page 1 Of 1

Surti Bhagor, Nr. Gujarat Gas Office, Umarwada Road, Ankleshwar-393 001, Dist. Bharuch (Gujarat)
Tele : 8469745285, Email : info@nctc.co.in; website : www.nctc.co.in, CIN : U140101GJ2000NPL037236



AnyScanner



Analytical Laboratory
NARMADA CLEAN TECH
(A Subsidiary of GIDC)



Report No : NCT/MIAR/2025/OCT/N-765

Issue Date : 28/10/2025

URL No. : TC1159825000018650F

To :

ENVIRO TECHNOLOGY LIMITED

Plot No: 2413/14, GIDC ESTATE

ANKLESHWAR 393 002.

TEST REPORT

Kindly find here with the Test report.

Sample Description:	Waste Water	Sample Quantity:	750 ml
Sampling Location:	Free flow sample from Final Discharge Point	Sample Received Date:	27/10/2025
Sample Received By:	Mr. Upendra Rout	Sampling Plan & Procedure:	N.A.
Packing Details:	Preserved (250ml) and Unpreserved (500ml) sample in Plastic bottle	Analysis Start Date:	27/10/2025
Customer Sample Id	N-9	Analysis Completion Date:	27/10/2025
Sampling Start Date & Time:	27/10/2025 & 0:16	Sampling done By:	NCT Monitoring Team

Sr No.	Parameter	Unit	Results	Method Ref.
1	pH at Room Temperature	~	7.19	APHA 24th ed. 4500 H+B
2	Chemical Oxygen Demand	mg/L	656	APHA 24th ed. 5220 B
3	Ammonical Nitrogen	mg/L	BDL	APHA 24th ed. 4500 NH3C
4	Total Dissolved Solids Dried at 180°C	mg/L	13816	APHA 24th ed. 2540 C
5	Total Suspended Solids Dried from 103-105°C	mg/L	57	APHA 24th ed. 2540 D

Note: Joint Analysis will be entertained within 15 days from the date of sampling

Abbreviation: BDL – Below Detection Limit

Any addition to , deviations, or exclusions from the method : Not Applicable

Remarks :

Terms and conditions governing the test report issued

1. Sample is drawn by Narmada Clean Tech ; the results are applicable only to the Received samples from Customer.
2. The test report shall not be reproduced in full or part without the written approval of the Analytical Laboratory Narmada Clean Tech.
3. The test report in full or part shall not be used for promotional or publicity purpose without the written consent of Analytical Laboratory Narmada Clean Tech.
4. Waste water samples shall be stored for the period of Fifteen days after the date of issue of Report.

For Narmada Clean Tech

Twinkle Modi

Authorized By

Twinkle Modi
Sr. Executive QCD

----- End of Report -----

Format No. F/OPN/01/01 Issue no. 01 Issue date 01/04/2022 Rev no. 01 Rev date : 02/04/2024 Page 1 Of 1

Surti Bhagor, Nr. Gujarat Gas Office, Umarwada Road, Ankleshwar-393 001, Dist. Bharuch (Gujarat)
Tele : 8469745285, Email : info@nctc.co.in; website : www.nctc.co.in, CIN : U140101GJ2000NPL037236



AnyScanner



Analytical Laboratory
NARMADA CLEAN TECH
(A Subsidiary of GIDC)



Report No : NCT/MIAR/2025/OCT/N-862

Issue Date : 31/10/2025

URL No. : TC1159825000018746F

To :

ENVIRO TECHNOLOGY LIMITED

Plot No: 2413/14, GIDC ESTATE

ANKLESHWAR 393 002.

TEST REPORT

Kindly find here with the Test report.

Sample Description:	Waste Water	Sample Quantity:	750 ml
Sampling Location:	Free flow sample from Final Discharge Point	Sample Received Date:	30/10/2025
Sample Received By:	Mr. Upendra Rout	Sampling Plan & Procedure:	N.A.
Packing Details:	Preserved (250ml) and Unpreserved (500ml) sample in Plastic bottle	Analysis Start Date:	30/10/2025
Customer Sample Id	N-14	Analysis Completion Date:	30/10/2025
Sampling Start Date & Time:	30/10/2025 & 1:55	Sampling done By:	NCT Monitoring Team

Sr No.	Parameter	Unit	Results	Method Ref.
1	pH at Room Temperature	~	7.21	APHA 24th ed. 4500 H+B
2	Chemical Oxygen Demand	mg/L	624	APHA 24th ed. 5220 B
3	Ammonical Nitrogen	mg/L	4	APHA 24th ed. 4500 NH3C
4	Total Dissolved Solids Dried at 180°C	mg/L	15538	APHA 24th ed. 2540 C
5	Total Suspended Solids Dried from 103-105°C	mg/L	47	APHA 24th ed. 2540 D

Note: Joint Analysis will be entertained within 15 days from the date of sampling

Abbreviation: BDL – Below Detection Limit

Any addition to , deviations, or exclusions from the method : Not Applicable

Remarks :

Terms and conditions governing the test report issued

1. Sample is drawn by Narmada Clean Tech ; the results are applicable only to the Received samples from Customer.
2. The test report shall not be reproduced in full or part without the written approval of the Analytical Laboratory Narmada Clean Tech.
3. The test report in full or part shall not be used for promotional or publicity purpose without the written consent of Analytical Laboratory Narmada Clean Tech.
4. Waste water samples shall be stored for the period of Fifteen days after the date of issue of Report.

For Narmada Clean Tech

Twinkle Modi

Authorized By

Twinkle Modi
Sr. Executive QCD

End of Report

Format No. F/OPN/01/01 Issue no. 01 Issue date 01/04/2022 Rev no. 01 Rev date : 02/04/2024 Page 1 Of 1

Surti Bhagor, Nr. Gujarat Gas Office, Umarwada Road, Ankleshwar-393 001, Dist. Bharuch (Gujarat)
Tele : 8469745285, Email : info@nctc.co.in; website : www.nctc.co.in, CIN : U140101GJ2000NPL037236





Analytical Laboratory
NARMADA CLEAN TECH
(A Subsidiary of GIDC)



Report No : NCT/MIAR/2025/NOV/N-13

Issue Date : 03/11/2025

URL No. : TC1159825000018850F

To :

ENVIRO TECHNOLOGY LIMITED

Plot No. 2413/14, GIDC ESTATE

ANKLESHWAR 393 002.

TEST REPORT

Kindly find here with the Test report.

Sample Description:	Waste Water	Sample Quantity:	750 ml
Sampling Location:	Free flow sample from Final Discharge Point	Sample Received Date:	02/11/2025
Sample Received By:	Mr. Upendra Rout	Sampling Plan & Procedure:	N.A.
Packing Details:	Preserved (250ml) and Unpreserved (500ml) sample in Plastic bottle	Analysis Start Date:	02/11/2025
Customer Sample Id	N-13	Analysis Completion Date:	02/11/2025
Sampling Start Date & Time:	02/11/2025 & 1:30	Sampling done By:	NCT Monitoring Team

Sr No.	Parameter	Unit	Results	Method Ref.
1	pH at Room Temperature	~	7.13	APHA 24th ed. 4500 H+B
2	Chemical Oxygen Demand	mg/L	688	APHA 24th ed. 5220 B
3	Ammonical Nitrogen	mg/L	BDL	APHA 24th ed. 4500 NH3C
4	Total Dissolved Solids Dried at 180°C	mg/L	14382	APHA 24th ed. 2540 C
5	Total Suspended Solids Dried from 103-105°C	mg/L	42	APHA 24th ed. 2540 D

Note: Joint Analysis will be entertained within 15 days from the date of sampling

Abbreviation: BDL – Below Detection Limit

Any addition to , deviations, or exclusions from the method : Not Applicable

Remarks :

Terms and conditions governing the test report issued

1. Sample is drawn by Narmada Clean Tech ; the results are applicable only to the Received samples from Customer.
2. The test report shall not be reproduced in full or part without the written approval of the Analytical Laboratory Narmada Clean Tech.
3. The test report in full or part shall not be used for promotional or publicity purpose without the written consent of Analytical Laboratory Narmada Clean Tech.
4. Waste water samples shall be stored for the period of Fifteen days after the date of issue of Report.

For Narmada Clean Tech

Twinkle Modi

Authorized By

Twinkle Modi
Sr. Executive QCD

----- End of Report -----

Format No. F/OPN/01/01 Issue no. 01 Issue date 01/04/2022 Rev no. 01 Rev date : 02/04/2024 Page 1 Of 2

Surti Bhagor, Nr. Gujarat Gas Office, Umarwada Road, Ankleshwar-393 001, Dist. Bharuch (Gujarat)
Tele : 8469745285, Email : info@nctc.co.in; website : www.nctc.co.in, CIN : U140101GJ2000NPL037236



AnyScanner



Analytical Laboratory
NARMADA CLEAN TECH
(A Subsidiary of GIDC)



Report No : NCT/MIAR/2025/NOV/N-16

Issue Date : 03/11/2025

URL No. : TC1159825000018853F

To :

ENVIRO TECHNOLOGY LIMITED

Plot No: 2413/14, GIDC ESTATE

ANKLESHWAR 393 002.

TEST REPORT

Kindly find here with the Test report.

Sample Description:	Waste Water	Sample Quantity:	750 ml
Sampling Location:	Sample collected from Autosampler	Sample Received Date:	02/11/2025
Sample Received By:	Mr. Upendra Rout	Sampling Plan & Procedure:	N.A.
Packing Details:	Preserved (250ml) and Unpreserved (500ml) sample in Plastic bottle	Analysis Start Date:	02/11/2025
Customer Sample Id	N-16	Analysis Completion Date:	02/11/2025
Sampling Start Date & Time:	01/11/2025 & 18:38	Sampling done By:	NCT Monitoring Team

Sr No.	Parameter	Unit	Results	Method Ref.
1	pH at Room Temperature	~	6.94	APHA 24th ed. 4500 H+B
2	Chemical Oxygen Demand	mg/L	624	APHA 24th ed. 5220 B
3	Ammonical Nitrogen	mg/L	6	APHA 24th ed. 4500 NH3C
4	Total Dissolved Solids Dried at 180°C	mg/L	13628	APHA 24th ed. 2540 C
5	Total Suspended Solids Dried from 103-105°C	mg/L	45	APHA 24th ed. 2540 D

Note: Joint Analysis will be entertained within 15 days from the date of sampling

Abbreviation: BDL – Below Detection Limit

Any addition to , deviations, or exclusions from the method : Not Applicable

Remarks :

Terms and conditions governing the test report issued

1. Sample is drawn by Narmada Clean Tech ; the results are applicable only to the Received samples from Customer.
2. The test report shall not be reproduced in full or part without the written approval of the Analytical Laboratory Narmada Clean Tech.
3. The test report in full or part shall not be used for promotional or publicity purpose without the written consent of Analytical Laboratory Narmada Clean Tech.
4. Waste water samples shall be stored for the period of Fifteen days after the date of issue of Report.

For Narmada Clean Tech

Twinkle Modi

Authorized By

Twinkle Modi
Sr. Executive QCD

End of Report

Format No. F/OPN/01/01 Issue no. 01 Issue date 01/04/2022 Rev no. 01 Rev date : 02/04/2024 Page 2 Of 2

Surti Bhagor, Nr. Gujarat Gas Office, Umarwada Road, Ankleshwar-393 001, Dist. Bharuch (Gujarat)
Tele : 8469745285, Email : info@nctc.co.in; website : www.nctc.co.in, CIN : U140101GJ2000NPL037236



AnyScanner



Analytical Laboratory
NARMADA CLEAN TECH
(A Subsidiary of GIDC)



Report No : NCT/MIAR/2025/NOV/N-131

Issue Date : 06/11/2025

URL No. : TC1159825000018973F

To :

ENVIRO TECHNOLOGY LIMITED

Plot No: 2413/14, GIDC ESTATE

ANKLESHWAR 393 002.

TEST REPORT

Kindly find here with the Test report.

Sample Description:	Waste Water	Sample Quantity:	750 ml
Sampling Location:	Free flow sample from Final Discharge Point	Sample Received Date:	05/11/2025
Sample Received By:	Mr. Upendra Rout	Sampling Plan & Procedure:	N.A.
Packing Details:	Preserved (250ml) and Unpreserved (500ml) sample in Plastic bottle	Analysis Start Date:	05/11/2025
Customer Sample Id	N-12	Analysis Completion Date:	05/11/2025
Sampling Start Date & Time:	04/11/2025 & 20:36	Sampling done By:	NCT Monitoring Team

Sr No.	Parameter	Unit	Results	Method Ref.
1	pH at Room Temperature	~	7.13	APHA 24th ed. 4500 H+B
2	Chemical Oxygen Demand	mg/L	672	APHA 24th ed. 5220 B
3	Ammonical Nitrogen	mg/L	BDL	APHA 24th ed. 4500 NH3C
4	Total Dissolved Solids Dried at 180°C	mg/L	13686	APHA 24th ed. 2540 C
5	Total Suspended Solids Dried from 103-105°C	mg/L	46	APHA 24th ed. 2540 D

Note: Joint Analysis will be entertained within 15 days from the date of sampling

Abbreviation: BDL – Below Detection Limit

Any addition to , deviations, or exclusions from the method : Not Applicable

Remarks :

Terms and conditions governing the test report issued

1. Sample is drawn by Narmada Clean Tech ; the results are applicable only to the Received samples from Customer.
2. The test report shall not be reproduced in full or part without the written approval of the Analytical Laboratory Narmada Clean Tech.
3. The test report in full or part shall not be used for promotional or publicity purpose without the written consent of Analytical Laboratory Narmada Clean Tech.
4. Waste water samples shall be stored for the period of Fifteen days after the date of Issue of Report.

For Narmada Clean Tech

Modi Twinkle N.

Authorized By

Twinkle Modi
Sr. Executive QCD

----- End of Report -----

Format No. F/OPN/01/01 Issue no. 01 Issue date 01/04/2022 Rev no. 01 Rev date : 02/04/2024 Page 1 Of 2

Surti Bhagor, Nr. Gujarat Gas Office, Umarwada Road, Ankleshwar-393 001, Dist. Bharuch (Gujarat)
Tele : 8469745285, Email : info@nctc.co.in; website : www.nctc.co.in, CIN : U140101GJ2000NPL037236





Analytical Laboratory
NARMADA CLEAN TECH
(A Subsidiary of GIDC)



Report No : NCT/MIAR/2025/NOV/N-137

URL No. : TC1159825000018979F

To :

ENVIRO TECHNOLOGY LIMITED

Plot No: 2413/14, GIDC ESTATE

ANKLESHWAR 393 002.

Issue Date : 06/11/2025

TEST REPORT

Kindly find here with the Test report.

Sample Description:	Waste Water	Sample Quantity:	750 ml
Sampling Location:	Free flow sample from Final Discharge Point	Sample Received Date:	05/11/2025
Sample Received By:	Mr. Upendra Rout	Sampling Plan & Procedure:	N.A.
Packing Details:	Preserved (250ml) and Unpreserved (500ml) sample in Plastic bottle	Analysis Start Date:	05/11/2025
Customer Sample Id	N-18	Analysis Completion Date:	05/11/2025
Sampling Start Date & Time:	05/11/2025 & 1:44	Sampling done By:	NCT Monitoring Team

Sr No.	Parameter	Unit	Results	Method Ref.
1	pH at Room Temperature	~	7.24	APHA 24th ed. 4500 H+B
2	Chemical Oxygen Demand	mg/L	640	APHA 24th ed. 5220 B
3	Ammonical Nitrogen	mg/L	BDL	APHA 24th ed. 4500 NH3C
4	Total Dissolved Solids Dried at 180°C	mg/L	13726	APHA 24th ed. 2540 C
5	Total Suspended Solids Dried from 103-105°C	mg/L	45	APHA 24th ed. 2540 D

Note: Joint Analysis will be entertained within 15 days from the date of sampling

Abbreviation: BDL – Below Detection Limit

Any addition to , deviations, or exclusions from the method : Not Applicable

Remarks :

Terms and conditions governing the test report issued

1. Sample is drawn by Narmada Clean Tech ; the results are applicable only to the Received samples from Customer.
2. The test report shall not be reproduced in full or part without the written approval of the Analytical Laboratory Narmada Clean Tech.
3. The test report in full or part shall not be used for promotional or publicity purpose without the written consent of Analytical Laboratory Narmada Clean Tech.
4. Waste water samples shall be stored for the period of Fifteen days after the date of issue of Report.

For Narmada Clean Tech

Authorized By

Twinkle Modi
Sr. Executive QCD

----- End of Report -----

Format No. F/OPN/01/01 Issue no. 01 Issue date 01/04/2022 Rev no. 01 Rev date : 02/04/2024 Page 2 Of 2

Surti Bhagor, Nr. Gujarat Gas Office, Umarwada Road, Ankleshwar-393 001, Dist. Bharuch (Gujarat)
Tele : 8469745285, Email : info@nctc.co.in; website : www.nctc.co.in, CIN : U140101GJ2000NPL037236



AnyScanner



Analytical Laboratory
NARMADA CLEAN TECH
(A Subsidiary of GIDC)



Report No : NCT/MIAR/2025/NOV/N-416

Issue Date : 13/11/2025

URL No. : TC1159825000019266F

To :

ENVIRO TECHNOLOGY LIMITED

Plot No: 2413/14, GIDC ESTATE

ANKLESHWAR 393 002.

TEST REPORT

Kindly find here with the Test report.

Sample Description:	Waste Water	Sample Quantity:	750 ml
Sampling Location:	Free flow sample from Final Discharge Point	Sample Received Date:	12/11/2025
Sample Received By:	Mr. Upendra Rout	Sampling Plan & Procedure:	N.A.
Packing Details:	Preserved (250ml) and Unpreserved (500ml) sample in Plastic bottle	Analysis Start Date:	12/11/2025
Customer Sample Id	N-14	Analysis Completion Date:	12/11/2025
Sampling Start Date & Time:	12/11/2025 & 0:36	Sampling done By:	NCT Monitoring Team

Sr No.	Parameter	Unit	Results	Method Ref.
1	pH at Room Temperature	~	7.08	APHA 24th ed. 4500 H+B
2	Chemical Oxygen Demand	mg/L	741	APHA 24th ed. 5220 B
3	Ammonical Nitrogen	mg/L	4	APHA 24th ed. 4500 NH3C
4	Total Dissolved Solids Dried at 180°C	mg/L	15316	APHA 24th ed. 2540 C
5	Total Suspended Solids Dried from 103-105°C	mg/L	42	APHA 24th ed. 2540 D

Note: Joint Analysis will be entertained within 15 days from the date of sampling

Abbreviation: BDL – Below Detection Limit

Any addition to , deviations, or exclusions from the method : Not Applicable

Remarks :

Terms and conditions governing the test report issued

1. Sample is drawn by Narmada Clean Tech ; the results are applicable only to the Received samples from Customer.
2. The test report shall not be reproduced in full or part without the written approval of the Analytical Laboratory Narmada Clean Tech.
3. The test report in full or part shall not be used for promotional or publicity purpose without the written consent of Analytical Laboratory Narmada Clean Tech.
4. Waste water samples shall be stored for the period of Fifteen days after the date of issue of Report.

For Narmada Clean Tech

Twinkle Modi

Authorized By

Twinkle Modi
Sr. Executive QCD

End of Report

Format No. F/OPN/01/01 Issue no. 01 Issue date 01/04/2022 Rev no. 01 Rev date : 02/04/2024 Page 1 Of 1

Surti Bhagor, Nr. Gujarat Gas Office, Umarwada Road, Ankleshwar-393 001, Dist. Bharuch (Gujarat)
Tele : 8469745285, Email : info@nctc.co.in; website : www.nctc.co.in, CIN : U140101GJ2000NPL037236



AnyScanner



Analytical Laboratory
NARMADA CLEAN TECH
(A Subsidiary of GIDC)



Report No : NCT/MIAR/2025/NOV/N-443

Issue Date : 14/11/2025

URL No. : TC1159825000019293F

To :

ENVIRO TECHNOLOGY LIMITED

Plot No: 2413/14, GIDC ESTATE

ANKLESHWAR 393 002.

TEST REPORT

Kindly find here with the Test report.

Sample Description:	Waste Water	Sample Quantity:	750 ml
Sampling Location:	Free flow sample from Final Discharge Point	Sample Received Date:	13/11/2025
Sample Received By:	Mr. Upendra Rout	Sampling Plan & Procedure:	N.A.
Packing Details:	Preserved (250ml) and Unpreserved (500ml) sample in Plastic bottle	Analysis Start Date:	13/11/2025
Customer Sample Id	N-4	Analysis Completion Date:	13/11/2025
Sampling Start Date & Time:	13/11/2025 & 2:22	Sampling done By:	NCT Monitoring Team

Sr No.	Parameter	Unit	Results	Method Ref.
1	pH at Room Temperature	~	7.04	APHA 24th ed. 4500 H+B
2	Chemical Oxygen Demand	mg/L	628	APHA 24th ed. 5220 B
3	Ammonical Nitrogen	mg/L	7	APHA 24th ed. 4500 NH ₃ C
4	Total Dissolved Solids Dried at 180°C	mg/L	15234	APHA 24th ed. 2540 C
5	Total Suspended Solids Dried from 103-105°C	mg/L	46	APHA 24th ed. 2540 D

Note: Joint Analysis will be entertained within 15 days from the date of sampling

Abbreviation: BDL – Below Detection Limit

Any addition to , deviations, or exclusions from the method : Not Applicable

Remarks :

Terms and conditions governing the test report issued

1. Sample is drawn by Narmada Clean Tech ; the results are applicable only to the Received samples from Customer.
2. The test report shall not be reproduced in full or part without the written approval of the Analytical Laboratory Narmada Clean Tech.
3. The test report in full or part shall not be used for promotional or publicity purpose without the written consent of Analytical Laboratory Narmada Clean Tech.
4. Waste water samples shall be stored for the period of Fifteen days after the date of issue of Report.

For Narmada Clean Tech

Twinkle Modi

Authorized By

Twinkle Modi
Sr. Executive QCD

----- End of Report -----

Format No. F/OPN/01/01 Issue no. 01 Issue date 01/04/2022 Rev no. 01 Rev date : 02/04/2024 Page 1 Of 1

Surti Bhagor, Nr. Gujarat Gas Office, Umarwada Road, Ankleshwar-393 001, Dist. Bharuch (Gujarat)
Tele : 8469745285, Email : info@nctc.co.in; website : www.nctc.co.in, CIN : U140101GJ2000NPL037236



AnyScanner



Analytical Laboratory
NARMADA CLEAN TECH
(A Subsidiary of GIDC)



Report No : NCT/MIAR/2025/NOV/N-494

Issue Date : 15/11/2025

URL No. : TC1159825000019341F

To :

ENVIRO TECHNOLOGY LIMITED

Plot No. 2413/14, GIDC ESTATE

ANKLESHWAR 393 002.

TEST REPORT

Kindly find here with the Test report.

Sample Description	Waste Water	Sample Quantity	750 ml
Sampling Location	Sample collected from Autosampler	Sample Received Date	14/11/2025
Sample Received By	Mr. Upendra Rout	Sampling Plan & Procedure	N A
Packing Details	Preserved (250ml) and Unpreserved (500ml) sample in Plastic bottle	Analysis Start Date	14/11/2025
Customer Sample Id	N-12	Analysis Completion Date	14/11/2025
Sampling Start Date & Time	13/11/2025 & 19.33	Sampling done By	NCT Monitoring Team

Sr No.	Parameter	Unit	Results	Method Ref.
1	pH at Room Temperature	~	6.88	APHA 24th ed. 4500 H+B
2	Chemical Oxygen Demand	mg/L	573	APHA 24th ed. 5220 B
3	Ammonical Nitrogen	mg/L	BDL	APHA 24th ed. 4500 NH3C
4	Total Dissolved Solids Dried at 180°C	mg/L	14652	APHA 24th ed. 2540 C
5	Total Suspended Solids Dried from 103-105°C	mg/L	39	APHA 24th ed. 2540 D

Note: Joint Analysis will be entertained within 15 days from the date of sampling

Abbreviation: BDL – Below Detection Limit

Any addition to , deviations, or exclusions from the method : Not Applicable

Remarks :

Terms and conditions governing the test report issued

1. Sample is drawn by Narmada Clean Tech ; the results are applicable only to the Received samples from Customer.
2. The test report shall not be reproduced in full or part without the written approval of the Analytical Laboratory Narmada Clean Tech.
3. The test report in full or part shall not be used for promotional or publicity purpose without the written consent of Analytical Laboratory Narmada Clean Tech.
4. Waste water samples shall be stored for the period of Fifteen days after the date of issue of Report.

For Narmada Clean Tech

Twinkle Modi

Authorized By

Twinkle Modi
Sr. Executive QCD

End of Report

Format No. F/OPN/01/01 Issue no. 01 Issue date 01/04/2022 Rev no. 01 Rev date : 02/04/2024 Page 1 Of 1

Surti Bhagor, Nr. Gujarat Gas Office, Umarwada Road, Ankleshwar-393 001, Dist. Bharuch (Gujarat)
Tele : 8469745285, Email : info@nctc.co.in; website : www.nctc.co.in, CIN : U140101GJ2000NPL037236





Analytical Laboratory
NARMADA CLEAN TECH
(A Subsidiary of GIDC)



Report No : NCT/MIA/R/2025/NOV/N-S12

Issue Date : 18/11/2025

URL No. : TC1159825000019467F

To :

ENVIRO TECHNOLOGY LIMITED

Plot No. 2413/14, GIDC ESTATE

ANKLESHWAR 393 002.

TEST REPORT

Kindly find here with the Test report.

Sample Description:	Waste Water	Sample Quantity:	750 ml
Sampling Location:	Free flow sample from Final Discharge Point	Sample Received Date:	17/11/2025
Sample Received By:	Mr. Upendra Rout	Sampling Plan & Procedure:	N.A.
Packing Details:	Preserved (250ml) and Unpreserved (500ml) sample in Plastic bottle	Analysis Start Date:	17/11/2025
Customer Sample Id	N-19	Analysis Completion Date:	17/11/2025
Sampling Start Date & Time:	17/11/2025 & 2:00	Sampling done By:	NCT Monitoring Team

Sr No.	Parameter	Unit	Results	Method Ref.
1	pH at Room Temperature	-	7.07	APHA 24th ed. 4500 H+B
2	Chemical Oxygen Demand	mg/L	768	APHA 24th ed. 5220 B
3	Ammonical Nitrogen	mg/L	13	APHA 24th ed. 4500 NH3C
4	Total Dissolved Solids Dried at 180°C	mg/L	16336	APHA 24th ed. 2540 C
5	Total Suspended Solids Dried from 103-105°C	mg/L	39	APHA 24th ed. 2540 D

Note: Joint Analysis will be entertained within 15 days from the date of sampling

Abbreviation: BDL – Below Detection Limit

Any addition to , deviations, or exclusions from the method : Not Applicable

Remarks :

Terms and conditions governing the test report issued

1. Sample is drawn by Narmada Clean Tech ; the results are applicable only to the Received samples from Customer.
2. The test report shall not be reproduced in full or part without the written approval of the Analytical Laboratory Narmada Clean Tech.
3. The test report in full or part shall not be used for promotional or publicity purpose without the written consent of Analytical Laboratory Narmada Clean Tech.
4. Waste water samples shall be stored for the period of Fifteen days after the date of issue of Report.

For Narmada Clean Tech

Twinkle Modi

Authorized By

Twinkle Modi
Sr. Executive QCD

End of Report

Format No. F/OPN/01/01 Issue no. 01 Issue date 01/04/2022 Rev no. 01 Rev date : 02/04/2024 Page 1 Of 1

Surti Bhagor, Nr. Gujarat Gas Office, Umarwada Road, Ankleshwar-393 001, Dist. Bharuch (Gujarat)
Tele : 8469745285, Email : info@nctc.co.in; website : www.nctc.co.in, CIN : U140101GJ2000NPL037236



AnyScanner



Analytical Laboratory
NARMADA CLEAN TECH
(A Subsidiary of GIDC)



Report No : NCT/MIAR/2025/NOV/N-812

Issue Date : 24/11/2025

URL No : TC1159825000019667F

To :

ENVIRO TECHNOLOGY LIMITED

Plot No. 2413/14, GIDC ESTATE

ANKLESHWAR 393 002.

TEST REPORT

Kindly find here with the Test report.

Sample Description:	Waste Water	Sample Quantity:	750 ml
Sampling Location:	Free flow sample from Final Discharge Point	Sample Received Date:	23/11/2025
Sample Received By:	Mr. Upendra Rout	Sampling Plan & Procedure:	N.A.
Packing Details:	Preserved (250ml) and Unpreserved (500ml) sample in Plastic bottle	Analysis Start Date:	23/11/2025
Customer Sample Id	N-1	Analysis Completion Date:	23/11/2025
Sampling Start Date & Time:	22/11/2025 & 12:27	Sampling done By:	NCT Monitoring Team

Sr No.	Parameter	Unit	Results	Method Ref.
1	pH at Room Temperature	~	6.98	APHA 24th ed. 4500 H+B
2	Chemical Oxygen Demand	mg/L	730	APHA 24th ed. 5220 B
3	Ammonical Nitrogen	mg/L	7	APHA 24th ed. 4500 NH3C
4	Total Dissolved Solids Dried at 180°C	mg/L	20944	APHA 24th ed. 2540 C
5	Total Suspended Solids Dried from 103-105°C	mg/L	44	APHA 24th ed. 2540 D

Note: Joint Analysis will be entertained within 15 days from the date of sampling

Abbreviation: BDL – Below Detection Limit

Any addition to , deviations, or exclusions from the method : Not Applicable

Remarks :

Terms and conditions governing the test report issued

1. Sample is drawn by Narmada Clean Tech ; the results are applicable only to the Received samples from Customer.
2. The test report shall not be reproduced in full or part without the written approval of the Analytical Laboratory Narmada Clean Tech.
3. The test report in full or part shall not be used for promotional or publicity purpose without the written consent of Analytical Laboratory Narmada Clean Tech.
4. Waste water samples shall be stored for the period of Fifteen days after the date of issue of Report.

For Narmada Clean Tech

Twinkle Modi

Authorized By

Twinkle Modi
Sr. Executive QCD

End of Report

Format No. F/OPN/01/01 Issue no. 01 Issue date 01/04/2022 Rev no. 01 Rev date : 02/04/2024 Page 1 Of 1

Surti Bhagor, Nr. Gujarat Gas Office, Umarwada Road, Ankleshwar-393 001, Dist. Bharuch (Gujarat)
Tele : 8469745285, Email : info@nctc.co.in; website : www.nctc.co.in, CIN : U140101GJ2000NPL037236



AnyScanner



Report No : NCT/MIAR/2025/NOV/N-894

Issue Date : 26/11/2025

URL No. : TC1159825000019749F

To :

ENVIRO TECHNOLOGY LIMITED

Plot No: 2413/14, GIDC ESTATE

ANKLESHWAR 393 002.

TEST REPORT

Kindly find here with the Test report.

Sample Description:	Waste Water	Sample Quantity:	750 ml
Sampling Location:	Free flow sample from Final Discharge Point	Sample Received Date:	25/11/2025
Sample Received By:	Mr. Upendra Rout	Sampling Plan & Procedure:	N.A.
Packing Details:	Preserved (250ml) and Unpreserved (500ml) sample in Plastic bottle	Analysis Start Date:	25/11/2025
Customer Sample Id	N-8	Analysis Completion Date:	25/11/2025
Sampling Start Date & Time:	25/11/2025 & 0:20	Sampling done By:	NCT Monitoring Team

Sr No.	Parameter	Unit	Results	Method Ref.
1	pH at Room Temperature	~	7.54	APHA 24th ed. 4500 H+B
2	Chemical Oxygen Demand	mg/L	752	APHA 24th ed. 5220 B
3	Ammonical Nitrogen	mg/L	BDL	APHA 24th ed. 4500 NH3C
4	Total Dissolved Solids Dried at 180°C	mg/L	20244	APHA 24th ed. 2540 C
5	Total Suspended Solids Dried from 103-105°C	mg/L	18	APHA 24th ed. 2540 D

Note: Joint Analysis will be entertained within 15 days from the date of sampling

Abbreviation: BDL – Below Detection Limit

Any addition to , deviations, or exclusions from the method : Not Applicable

Remarks :

Terms and conditions governing the test report issued

1. Sample is drawn by Narmada Clean Tech ; the results are applicable only to the Received samples from Customer.
2. The test report shall not be reproduced in full or part without the written approval of the Analytical Laboratory Narmada Clean Tech.
3. The test report in full or part shall not be used for promotional or publicity purpose without the written consent of Analytical Laboratory Narmada Clean Tech.
4. Waste water samples shall be stored for the period of Fifteen days after the date of issue of Report.

For Narmada Clean Tech

Authorized By

Twinkle Modi
Sr. Executive QCD

----- End of Report -----

Format No. F/OPN/01/01 Issue no. 01 Issue date 01/04/2022 Rev no. 01 Rev date : 02/04/2024 Page 1 Of 1

Surti Bhagor, Nr. Gujarat Gas Office, Umarwada Road, Ankleshwar-393 001, Dist. Bharuch (Gujarat)
Tele : 8469745285, Email : info@nctc.co.in; website : www.nctc.co.in, CIN : U140101GJ2000NPL037236



Analytical Laboratory
NARMADA CLEAN TECH
(A Subsidiary of GIDC)



Report No : NCT/MIAR/2025/NOV/N-924

Issue Date : 27/11/2025

URL No. : TC1159825000019787F

To :

ENVIRO TECHNOLOGY LIMITED

Plot No: 2413/14, GIDC ESTATE

ANKLESHWAR 393 002.

TEST REPORT

Kindly find here with the Test report.

Sample Description:	Waste Water	Sample Quantity:	750 ml
Sampling Location:	Free flow sample from Final Discharge Point	Sample Received Date:	26/11/2025
Sample Received By:	Mr. Upendra Rout	Sampling Plan & Procedure:	N.A.
Packing Details:	Preserved (250ml) and Unpreserved (500ml) sample in Plastic bottle	Analysis Start Date:	26/11/2025
Customer Sample Id	N-10	Analysis Completion Date:	26/11/2025
Sampling Start Date & Time:	26/11/2025 & 2:00	Sampling done By:	NCT Monitoring Team

Sr No.	Parameter	Unit	Results.	Method Ref.
1	pH at Room Temperature	~	7.29	APHA 24th ed. 4500 H+B
2	Chemical Oxygen Demand	mg/L	771	APHA 24th ed. 5220 B
3	Ammonical Nitrogen	mg/L	BDL	APHA 24th ed. 4500 NH3C
4	Total Dissolved Solids Dried at 180°C	mg/L	20344	APHA 24th ed. 2540 C
5	Total Suspended Solids Dried from 103-105°C	mg/L	31	APHA 24th ed. 2540 D

Note: Joint Analysis will be entertained within 15 days from the date of sampling

Abbreviation: BDL – Below Detection Limit

Any addition to , deviations, or exclusions from the method : Not Applicable

Remarks :

Terms and conditions governing the test report issued

1. Sample is drawn by Narmada Clean Tech ; the results are applicable only to the Received samples from Customer.
2. The test report shall not be reproduced in full or part without the written approval of the Analytical Laboratory Narmada Clean Tech.
3. The test report in full or part shall not be used for promotional or publicity purpose without the written consent of Analytical Laboratory Narmada Clean Tech.
4. Waste water samples shall be stored for the period of Fifteen days after the date of issue of Report.

For Narmada Clean Tech

Modi Twinkle

Authorized By

Twinkle Modi
Sr. Executive QCD

----- End of Report -----

Format No. F/OPN/01/01 Issue no. 01 Issue date 01/04/2022 Rev no. 01 Rev date : 02/04/2024 Page 1 Of 1

Surti Bhagor, Nr. Gujarat Gas Office, Umarwada Road, Ankleshwar-393 001, Dist. Bharuch (Gujarat)
Tele : 8469745285, Email : info@nctc.co.in; website : www.nctc.co.in, CIN : U140101GJ2000NPL037236



AnyScanner



Analytical Laboratory
NARMADA CLEAN TECH
(A Subsidiary of GIDC)



Report No : NCT/MIAR/2025/NOV/N-992

Issue Date : 29/11/2025

URL No. : TC1159825000019855F

To :

ENVIRO TECHNOLOGY LIMITED

Plot No: 2413/14, GIDC ESTATE

ANKLESHWAR 393 002.

TEST REPORT

Kindly find here with the Test report.

Sample Description:	Waste Water	Sample Quantity:	750 ml
Sampling Location:	Sample collected from Autosampler	Sample Received Date:	28/11/2025
Sample Received By:	Mr. Upendra Rout	Sampling Plan & Procedure:	N.A.
Packing Details:	Preserved (250ml) and Unpreserved (500ml) sample in Plastic bottle	Analysis Start Date:	28/11/2025
Customer Sample Id	N-13	Analysis Completion Date:	28/11/2025
Sampling Start Date & Time:	27/11/2025 & 20:12	Sampling done By:	NCT Monitoring Team

Sr No.	Parameter	Unit	Results	Method Ref.
1	pH at Room Temperature	~	6.89	APHA 24th ed. 4500 H+B
2	Chemical Oxygen Demand	mg/L	704	APHA 24th ed. 5220 B
3	Ammonical Nitrogen	mg/L	6	APHA 24th ed. 4500 NH3C
4	Total Dissolved Solids Dried at 180°C	mg/L	19312	APHA 24th ed. 2540 C
5	Total Suspended Solids Dried from 103-105°C	mg/L	35	APHA 24th ed. 2540 D

Note: Joint Analysis will be entertained within 15 days from the date of sampling

Abbreviation: BDL – Below Detection Limit

Any addition to , deviations, or exclusions from the method : Not Applicable

Remarks :

Terms and conditions governing the test report issued

1. Sample is drawn by Narmada Clean Tech ; the results are applicable only to the Received samples from Customer.
2. The test report shall not be reproduced in full or part without the written approval of the Analytical Laboratory Narmada Clean Tech.
3. The test report in full or part shall not be used for promotional or publicity purpose without the written consent of Analytical Laboratory Narmada Clean Tech.
4. Waste water samples shall be stored for the period of Fifteen days after the date of issue of Report.

For Narmada Clean Tech

Authorized By

Twinkle Modi
Sr. Executive QCD

End of Report

Format No. F/OPN/01/01 Issue no. 01 Issue date 01/04/2022 Rev no. 01 Rev date : 02/04/2024 Page 1 Of 1

Surti Bhagor, Nr. Gujarat Gas Office, Umarwada Road, Ankleshwar-393 001, Dist. Bharuch (Gujarat)
Tele : 8469745285, Email : info@nctc.co.in; website : www.nctc.co.in, CIN : U140101GJ2000NPL037236



AnyScanner



Analytical Laboratory
NARMADA CLEAN TECH
(A Subsidiary of GIDC)



Report No : NCT/MIAR/2025/NOV/N-1022

Issue Date : 30/11/2025

URL No. : TC1159825000019889F

To :

ENVIRO TECHNOLOGY LIMITED

Plot No: 2413/14, GIDC ESTATE

ANKLESHWAR 393 002.

TEST REPORT

Kindly find here with the Test report.

Sample Description:	Waste Water	Sample Quantity:	750 ml
Sampling Location:	Free flow sample from Final Discharge Point	Sample Received Date:	29/11/2025
Sample Received By:	Mr. Upendra Rout	Sampling Plan & Procedure:	N.A.
Packing Details:	Preserved (250ml) and Unpreserved (500ml) sample in Plastic bottle	Analysis Start Date:	29/11/2025
Customer Sample Id	N-11	Analysis Completion Date:	29/11/2025
Sampling Start Date & Time:	29/11/2025 & 1:55	Sampling done By:	NCT Monitoring Team

Sr No.	Parameter	Unit	Results	Method Ref.
1	pH at Room Temperature	~	7.34	APHA 24th ed. 4500 H+B
2	Chemical Oxygen Demand	mg/L	720	APHA 24th ed. 5220 B
3	Ammonical Nitrogen	mg/L	BDL	APHA 24th ed. 4500 NH3C
4	Total Dissolved Solids Dried at 180°C	mg/L	20440	APHA 24th ed. 2540 C
5	Total Suspended Solids Dried from 103-105°C	mg/L	29	APHA 24th ed. 2540 D

Note: Joint Analysis will be entertained within 15 days from the date of sampling

Abbreviation: BDL – Below Detection Limit

Any addition to , deviations, or exclusions from the method : Not Applicable

Remarks :

Terms and conditions governing the test report issued

1. Sample is drawn by Narmada Clean Tech ; the results are applicable only to the Received samples from Customer.
2. The test report shall not be reproduced in full or part without the written approval of the Analytical Laboratory Narmada Clean Tech.
3. The test report in full or part shall not be used for promotional or publicity purpose without the written consent of Analytical Laboratory Narmada Clean Tech.
4. Waste water samples shall be stored for the period of Fifteen days after the date of issue of Report.

For Narmada Clean Tech

Authorized By

Twinkle Modi
Sr. Executive QCD

----- End of Report -----

Format No. F/OPN/01/01 Issue no. 01 Issue date 01/04/2022 Rev no. 01 Rev date : 02/04/2024 Page 1 Of 1

Surti Bhagor, Nr. Gujarat Gas Office, Umarwada Road, Ankleshwar-393 001, Dist. Bharuch (Gujarat)
Tele : 8469745285, Email : info@nctc.co.in; website : www.nctc.co.in, CIN : U140101GJ2000NPL037236



AnyScanner



Analytical Laboratory
NARMADA CLEAN TECH
(A Subsidiary of GIDC)



Report No : NCT/MIAR/2025/NOV/N-1022

Issue Date : 30/11/2025

URL No. : TC1159825000019889F

To :

ENVIRO TECHNOLOGY LIMITED

Plot No: 2413/14, GIDC ESTATE

ANKLESHWAR 393 002.

TEST REPORT

Kindly find here with the Test report.

Sample Description:	Waste Water	Sample Quantity:	750 ml
Sampling Location:	Free flow sample from Final Discharge Point	Sample Received Date:	29/11/2025
Sample Received By:	Mr. Upendra Rout	Sampling Plan & Procedure:	N.A.
Packing Details:	Preserved (250ml) and Unpreserved (500ml) sample in Plastic bottle	Analysis Start Date:	29/11/2025
Customer Sample Id	N-11	Analysis Completion Date:	29/11/2025
Sampling Start Date & Time:	29/11/2025 & 1:55	Sampling done By:	NCT Monitoring Team

Sr No.	Parameter	Unit	Results	Method Ref.
1	pH at Room Temperature	~	7.34	APHA 24th ed. 4500 H+B
2	Chemical Oxygen Demand	mg/L	720	APHA 24th ed. 5220 B
3	Ammonical Nitrogen	mg/L	BDL	APHA 24th ed. 4500 NH3C
4	Total Dissolved Solids Dried at 180°C	mg/L	20440	APHA 24th ed. 2540 C
5	Total Suspended Solids Dried from 103-105°C	mg/L	29	APHA 24th ed. 2540 D

Note: Joint Analysis will be entertained within 15 days from the date of sampling

Abbreviation: BDL – Below Detection Limit

Any addition to , deviations, or exclusions from the method : Not Applicable

Remarks :

Terms and conditions governing the test report issued

1. Sample is drawn by Narmada Clean Tech ; the results are applicable only to the Received samples from Customer.
2. The test report shall not be reproduced in full or part without the written approval of the Analytical Laboratory Narmada Clean Tech.
3. The test report in full or part shall not be used for promotional or publicity purpose without the written consent of Analytical Laboratory Narmada Clean Tech.
4. Waste water samples shall be stored for the period of Fifteen days after the date of issue of Report.

For Narmada Clean Tech

Authorized By

Twinkle Modi
Sr. Executive QCD

End of Report

Format No. F/OPN/01/01 Issue no. 01 Issue date 01/04/2022 Rev no. 01 Rev date : 02/04/2024 Page 1 Of 1

Surti Bhagor, Nr. Gujarat Gas Office, Umarwada Road, Ankleshwar-393 001, Dist. Bharuch (Gujarat)
Tele : 8469745285, Email : info@nctc.co.in; website : www.nctc.co.in, CIN : U140101GJ2000NPL037236



AnyScanner



Analytical Laboratory
NARMADA CLEAN TECH
(A Subsidiary of GIDC)



Report No : NCT/MIAR/2025/DEC/N-82

Issue Date : 05/12/2025

URL No. : TC1159825000020052F

To :

ENVIRO TECHNOLOGY LIMITED

Plot No: 2413/14, GIDC ESTATE

ANKLESHWAR 393 002.

TEST REPORT

Kindly find here with the Test report.

Sample Description:	Waste Water	Sample Quantity:	750 ml
Sampling Location:	Free flow sample from Final Discharge Point	Sample Received Date:	04/12/2025
Sample Received By:	Mr. Upendra Rout	Sampling Plan & Procedure:	N.A.
Packing Details:	Preserved (250ml) and Unpreserved (500ml) sample in Plastic bottle	Analysis Start Date:	04/12/2025
Customer Sample Id	N-17	Analysis Completion Date:	04/12/2025
Sampling Start Date & Time:	04/12/2025 & 0:40	Sampling done By:	NCT Monitoring Team

Sr No.	Parameter	Unit	Results	Method Ref.
1	pH at Room Temperature	~	7.33	APHA 24th ed. 4500 H+B
2	Chemical Oxygen Demand	mg/L	720	APHA 24th ed. 5220 B
3	Ammonical Nitrogen	mg/L	BDL	APHA 24th ed. 4500 NH3C
4	Total Dissolved Solids Dried at 180°C	mg/L	18722	APHA 24th ed. 2540 C
5	Total Suspended Solids Dried from 103-105°C	mg/L	32	APHA 24th ed. 2540 D

Note: Joint Analysis will be entertained within 15 days from the date of sampling

Abbreviation: BDL – Below Detection Limit

Any addition to , deviations, or exclusions from the method : Not Applicable

Remarks :

Terms and conditions governing the test report issued

1. Sample is drawn by Narmada Clean Tech ; the results are applicable only to the Received samples from Customer.
2. The test report shall not be reproduced in full or part without the written approval of the Analytical Laboratory Narmada Clean Tech.
3. The test report in full or part shall not be used for promotional or publicity purpose without the written consent of Analytical Laboratory Narmada Clean Tech.
4. Waste water samples shall be stored for the period of Fifteen days after the date of issue of Report.

For Narmada Clean Tech

Authorized By

Twinkle Modi
Sr. Executive QCD

End of Report

Format No. F/OPN/01/01 Issue no. 01 Issue date 01/04/2022 Rev no. 01 Rev date : 02/04/2024 Page 1 Of 1

Surti Bhagor, Nr. Gujarat Gas Office, Umarwada Road, Ankleshwar-393 001, Dist. Bharuch (Gujarat)
Tele : 8469745285, Email : info@nctc.co.in; website : www.nctc.co.in, CIN : U140101GJ2000NPL037236



AnyScanner



Analytical Laboratory
NARMADA CLEAN TECH
(A Subsidiary of GIDC)



Report No : NCT/MIAR/2025/DEC/N-222

Issue Date : 09/12/2025

URL No. : TC1159825000020192F

To :

ENVIRO TECHNOLOGY LIMITED

Plot No: 2413/14, GIDC ESTATE

ANKLESHWAR 393 002.

TEST REPORT

Kindly find here with the Test report.

Sample Description:	Waste Water	Sample Quantity:	750 ml
Sampling Location:	Sample collected from Autosampler	Sample Received Date:	08/12/2025
Sample Received By:	Mr. Upendra Rout	Sampling Plan & Procedure:	N.A.
Packing Details:	Preserved (250ml) and Unpreserved (500ml) sample in Plastic bottle	Analysis Start Date:	08/12/2025
Customer Sample Id	N-10	Analysis Completion Date:	08/12/2025
Sampling Start Date & Time:	07/12/2025 & 13:25	Sampling done By:	NCT Monitoring Team

Sr No.	Parameter	Unit	Results	Method Ref.
1	pH at Room Temperature	~	7.26	APHA 24th ed. 4500 H+B
2	Chemical Oxygen Demand	mg/L	704	APHA 24th ed. 5220 B
3	Ammonical Nitrogen	mg/L	BDL	APHA 24th ed. 4500 NH3C
4	Total Dissolved Solids Dried at 180°C	mg/L	18516	APHA 24th ed. 2540 C
5	Total Suspended Solids Dried from 103-105°C	mg/L	40	APHA 24th ed. 2540 D

Note: Joint Analysis will be entertained within 15 days from the date of sampling

Abbreviation: BDL – Below Detection Limit

Any addition to , deviations, or exclusions from the method : Not Applicable

Remarks :

Terms and conditions governing the test report issued

1. Sample is drawn by Narmada Clean Tech ; the results are applicable only to the Received samples from Customer.
2. The test report shall not be reproduced in full or part without the written approval of the Analytical Laboratory Narmada Clean Tech.
3. The test report in full or part shall not be used for promotional or publicity purpose without the written consent of Analytical Laboratory Narmada Clean Tech.
4. Waste water samples shall be stored for the period of Fifteen days after the date of issue of Report.

For Narmada Clean Tech

Twinkle Modi

Authorized By

Twinkle Modi
Sr. Executive QCD

----- End of Report -----

Format No. F/OPN/01/01 Issue no. 01 Issue date 01/04/2022 Rev no. 01 Rev date : 02/04/2024 Page 1 Of 1

Surti Bhagor, Nr. Gujarat Gas Office, Umarwada Road, Ankleshwar-393 001, Dist. Bharuch (Gujarat)
Tele : 8469745285, Email : info@nctc.co.in; website : www.nctc.co.in, CIN : U140101GJ2000NPL037236



AnyScanner



Analytical Laboratory
NARMADA CLEAN TECH
(A Subsidiary of GIDC)



Report No : NCT/MIAR/2025/DEC/N-333

Issue Date : 12/12/2025

URL No. : TC1159825000020304F

To :

ENVIRO TECHNOLOGY LIMITED

Plot No: 2413/14, GIDC ESTATE

ANKLESHWAR 393 002.

TEST REPORT

Kindly find here with the Test report.

Sample Description:	Waste Water	Sample Quantity:	750 ml
Sampling Location:	Free flow sample from Final Discharge Point	Sample Received Date:	11/12/2025
Sample Received By:	Mr. Upendra Rout	Sampling Plan & Procedure:	N.A.
Packing Details:	Preserved (250ml) and Unpreserved (500ml) sample in Plastic bottle	Analysis Start Date:	11/12/2025
Customer Sample Id	N-15	Analysis Completion Date:	11/12/2025
Sampling Start Date & Time:	11/12/2025 & 3:08	Sampling done By:	NCT Monitoring Team

Sr No.	Parameter	Unit	Results	Method Ref.
1	pH at Room Temperature	~	7.09	APHA 24th ed. 4500 H+B
2	Chemical Oxygen Demand	mg/L	792	APHA 24th ed. 5220 B
3	Ammonical Nitrogen	mg/L	BDL	APHA 24th ed. 4500 NH3C
4	Total Dissolved Solids Dried at 180°C	mg/L	18936	APHA 24th ed. 2540 C
5	Total Suspended Solids Dried from 103-105°C	mg/L	42	APHA 24th ed. 2540 D

Note: Joint Analysis will be entertained within 15 days from the date of sampling

Abbreviation: BDL – Below Detection Limit

Any addition to , deviations, or exclusions from the method : Not Applicable

Remarks :

Terms and conditions governing the test report issued

1. Sample is drawn by Narmada Clean Tech ; the results are applicable only to the Received samples from Customer.
2. The test report shall not be reproduced in full or part without the written approval of the Analytical Laboratory Narmada Clean Tech.
3. The test report in full or part shall not be used for promotional or publicity purpose without the written consent of Analytical Laboratory Narmada Clean Tech.
4. Waste water samples shall be stored for the period of Fifteen days after the date of issue of Report.

For Narmada Clean Tech

Authorized By

Twinkle Modi
Sr. Executive QCD

----- End of Report -----

Format No. F/OPN/01/01 Issue no. 01 Issue date 01/04/2022 Rev no. 01 Rev date : 02/04/2024 Page 1 Of 1

Surti Bhagor, Nr. Gujarat Gas Office, Umarwada Road, Ankleshwar-393 001, Dist. Bharuch (Gujarat)
Tele : 8469745285, Email : info@nctc.co.in; website : www.nctc.co.in, CIN : U140101GJ2000NPL037236



AnyScanner



Analytical Laboratory
NARMADA CLEAN TECH
(A Subsidiary of GIDC)



Report No : NCT/MIAR/2025/DEC/N-333

Issue Date : 12/12/2025

URL No. : TC1159825000020304F

To :

ENVIRO TECHNOLOGY LIMITED

Plot No: 2413/14, GIDC ESTATE

ANKLESHWAR 393 002.

TEST REPORT

Kindly find here with the Test report.

Sample Description:	Waste Water	Sample Quantity:	750 ml
Sampling Location:	Free flow sample from Final Discharge Point	Sample Received Date:	11/12/2025
Sample Received By:	Mr. Upendra Rout	Sampling Plan & Procedure:	N.A.
Packing Details:	Preserved (250ml) and Unpreserved (500ml) sample in Plastic bottle	Analysis Start Date:	11/12/2025
Customer Sample Id	N-15	Analysis Completion Date:	11/12/2025
Sampling Start Date & Time:	11/12/2025 & 3:08	Sampling done By:	NCT Monitoring Team

Sr No.	Parameter	Unit	Results	Method Ref.
1	pH at Room Temperature	~	7.09	APHA 24th ed. 4500 H+B
2	Chemical Oxygen Demand	mg/L	792	APHA 24th ed. 5220 B
3	Ammonical Nitrogen	mg/L	BDL	APHA 24th ed. 4500 NH3C
4	Total Dissolved Solids Dried at 180°C	mg/L	18936	APHA 24th ed. 2540 C
5	Total Suspended Solids Dried from 103-105°C	mg/L	42	APHA 24th ed. 2540 D

Note: Joint Analysis will be entertained within 15 days from the date of sampling

Abbreviation: BDL – Below Detection Limit

Any addition to , deviations, or exclusions from the method : Not Applicable

Remarks :

Terms and conditions governing the test report issued

1. Sample is drawn by Narmada Clean Tech ; the results are applicable only to the Received samples from Customer.
2. The test report shall not be reproduced in full or part without the written approval of the Analytical Laboratory Narmada Clean Tech.
3. The test report in full or part shall not be used for promotional or publicity purpose without the written consent of Analytical Laboratory Narmada Clean Tech.
4. Waste water samples shall be stored for the period of Fifteen days after the date of issue of Report.

For Narmada Clean Tech

Authorized By

Twinkle Modi
Sr. Executive QCD

----- End of Report -----

Format No. F/OPN/01/01 Issue no. 01 Issue date 01/04/2022 Rev no. 01 Rev date : 02/04/2024 Page 1 Of 1

Surti Bhagor, Nr. Gujarat Gas Office, Umarwada Road, Ankleshwar-393 001, Dist. Bharuch (Gujarat)
Tele : 8469745285, Email : info@nctc.co.in; website : www.nctc.co.in, CIN : U140101GJ2000NPL037236



AnyScanner



Analytical Laboratory
NARMADA CLEAN TECH
(A Subsidiary of GIDC)



Report No : NCT/MIAR/2025/DEC/N-469

Issue Date : 16/12/2025

URL No. : TC1159825000020467F

To :

ENVIRO TECHNOLOGY LIMITED

Plot No: 2413/14, GIDC ESTATE

ANKLESHWAR 393 002.

TEST REPORT

Kindly find here with the Test report.

Sample Description:	Waste Water	Sample Quantity:	750 ml
Sampling Location:	Free flow sample from Final Discharge Point	Sample Received Date:	15/12/2025
Sample Received By:	Mr. Upendra Rout	Sampling Plan & Procedure:	N.A.
Packing Details:	Preserved (250ml) and Unpreserved (500ml) sample in Plastic bottle	Analysis Start Date:	15/12/2025
Customer Sample Id	N-15	Analysis Completion Date:	15/12/2025
Sampling Start Date & Time:	15/12/2025 & 0:30	Sampling done By:	NCT Monitoring Team

Sr No.	Parameter	Unit	Results	Method Ref.
1	pH at Room Temperature	~	7.14	APHA 24th ed. 4500 H+B
2	Chemical Oxygen Demand	mg/L	752	APHA 24th ed. 5220 B
3	Ammonical Nitrogen	mg/L	7	APHA 24th ed. 4500 NH3C
4	Total Dissolved Solids Dried at 180°C	mg/L	19122	APHA 24th ed. 2540 C
5	Total Suspended Solids Dried from 103-105°C	mg/L	28	APHA 24th ed. 2540 D

Note: Joint Analysis will be entertained within 15 days from the date of sampling

Abbreviation: BDL – Below Detection Limit

Any addition to , deviations, or exclusions from the method : Not Applicable

Remarks :

Terms and conditions governing the test report issued

1. Sample is drawn by Narmada Clean Tech ; the results are applicable only to the Received samples from Customer.
2. The test report shall not be reproduced in full or part without the written approval of the Analytical Laboratory Narmada Clean Tech.
3. The test report in full or part shall not be used for promotional or publicity purpose without the written consent of Analytical Laboratory Narmada Clean Tech.
4. Waste water samples shall be stored for the period of Fifteen days after the date of issue of Report.

For Narmada Clean Tech

Twinkle Modi

Authorized By

Twinkle Modi
Sr. Executive QCD

----- End of Report -----

Format No. F/OPN/01/01 Issue no. 01 Issue date 01/04/2022 Rev no. 01 Rev date : 02/04/2024 Page 1 Of 1

Surti Bhagor, Nr. Gujarat Gas Office, Umarwada Road, Ankleshwar-393 001, Dist. Bharuch (Gujarat)
Tele : 8469745285, Email : info@nctc.co.in; website : www.nctc.co.in, CIN : U140101GJ2000NPL037236



AnyScanner



Analytical Laboratory
NARMADA CLEAN TECH
(A Subsidiary of GIDC)



Report No : NCT/MIAR/2025/DEC/N-502

Issue Date : 17/12/2025

URL No. : TC1159825000020500F

To :

ENVIRO TECHNOLOGY LIMITED

Plot No: 2413/14, GIDC ESTATE

ANKLESHWAR 393 002.

TEST REPORT

Kindly find here with the Test report.

Sample Description:	Waste Water	Sample Quantity:	750 ml
Sampling Location:	Free flow sample from Final Discharge Point	Sample Received Date:	16/12/2025
Sample Received By:	Mr. Upendra Rout	Sampling Plan & Procedure:	N.A.
Packing Details:	Preserved (250ml) and Unpreserved (500ml) sample in Plastic bottle	Analysis Start Date:	16/12/2025
Customer Sample Id	N-11	Analysis Completion Date:	16/12/2025
Sampling Start Date & Time:	16/12/2025 & 1:32	Sampling done By:	NCT Monitoring Team

Sr No.	Parameter	Unit	Results	Method Ref.
1	pH at Room Temperature	~	7.15	APHA 24th ed. 4500 H+B
2	Chemical Oxygen Demand	mg/L	832	APHA 24th ed. 5220 B
3	Ammonical Nitrogen	mg/L	6	APHA 24th ed. 4500 NH3C
4	Total Dissolved Solids Dried at 180°C	mg/L	17932	APHA 24th ed. 2540 C
5	Total Suspended Solids Dried from 103-105°C	mg/L	36	APHA 24th ed. 2540 D

Note: Joint Analysis will be entertained within 15 days from the date of sampling

Abbreviation: BDL – Below Detection Limit

Any addition to , deviations, or exclusions from the method : Not Applicable

Remarks :

Terms and conditions governing the test report issued

1. Sample is drawn by Narmada Clean Tech ; the results are applicable only to the Received samples from Customer.
2. The test report shall not be reproduced in full or part without the written approval of the Analytical Laboratory Narmada Clean Tech.
3. The test report in full or part shall not be used for promotional or publicity purpose without the written consent of Analytical Laboratory Narmada Clean Tech.
4. Waste water samples shall be stored for the period of Fifteen days after the date of issue of Report.

For Narmada Clean Tech

Twinkle Modi

Authorized By

Twinkle Modi
Sr. Executive QCD

End of Report

Format No. F/OPN/01/01 Issue no. 01 Issue date 01/04/2022 Rev no. 01 Rev date : 02/04/2024 Page 1 Of 1

Surti Bhagor, Nr. Gujarat Gas Office, Umarwada Road, Ankleshwar-393 001, Dist. Bharuch (Gujarat)
Tele : 8469745285, Email : info@nctc.co.in; website : www.nctc.co.in, CIN : U140101GJ2000NPL037236



AnyScanner



Analytical Laboratory
NARMADA CLEAN TECH
(A Subsidiary of GIDC)



Report No : NCT/MIAR/2025/DEC/N-678

Issue Date : 22/12/2025

URL No. : TC1159825000020680F

To :

ENVIRO TECHNOLOGY LIMITED

Plot No: 2413/14, GIDC ESTATE

ANKLESHWAR 393 002.

TEST REPORT

Kindly find here with the Test report.

Sample Description:	Waste Water	Sample Quantity:	750 ml
Sampling Location:	Free flow sample from Final Discharge Point	Sample Received Date:	21/12/2025
Sample Received By:	Mr. Upendra Rout	Sampling Plan & Procedure:	N.A.
Packing Details:	Preserved (250ml) and Unpreserved (500ml) sample in Plastic bottle	Analysis Start Date:	21/12/2025
Customer Sample Id	N-17	Analysis Completion Date:	21/12/2025
Sampling Start Date & Time:	21/12/2025 & 2:20	Sampling done By:	NCT Monitoring Team

Sr No.	Parameter	Unit	Results	Method Ref.
1	pH at Room Temperature	~	7.54	APHA 24th ed. 4500 H+B
2	Chemical Oxygen Demand	mg/L	832	APHA 24th ed. 5220 B
3	Ammonical Nitrogen	mg/L	BDL	APHA 24th ed. 4500 NH3C
4	Total Dissolved Solids Dried at 180°C	mg/L	20222	APHA 24th ed. 2540 C
5	Total Suspended Solids Dried from 103-105°C	mg/L	57	APHA 24th ed. 2540 D

Note: Joint Analysis will be entertained within 15 days from the date of sampling

Abbreviation: BDL – Below Detection Limit

Any addition to , deviations, or exclusions from the method : Not Applicable

Remarks :

Terms and conditions governing the test report issued

1. Sample is drawn by Narmada Clean Tech ; the results are applicable only to the Received samples from Customer.
2. The test report shall not be reproduced in full or part without the written approval of the Analytical Laboratory Narmada Clean Tech.
3. The test report in full or part shall not be used for promotional or publicity purpose without the written consent of Analytical Laboratory Narmada Clean Tech.
4. Waste water samples shall be stored for the period of Fifteen days after the date of issue of Report.

For Narmada Clean Tech

Twinkle Modi

Authorized By

Twinkle Modi
Sr. Executive QCD

----- End of Report -----

Format No. F/OPN/01/01 Issue no. 01 Issue date 01/04/2022 Rev no. 01 Rev date : 02/04/2024 Page 1 Of 1

Surti Bhagor, Nr. Gujarat Gas Office, Umarwada Road, Ankleshwar-393 001, Dist. Bharuch (Gujarat)
Tele : 8469745285, Email : info@nctc.co.in; website : www.nctc.co.in, CIN : U140101GJ2000NPL037236



AnyScanner



Analytical Laboratory
NARMADA CLEAN TECH
(A Subsidiary of GIDC)



Report No : NCT/MIAR/2025/DEC/N-896

Issue Date : 29/12/2025

URL No. : TC1159825000020940F

To :

ENVIRO TECHNOLOGY LIMITED

Plot No: 2413/14, GIDC ESTATE

ANKLESHWAR 393 002.

TEST REPORT

Kindly find here with the Test report.

Sample Description:	Waste Water	Sample Quantity:	750 ml
Sampling Location:	Sample collected from Autosampler	Sample Received Date:	28/12/2025
Sample Received By:	Mr. Upendra Rout	Sampling Plan & Procedure:	N.A.
Packing Details:	Preserved (250ml) and Unpreserved (500ml) sample in Plastic bottle	Analysis Start Date:	28/12/2025
Customer Sample Id	N-07	Analysis Completion Date:	28/12/2025
Sampling Start Date & Time:	27/12/2025 & 16:18	Sampling done By:	NCT Monitoring Team

Sr No.	Parameter	Unit	Results	Method Ref.
1	pH at Room Temperature	~	7.12	APHA 24th ed. 4500 H+B
2	Chemical Oxygen Demand	mg/L	800	APHA 24th ed. 5220 B
3	Ammonical Nitrogen	mg/L	BDL	APHA 24th ed. 4500 NH3C
4	Total Dissolved Solids Dried at 180°C	mg/L	19632	APHA 24th ed. 2540 C
5	Total Suspended Solids Dried from 103-105°C	mg/L	32	APHA 24th ed. 2540 D

Note: Joint Analysis will be entertained within 15 days from the date of sampling

Abbreviation: BDL – Below Detection Limit

Any addition to , deviations, or exclusions from the method : Not Applicable

Remarks :

Terms and conditions governing the test report issued

1. Sample is drawn by Narmada Clean Tech ; the results are applicable only to the Received samples from Customer.
2. The test report shall not be reproduced in full or part without the written approval of the Analytical Laboratory Narmada Clean Tech.
3. The test report in full or part shall not be used for promotional or publicity purpose without the written consent of Analytical Laboratory Narmada Clean Tech.
4. Waste water samples shall be stored for the period of Fifteen days after the date of issue of Report.

For Narmada Clean Tech

Twinkle Modi

Authorized By

Twinkle Modi
Sr. Executive QCD

----- End of Report -----

Format No. F/OPN/01/01 Issue no. 01 Issue date 01/04/2022 Rev no. 01 Rev date : 02/04/2024 Page 1 Of 1

Surti Bhagor, Nr. Gujarat Gas Office, Umarwada Road, Ankleshwar-393 001, Dist. Bharuch (Gujarat)
Tele : 8469745285, Email : info@nctc.co.in; website : www.nctc.co.in, CIN : U140101GJ2000NPL037236



AnyScanner



Analytical Laboratory
NARMADA CLEAN TECH
(A Subsidiary of GIDC)



Report No : NCT/MIAR/2025/DEC/N-971

Issue Date : 31/12/2025

URL No. : TC1159825000021019F

To :

ENVIRO TECHNOLOGY LIMITED

Plot No: 2413/14, GIDC ESTATE

ANKLESHWAR 393 002.

TEST REPORT

Kindly find here with the Test report.

Sample Description:	Waste Water	Sample Quantity:	750 ml
Sampling Location:	Free flow sample from Final Discharge Point	Sample Received Date:	30/12/2025
Sample Received By:	Mr. Upendra Rout	Sampling Plan & Procedure:	N.A.
Packing Details:	Preserved (250ml) and Unpreserved (500ml) sample in Plastic bottle	Analysis Start Date:	30/12/2025
Customer Sample Id	N-16	Analysis Completion Date:	30/12/2025
Sampling Start Date & Time:	30/12/2025 & 1:54	Sampling done By:	NCT Monitoring Team

Sr No.	Parameter	Unit	Results	Method Ref.
1	pH at Room Temperature	~	7.54	APHA 24th ed. 4500 H+B
2	Chemical Oxygen Demand	mg/L	832	APHA 24th ed. 5220 B
3	Ammonical Nitrogen	mg/L	BDL	APHA 24th ed. 4500 NH3C
4	Total Dissolved Solids Dried at 180°C	mg/L	19330	APHA 24th ed. 2540 C
5	Total Suspended Solids Dried from 103-105°C	mg/L	45	APHA 24th ed. 2540 D

Note: Joint Analysis will be entertained within 15 days from the date of sampling

Abbreviation: BDL – Below Detection Limit

Any addition to , deviations, or exclusions from the method : Not Applicable

Remarks :

Terms and conditions governing the test report issued

1. Sample is drawn by Narmada Clean Tech ; the results are applicable only to the Received samples from Customer.
2. The test report shall not be reproduced in full or part without the written approval of the Analytical Laboratory Narmada Clean Tech.
3. The test report in full or part shall not be used for promotional or publicity purpose without the written consent of Analytical Laboratory Narmada Clean Tech.
4. Waste water samples shall be stored for the period of Fifteen days after the date of issue of Report.

For Narmada Clean Tech

Twinkle Modi

Authorized By

Twinkle Modi
Sr. Executive QCD

----- End of Report -----

Format No. F/OPN/01/01 Issue no. 01 Issue date 01/04/2022 Rev no. 01 Rev date : 02/04/2024 Page 1 Of 1

Surti Bhagor, Nr. Gujarat Gas Office, Umarwada Road, Ankleshwar-393 001, Dist. Bharuch (Gujarat)
Tele : 8469745285, Email : info@nctc.co.in; website : www.nctc.co.in, CIN : U140101GJ2000NPL037236



AnyScanner



Analytical Laboratory
NARMADA CLEAN TECH
(A Subsidiary of GIDC)



Report No : NCT/MIAR/2026/JAN/N-2

URL No. : TC1159826000021111F

To :

ENVIRO TECHNOLOGY LIMITED

Plot No: 2413/14, GIDC ESTATE

ANKLESHWAR 393 002.

Issue Date : 03/01/2026

TEST REPORT

Kindly find here with the Test report.

Sample Description:	Waste Water	Sample Quantity:	750 ml
Sampling Location:	Free flow sample from Final Discharge Point	Sample Received Date:	02/01/2026
Sample Received By:	Mr. Upendra Rout	Sampling Plan & Procedure:	N.A.
Packing Details:	Preserved (250ml) and Unpreserved (500ml) sample in Plastic bottle	Analysis Start Date:	02/01/2026
Customer Sample Id	N-2	Analysis Completion Date:	02/01/2026
Sampling Start Date & Time:	02/01/2026 & 1:54	Sampling done By:	NCT Monitoring Team

Sr No.	Parameter	Unit	Results	Method Ref.
1	pH at Room Temperature	~	7.51	APHA 24th ed. 4500 H+B
2	Chemical Oxygen Demand	mg/L	851	APHA 24th ed. 5220 B
3	Ammonical Nitrogen	mg/L	BDL	APHA 24th ed. 4500 NH3C
4	Total Dissolved Solids Dried at 180°C	mg/L	18400	APHA 24th ed. 2540 C
5	Total Suspended Solids Dried from 103-105°C	mg/L	31	APHA 24th ed. 2540 D

Note: Joint Analysis will be entertained within 15 days from the date of sampling

Abbreviation: BDL – Below Detection Limit

Any addition to , deviations, or exclusions from the method : Not Applicable

Remarks :

Terms and conditions governing the test report issued

1. Sample is drawn by Narmada Clean Tech ; the results are applicable only to the Received samples from Customer.
2. The test report shall not be reproduced in full or part without the written approval of the Analytical Laboratory Narmada Clean Tech.
3. The test report in full or part shall not be used for promotional or publicity purpose without the written consent of Analytical Laboratory Narmada Clean Tech.
4. Waste water samples shall be stored for the period of Fifteen days after the date of issue of Report.

For Narmada Clean Tech

Authorized By

Twinkle Modi
Sr. Executive QCD

End of Report

Format No. F/OPN/01/01 Issue no. 01 Issue date 01/04/2022 Rev no. 01 Rev date : 02/04/2024 Page 1 Of 1

Surti Bhagor, Nr. Gujarat Gas Office, Umarwada Road, Ankleshwar-393 001, Dist. Bharuch (Gujarat)
Tele : 8469745285, Email : info@nctc.co.in; website : www.nctc.co.in, CIN : U140101GJ2000NPL037236



AnyScanner



Analytical Laboratory
NARMADA CLEAN TECH
(A Subsidiary of GIDC)



Report No : NCT/MIAR/2026/JAN/N-116

Issue Date : 06/01/2026

URL No. : TC1159826000021227F

To :

ENVIRO TECHNOLOGY LIMITED

Plot No. 2413/14, GIDC ESTATE

ANKLESHWAR 393 002.

TEST REPORT

Kindly find here with the Test report.

Sample Description:	Waste Water	Sample Quantity:	750 ml
Sampling Location:	Free flow sample from Final Discharge Point	Sample Received Date:	05/01/2026
Sample Received By:	Mr. Upendra Rout	Sampling Plan & Procedure:	N.A.
Packing Details:	Preserved (250ml) and Unpreserved (500ml) sample in Plastic bottle	Analysis Start Date:	05/01/2026
Customer Sample Id	N-13	Analysis Completion Date:	05/01/2026
Sampling Start Date & Time:	04/01/2026 & 23:18	Sampling done By:	NCT Monitoring Team

Sr No.	Parameter	Unit	Results	Method Ref.
1	pH at Room Temperature	~	7.3	APHA 24th ed. 4500 H+B
2	Chemical Oxygen Demand	mg/L	832	APHA 24th ed. 5220 B
3	Ammonical Nitrogen	mg/L	BDL	APHA 24th ed. 4500 NH3C
4	Total Dissolved Solids Dried at 180°C	mg/L	19016	APHA 24th ed. 2540 C
5	Total Suspended Solids Dried from 103-105°C	mg/L	54	APHA 24th ed. 2540 D

Note: Joint Analysis will be entertained within 15 days from the date of sampling

Abbreviation: BDL – Below Detection Limit

Any addition to , deviations, or exclusions from the method : Not Applicable

Remarks :

Terms and conditions governing the test report issued

1. Sample is drawn by Narmada Clean Tech ; the results are applicable only to the Received samples from Customer.
2. The test report shall not be reproduced in full or part without the written approval of the Analytical Laboratory Narmada Clean Tech.
3. The test report in full or part shall not be used for promotional or publicity purpose without the written consent of Analytical Laboratory Narmada Clean Tech.
4. Waste water samples shall be stored for the period of Fifteen days after the date of issue of Report.

For Narmada Clean Tech

Twinkle Modi

Authorized By

Twinkle Modi
Sr. Executive QCD

----- End of Report -----

Format No. F/OPN/01/01 Issue no. 01 Issue date 01/04/2022 Rev no. 01 Rev date : 02/04/2024 Page 1 Of 1

Surti Bhagor, Nr. Gujarat Gas Office, Umarwada Road, Ankleshwar-393 001, Dist. Bharuch (Gujarat)
Tele : 8469745285, Email : info@nctc.co.in; website : www.nctc.co.in, CIN : U140101GJ2000NPL037236



AnyScanner



Analytical Laboratory
NARMADA CLEAN TECH
(A Subsidiary of GIDC)



Report No : NCT/MIAR/2026/JAN/N-329

Issue Date : 12/01/2026

URL No. : TC1159826000021442F

To :

ENVIRO TECHNOLOGY LIMITED

Plot No: 2413/14, GIDC ESTATE

ANKLESHWAR 393 002.

TEST REPORT

Kindly find here with the Test report.

Sample Description:	Waste Water	Sample Quantity:	750 ml
Sampling Location:	Free flow sample from Final Discharge Point	Sample Received Date:	11/01/2026
Sample Received By:	Mr. Upendra Rout	Sampling Plan & Procedure:	N.A.
Packing Details:	Preserved (250ml) and Unpreserved (500ml) sample in Plastic bottle	Analysis Start Date:	11/01/2026
Customer Sample Id	N-15	Analysis Completion Date:	11/01/2026
Sampling Start Date & Time:	11/01/2026 & 2:10	Sampling done By:	NCT Monitoring Team

Sr No.	Parameter	Unit	Results	Method Ref.
1	pH at Room Temperature	~	7.26	APHA 24th ed. 4500 H+B
2	Chemical Oxygen Demand	mg/L	800	APHA 24th ed. 5220 B
3	Ammonical Nitrogen	mg/L	BDL	APHA 24th ed. 4500 NH3C
4	Total Dissolved Solids Dried at 180°C	mg/L	20344	APHA 24th ed. 2540 C
5	Total Suspended Solids Dried from 103-105°C	mg/L	31	APHA 24th ed. 2540 D

Note: Joint Analysis will be entertained within 15 days from the date of sampling

Abbreviation: BDL – Below Detection Limit

Any addition to , deviations, or exclusions from the method : Not Applicable

Remarks :

Terms and conditions governing the test report issued

1. Sample is drawn by Narmada Clean Tech ; the results are applicable only to the Received samples from Customer.
2. The test report shall not be reproduced in full or part without the written approval of the Analytical Laboratory Narmada Clean Tech.
3. The test report in full or part shall not be used for promotional or publicity purpose without the written consent of Analytical Laboratory Narmada Clean Tech.
4. Waste water samples shall be stored for the period of Fifteen days after the date of issue of Report.

For Narmada Clean Tech

Authorized By

Twinkle Modi
Sr. Executive QCD

End of Report

Format No. F/OPN/01/01 Issue no. 01 Issue date 01/04/2022 Rev no. 01 Rev date : 02/04/2024 Page 1 Of 1

Surti Bhagor, Nr. Gujarat Gas Office, Umarwada Road, Ankleshwar-393 001, Dist. Bharuch (Gujarat)
Tele : 8469745285, Email : info@nctc.co.in; website : www.nctc.co.in, CIN : U140101GJ2000NPL037236



AnyScanner



Analytical Laboratory
NARMADA CLEAN TECH
(A Subsidiary of GIDC)



Report No : NCT/MIAR/2026/JAN/N-394

Issue Date : 15/01/2026

URL No. : TC1159826000021514F

To :

ENVIRO TECHNOLOGY LIMITED

Plot No. 2413/14, GIDC ESTATE

ANKLESHWAR 393 002

TEST REPORT

Kindly find here with the Test report.

Sample Description:	Waste Water	Sample Quantity:	750 ml
Sampling Location:	Free flow sample from Final Discharge Point	Sample Received Date:	14/01/2026
Sample Received By:	Mr. Upendra Rout	Sampling Plan & Procedure:	N.A.
Packing Details:	Preserved (250ml) and Unpreserved (500ml) sample in Plastic bottle	Analysis Start Date:	14/01/2026
Customer Sample Id	N-1	Analysis Completion Date:	14/01/2026
Sampling Start Date & Time:	13/01/2026 & 18:56	Sampling done By:	NCT Monitoring Team

Sr No.	Parameter	Unit	Results	Method Ref.
1	pH at Room Temperature	~	7.32	APHA 24th ed. 4500 H+B
2	Chemical Oxygen Demand	mg/L	800	APHA 24th ed. 5220 B
3	Ammonical Nitrogen	mg/L	BDL	APHA 24th ed. 4500 NH3C
4	Total Dissolved Solids Dried at 180°C	mg/L	21692	APHA 24th ed. 2540 C
5	Total Suspended Solids Dried from 103-105°C	mg/L	39	APHA 24th ed. 2540 D

Note: Joint Analysis will be entertained within 15 days from the date of sampling

Abbreviation: BDL – Below Detection Limit

Any addition to , deviations, or exclusions from the method : Not Applicable

Remarks :

Terms and conditions governing the test report issued

1. Sample is drawn by Narmada Clean Tech ; the results are applicable only to the Received samples from Customer.
2. The test report shall not be reproduced in full or part without the written approval of the Analytical Laboratory Narmada Clean Tech.
3. The test report in full or part shall not be used for promotional or publicity purpose without the written consent of Analytical Laboratory Narmada Clean Tech.
4. Waste water samples shall be stored for the period of Fifteen days after the date of issue of Report.

For Narmada Clean Tech

Twinkle Modi

Authorized By

Twinkle Modi
Sr. Executive QCD

----- End of Report -----

Format No. F/OPN/01/01 Issue no. 01 Issue date 01/04/2022 Rev no. 01 Rev date : 02/04/2024 Page 1 Of 1

Surti Bhagor, Nr. Gujarat Gas Office, Umarwada Road, Ankleshwar-393 001, Dist. Bharuch (Gujarat)
Tele : 8469745285, Email : info@nctc.co.in; website : www.nctc.co.in, CIN : U140101GJ2000NPL037236



AnyScanner



Analytical Laboratory
NARMADA CLEAN TECH
(A Subsidiary of GIDC)



Report No : NCT/MIAR/2026/JAN/N-456

Issue Date : 17/01/2026

URL No. : TC1159826000021576F

To :

ENVIRO TECHNOLOGY LIMITED

Plot No: 2413/14, GIDC ESTATE

ANKLESHWAR 393 002.

TEST REPORT

Kindly find here with the Test report.

Sample Description:	Waste Water	Sample Quantity:	750 ml
Sampling Location:	Free flow sample from Final Discharge Point	Sample Received Date:	16/01/2026
Sample Received By:	Mr. Upendra Rout	Sampling Plan & Procedure:	N.A.
Packing Details:	Preserved (250ml) and Unpreserved (500ml) sample in Plastic bottle	Analysis Start Date:	16/01/2026
Customer Sample Id	N-12	Analysis Completion Date:	16/01/2026
Sampling Start Date & Time:	15/01/2026 & 19:46	Sampling done By:	NCT Monitoring Team

Sr No.	Parameter	Unit	Results	Method Ref.
1	pH at Room Temperature	~	7.4	APHA 24th ed. 4500 H+B
2	Chemical Oxygen Demand	mg/L	816	APHA 24th ed. 5220 B
3	Ammonical Nitrogen	mg/L	BDL	APHA 24th ed. 4500 NH3C
4	Total Dissolved Solids Dried at 180°C	mg/L	22844	APHA 24th ed. 2540 C
5	Total Suspended Solids Dried from 103-105°C	mg/L	28	APHA 24th ed. 2540 D

Note: Joint Analysis will be entertained within 15 days from the date of sampling

Abbreviation: BDL – Below Detection Limit

Any addition to , deviations, or exclusions from the method : Not Applicable

Remarks :

Terms and conditions governing the test report issued

1. Sample is drawn by Narmada Clean Tech ; the results are applicable only to the Received samples from Customer.
2. The test report shall not be reproduced in full or part without the written approval of the Analytical Laboratory Narmada Clean Tech.
3. The test report in full or part shall not be used for promotional or publicity purpose without the written consent of Analytical Laboratory Narmada Clean Tech.
4. Waste water samples shall be stored for the period of Fifteen days after the date of issue of Report.

For Narmada Clean Tech

Twinkle Modi

Authorized By

Twinkle Modi
Sr. Executive QCD

----- End of Report -----

Format No. F/OPN/01/01 Issue no. 01 Issue date 01/04/2022 Rev no. 01 Rev date : 02/04/2024 Page 1 Of 1

Surti Bhagor, Nr. Gujarat Gas Office, Umarwada Road, Ankleshwar-393 001, Dist. Bharuch (Gujarat)
Tele : 8469745285, Email : info@nctc.co.in; website : www.nctc.co.in, CIN : U140101GJ2000NPL037236



AnyScanner



Analytical Laboratory
NARMADA CLEAN TECH
(A Subsidiary of GIDC)



Report No : NCT/MIAR/2026/JAN/N-524

Issue Date : 19/01/2026

URL No. : TC1159826000021644F

To :

ENVIRO TECHNOLOGY LIMITED

Plot No: 2413/14, GIDC ESTATE

ANKLESHWAR 393 002.

TEST REPORT

Kindly find here with the Test report.

Sample Description:	Waste Water	Sample Quantity:	750 ml
Sampling Location:	Free flow sample from Final Discharge Point	Sample Received Date:	18/01/2026
Sample Received By:	Mr. Upendra Rout	Sampling Plan & Procedure:	N.A.
Packing Details:	Preserved (250ml) and Unpreserved (500ml) sample in Plastic bottle	Analysis Start Date:	18/01/2026
Customer Sample Id	N-15	Analysis Completion Date:	18/01/2026
Sampling Start Date & Time:	18/01/2026 & 1:30	Sampling done By:	NCT Monitoring Team

Sr No.	Parameter	Unit	Results	Method Ref.
1	pH at Room Temperature	~	7.41	APHA 24th ed. 4500 H+B
2	Chemical Oxygen Demand	mg/L	800	APHA 24th ed. 5220 B
3	Ammonical Nitrogen	mg/L	BDL	APHA 24th ed. 4500 NH3C
4	Total Dissolved Solids Dried at 180°C	mg/L	21932	APHA 24th ed. 2540 C
5	Total Suspended Solids Dried from 103-105°C	mg/L	34	APHA 24th ed. 2540 D

Note: Joint Analysis will be entertained within 15 days from the date of sampling

Abbreviation: BDL – Below Detection Limit

Any addition to , deviations, or exclusions from the method : Not Applicable

Remarks :

Terms and conditions governing the test report issued

1. Sample is drawn by Narmada Clean Tech ; the results are applicable only to the Received samples from Customer.
2. The test report shall not be reproduced in full or part without the written approval of the Analytical Laboratory Narmada Clean Tech.
3. The test report in full or part shall not be used for promotional or publicity purpose without the written consent of Analytical Laboratory Narmada Clean Tech.
4. Waste water samples shall be stored for the period of Fifteen days after the date of issue of Report.

For Narmada Clean Tech

Twinkle Modi

Authorized By

Twinkle Modi
Sr. Executive QCD

----- End of Report -----

Format No. F/OPN/01/01 Issue no. 01 Issue date 01/04/2022 Rev no. 01 Rev date : 02/04/2024 Page 1 Of 1

Surti Bhagor, Nr. Gujarat Gas Office, Umarwada Road, Ankleshwar-393 001, Dist. Bharuch (Gujarat)
Tele : 8469745285, Email : info@nctc.co.in; website : www.nctc.co.in, CIN : U140101GJ2000NPL037236



AnyScanner



Analytical Laboratory
NARMADA CLEAN TECH
(A Subsidiary of GIDC)



Report No : NCT/MIAR/2026/JAN/N-824

URL No. : TC1159826000021954F

To :

ENVIRO TECHNOLOGY LIMITED

Plot No: 2413/14, GIDC ESTATE

ANKLESHWAR 393 002.

Issue Date : 28/01/2026

TEST REPORT

Kindly find here with the Test report.

Sample Description:	Waste Water	Sample Quantity:	750 ml
Sampling Location:	Free flow sample from Final Discharge Point	Sample Received Date:	27/01/2026
Sample Received By:	Mr. Upendra Rout	Sampling Plan & Procedure:	N.A.
Packing Details:	Preserved (250ml) and Unpreserved (500ml) sample in Plastic bottle	Analysis Start Date:	27/01/2026
Customer Sample Id	N-13	Analysis Completion Date:	27/01/2026
Sampling Start Date & Time:	27/01/2026 & 2:03	Sampling done By:	NCT Monitoring Team

Sr No.	Parameter	Unit	Results	Method Ref.
1	pH at Room Temperature	~	7.77	APHA 24th ed. 4500 H+B
2	Chemical Oxygen Demand	mg/L	800	APHA 24th ed. 5220 B
3	Ammonical Nitrogen	mg/L	BDL	APHA 24th ed. 4500 NH3C
4	Total Dissolved Solids Dried at 180°C	mg/L	20990	APHA 24th ed. 2540 C
5	Total Suspended Solids Dried from 103-105°C	mg/L	34	APHA 24th ed. 2540 D

Note: Joint Analysis will be entertained within 15 days from the date of sampling

Abbreviation: BDL – Below Detection Limit

Any addition to , deviations, or exclusions from the method : Not Applicable

Remarks :

Terms and conditions governing the test report issued

1. Sample is drawn by Narmada Clean Tech ; the results are applicable only to the Received samples from Customer.
2. The test report shall not be reproduced in full or part without the written approval of the Analytical Laboratory Narmada Clean Tech.
3. The test report in full or part shall not be used for promotional or publicity purpose without the written consent of Analytical Laboratory Narmada Clean Tech.
4. Waste water samples shall be stored for the period of Fifteen days after the date of issue of Report.

For Narmada Clean Tech

Twinkle Modi

Authorized By

Twinkle Modi
Sr. Executive QCD

End of Report

Format No. F/OPN/01/01 Issue no. 01 Issue date 01/04/2022 Rev no. 01 Rev date : 02/04/2024 Page 1 Of 1

Surti Bhagor, Nr. Gujarat Gas Office, Umarwada Road, Ankleshwar-393 001, Dist. Bharuch (Gujarat)
Tele : 8469745285, Email : info@nctc.co.in; website : www.nctc.co.in, CIN : U140101GJ2000NPL037236



AnyScanner



Analytical Laboratory
NARMADA CLEAN TECH
(A Subsidiary of GIDC)



Report No : NCT/MIAR/2026/JAN/N-972

Issue Date : 02/02/2026

URL No. : TC1159826000022107F

To :

ENVIRO TECHNOLOGY LIMITED

Plot No: 2413/14, GIDC ESTATE

ANKLESHWAR 393 002.

TEST REPORT

Kindly find here with the Test report.

Sample Description:	Waste Water	Sample Quantity:	750 ml
Sampling Location:	Sample collected from Autosampler	Sample Received Date:	01/02/2026
Sample Received By:	Mr. Upendra Rout	Sampling Plan & Procedure:	N.A.
Packing Details:	Preserved (250ml) and Unpreserved (500ml) sample in Plastic bottle	Analysis Start Date:	01/02/2026
Customer Sample Id	N-6	Analysis Completion Date:	01/02/2026
Sampling Start Date & Time:	31/01/2026 & 11:01	Sampling done By:	NCT Monitoring Team

Sr No.	Parameter	Unit	Results	Method Ref.
1	pH at Room Temperature	~	7.27	APHA 24th ed. 4500 H+B
2	Chemical Oxygen Demand	mg/L	864	APHA 24th ed. 5220 B
3	Ammonical Nitrogen	mg/L	BDL	APHA 24th ed. 4500 NH3C
4	Total Dissolved Solids Dried at 180°C	mg/L	21746	APHA 24th ed. 2540 C
5	Total Suspended Solids Dried from 103-105°C	mg/L	58	APHA 24th ed. 2540 D

Note: Joint Analysis will be entertained within 15 days from the date of sampling

Abbreviation: BDL – Below Detection Limit

Any addition to , deviations, or exclusions from the method : Not Applicable

Remarks :

Terms and conditions governing the test report issued

1. Sample is drawn by Narmada Clean Tech ; the results are applicable only to the Received samples from Customer.
2. The test report shall not be reproduced in full or part without the written approval of the Analytical Laboratory Narmada Clean Tech.
3. The test report in full or part shall not be used for promotional or publicity purpose without the written consent of Analytical Laboratory Narmada Clean Tech.
4. Waste water samples shall be stored for the period of Fifteen days after the date of issue of Report.

For Narmada Clean Tech

Twinkle Modi

Authorized By

Twinkle Modi
Sr. Executive QCD

End of Report

Format No. F/OPN/01/01 Issue no. 01 Issue date 01/04/2022 Rev no. 01 Rev date : 02/04/2024 Page 1 Of 2

Surti Bhagor, Nr. Gujarat Gas Office, Umarwada Road, Ankleshwar-393 001, Dist. Bharuch (Gujarat)



AnyScanner



Analytical Laboratory
NARMADA CLEAN TECH
(A Subsidiary of GIDC)



Report No : NCT/MIAR/2026/JAN/N-979

Issue Date : 02/02/2026

URL No. : TC1159826000022114F

To :

ENVIRO TECHNOLOGY LIMITED

Plot No: 2413/14, GIDC ESTATE

ANKLESHWAR 393 002.

TEST REPORT

Kindly find here with the Test report.

Sample Description:	Waste Water	Sample Quantity:	750 ml
Sampling Location:	Free flow sample from Final Discharge Point	Sample Received Date:	01/02/2026
Sample Received By:	Mr. Upendra Rout	Sampling Plan & Procedure:	N.A.
Packing Details:	Preserved (250ml) and Unpreserved (500ml) sample in Plastic bottle	Analysis Start Date:	01/02/2026
Customer Sample Id	N-13	Analysis Completion Date:	01/02/2026
Sampling Start Date & Time:	01/02/2026 & 1:15	Sampling done By:	NCT Monitoring Team

Sr No.	Parameter	Unit	Results	Method Ref.
1	pH at Room Temperature	~	7.45	APHA 24th ed. 4500 H+B
2	Chemical Oxygen Demand	mg/L	832	APHA 24th ed. 5220 B
3	Ammonical Nitrogen	mg/L	BDL	APHA 24th ed. 4500 NH3C
4	Total Dissolved Solids Dried at 180°C	mg/L	22516	APHA 24th ed. 2540 C
5	Total Suspended Solids Dried from 103-105°C	mg/L	39	APHA 24th ed. 2540 D

Note: Joint Analysis will be entertained within 15 days from the date of sampling

Abbreviation: BDL – Below Detection Limit

Any addition to , deviations, or exclusions from the method : Not Applicable

Remarks :

Terms and conditions governing the test report issued

1. Sample is drawn by Narmada Clean Tech ; the results are applicable only to the Received samples from Customer.
2. The test report shall not be reproduced in full or part without the written approval of the Analytical Laboratory Narmada Clean Tech.
3. The test report in full or part shall not be used for promotional or publicity purpose without the written consent of Analytical Laboratory Narmada Clean Tech.
4. Waste water samples shall be stored for the period of Fifteen days after the date of issue of Report.

For Narmada Clean Tech

Twinkle Modi

Authorized By

Twinkle Modi
Sr. Executive QCD

----- End of Report -----

Format No. F/OPN/01/01 Issue no. 01 Issue date 01/04/2022 Rev no. 01 Rev date : 02/04/2024 Page 2 Of 2

Surti Bhagor, Nr. Gujarat Gas Office, Umarwada Road, Ankleshwar-393 001, Dist. Bharuch (Gujarat)
Tele : 8469745285, Email : info@nctc.co.in; website : www.nctc.co.in, CIN : U140101GJ2000NPL037236



AnyScanner



Analytical Laboratory
NARMADA CLEAN TECH
(A Subsidiary of GIDC)



Report No : NCT/MIAR/2026/JAN/N-938

URL No. : TC1159826000022073F

To :

ENVIRO TECHNOLOGY LIMITED

Plot No: 2413/14, GIDC ESTATE

ANKLESHWAR 393 002.

Issue Date : 01/02/2026

TEST REPORT

Kindly find here with the Test report.

Sample Description:	Waste Water	Sample Quantity:	750 ml
Sampling Location:	Free flow sample from Final Discharge Point	Sample Received Date:	31/01/2026
Sample Received By:	Mr. Upendra Rout	Sampling Plan & Procedure:	N.A.
Packing Details:	Preserved (250ml) and Unpreserved (500ml) sample in Plastic bottle	Analysis Start Date:	31/01/2026
Customer Sample Id	N-2	Analysis Completion Date:	31/01/2026
Sampling Start Date & Time:	31/01/2026 & 1:28	Sampling done By:	NCT Monitoring Team

Sr No.	Parameter	Unit	Results	Method Ref.
1	pH at Room Temperature	~	7.5	APHA 24th ed. 4500 H+B
2	Chemical Oxygen Demand	mg/L	851	APHA 24th ed. 5220 B
3	Ammonical Nitrogen	mg/L	BDL	APHA 24th ed. 4500 NH3C
4	Total Dissolved Solids Dried at 180°C	mg/L	23000	APHA 24th ed. 2540 C
5	Total Suspended Solids Dried from 103-105°C	mg/L	74	APHA 24th ed. 2540 D

Note: Joint Analysis will be entertained within 15 days from the date of sampling

Abbreviation: BDL – Below Detection Limit

Any addition to , deviations, or exclusions from the method : Not Applicable

Remarks :

Terms and conditions governing the test report issued

1. Sample is drawn by Narmada Clean Tech ; the results are applicable only to the Received samples from Customer.
2. The test report shall not be reproduced in full or part without the written approval of the Analytical Laboratory Narmada Clean Tech.
3. The test report in full or part shall not be used for promotional or publicity purpose without the written consent of Analytical Laboratory Narmada Clean Tech.
4. Waste water samples shall be stored for the period of Fifteen days after the date of issue of Report.

For Narmada Clean Tech

Twinkle Modi

Authorized By

Twinkle Modi
Sr. Executive QCD

----- End of Report -----

Format No. F/OPN/01/01 Issue no. 01 Issue date 01/04/2022 Rev no. 01 Rev date : 02/04/2024 Page 1 Of 1

Surti Bhagor, Nr. Gujarat Gas Office, Umarwada Road, Ankleshwar-393 001, Dist. Bharuch (Gujarat)
Tele : 8469745285, Email : info@nctc.co.in; website : www.nctc.co.in, CIN : U140101GJ2000NPL037236



AnyScanner



Analytical Laboratory
NARMADA CLEAN TECH
(A Subsidiary of GIDC)



Report No : NCT/MIAR/2026/FEB/N-200

Issue Date : 09/02/2026

URL No. : TC1159826000022368F

To :

ENVIRO TECHNOLOGY LIMITED

Plot No: 2413/14, GIDC ESTATE

ANKLESHWAR 393 002.

TEST REPORT

Kindly find here with the Test report.

Sample Description:	Waste Water	Sample Quantity:	750 ml
Sampling Location:	Free flow sample from Final Discharge Point	Sample Received Date:	08/02/2026
Sample Received By:	Mr. Upendra Rout	Sampling Plan & Procedure:	N.A.
Packing Details:	Preserved (250ml) and Unpreserved (500ml) sample in Plastic bottle	Analysis Start Date:	08/02/2026
Customer Sample Id	N-11	Analysis Completion Date:	08/02/2026
Sampling Start Date & Time:	08/02/2026 & 0:20	Sampling done By:	NCT Monitoring Team

Sr No.	Parameter	Unit	Results	Method Ref.
1	pH at Room Temperature	~	7.37	APHA 24th ed. 4500 H+B
2	Chemical Oxygen Demand	mg/L	928	APHA 24th ed. 5220 B
3	Ammonical Nitrogen	mg/L	BDL	APHA 24th ed. 4500 NH3C
4	Total Dissolved Solids Dried at 180°C	mg/L	22518	APHA 24th ed. 2540 C
5	Total Suspended Solids Dried from 103-105°C	mg/L	33	APHA 24th ed. 2540 D

Note: Joint Analysis will be entertained within 15 days from the date of sampling

Abbreviation: BDL – Below Detection Limit

Any addition to , deviations, or exclusions from the method : Not Applicable

Remarks :

Terms and conditions governing the test report issued

1. Sample is drawn by Narmada Clean Tech ; the results are applicable only to the Received samples from Customer.
2. The test report shall not be reproduced in full or part without the written approval of the Analytical Laboratory Narmada Clean Tech.
3. The test report in full or part shall not be used for promotional or publicity purpose without the written consent of Analytical Laboratory Narmada Clean Tech.
4. Waste water samples shall be stored for the period of Fifteen days after the date of issue of Report.

For Narmada Clean Tech

Authorized By

Twinkle Modi
Sr. Executive QCD

----- End of Report -----

Format No. F/OPN/01/01 Issue no. 01 Issue date 01/04/2022 Rev no. 01 Rev date : 02/04/2024 Page 1 Of 1

Surti Bhagor, Nr. Gujarat Gas Office, Umarwada Road, Ankleshwar-393 001, Dist. Bharuch (Gujarat)
Tele : 8469745285, Email : info@nctc.co.in; website : www.nctc.co.in, CIN : U140101GJ2000NPL037236



AnyScanner



Analytical Laboratory
NARMADA CLEAN TECH
(A Subsidiary of GIDC)



Report No : NCT/MIAR/2026/FEB/N-357

Issue Date : 14/02/2026

URL No. : TC1159826000022529F

To :

ENVIRO TECHNOLOGY LIMITED

Plot No: 2413/14, GIDC ESTATE

ANKLESHWAR 393 002.

TEST REPORT

Kindly find here with the Test report.

Sample Description:	Waste Water	Sample Quantity:	750 ml
Sampling Location:	Free flow sample from Final Discharge Point	Sample Received Date:	13/02/2026
Sample Received By:	Mr. Upendra Rout	Sampling Plan & Procedure:	N.A.
Packing Details:	Preserved (250ml) and Unpreserved (500ml) sample in Plastic bottle	Analysis Start Date:	13/02/2026
Customer Sample Id	N-16	Analysis Completion Date:	13/02/2026
Sampling Start Date & Time:	13/02/2026 & 0:49	Sampling done By:	NCT Monitoring Team

Sr No.	Parameter	Unit	Results	Method Ref.
1	pH at Room Temperature	~	7.18	APHA 24th ed. 4500 H+B
2	Chemical Oxygen Demand	mg/L	888	APHA 24th ed. 5220 B
3	Ammonical Nitrogen	mg/L	BDL	APHA 24th ed. 4500 NH3C
4	Total Dissolved Solids Dried at 180°C	mg/L	20212	APHA 24th ed. 2540 C
5	Total Suspended Solids Dried from 103-105°C	mg/L	60	APHA 24th ed. 2540 D

Note: Joint Analysis will be entertained within 15 days from the date of sampling

Abbreviation: BDL – Below Detection Limit

Any addition to , deviations, or exclusions from the method : Not Applicable

Remarks :

Terms and conditions governing the test report issued

1. Sample is drawn by Narmada Clean Tech ; the results are applicable only to the Received samples from Customer.
2. The test report shall not be reproduced in full or part without the written approval of the Analytical Laboratory Narmada Clean Tech.
3. The test report in full or part shall not be used for promotional or publicity purpose without the written consent of Analytical Laboratory Narmada Clean Tech.
4. Waste water samples shall be stored for the period of Fifteen days after the date of issue of Report.

For Narmada Clean Tech

Twinkle Modi

Authorized By

Twinkle Modi
Sr. Executive QCD

End of Report

Format No. F/OPN/01/01 Issue no. 01 Issue date 01/04/2022 Rev no. 01 Rev date : 02/04/2024 Page 1 Of 2

Surti Bhagor, Nr. Gujarat Gas Office, Umarwada Road, Ankleshwar-393 001, Dist. Bharuch (Gujarat)
Tele : 8469745285, Email : info@nctc.co.in; website : www.nctc.co.in, CIN : U140101GJ2000NPL037236



AnyScanner



Analytical Laboratory
NARMADA CLEAN TECH
(A Subsidiary of GIDC)



Report No : NCT/MIAR/2026/FEB/N-358

Issue Date : 14/02/2026

URL No. : TC1159826000022530F

To :

ENVIRO TECHNOLOGY LIMITED

Plot No: 2413/14, GIDC ESTATE

ANKLESHWAR 393 002.

TEST REPORT

Kindly find here with the Test report.

Sample Description:	Waste Water	Sample Quantity:	750 ml
Sampling Location:	Free flow sample from Final Discharge Point	Sample Received Date:	13/02/2026
Sample Received By:	Mr. Upendra Rout	Sampling Plan & Procedure:	N.A.
Packing Details:	Preserved (250ml) and Unpreserved (500ml) sample in Plastic bottle	Analysis Start Date:	13/02/2026
Customer Sample Id	N-17	Analysis Completion Date:	13/02/2026
Sampling Start Date & Time:	12/02/2026 & 9:55	Sampling done By:	NCT Monitoring Team

Sr No.	Parameter	Unit	Results	Method Ref.
1	pH at Room Temperature	~	7.59	APHA 24th ed. 4500 H+B
2	Chemical Oxygen Demand	mg/L	793	APHA 24th ed. 5220 B
3	Ammonical Nitrogen	mg/L	38	APHA 24th ed. 4500 NH3C
4	Total Dissolved Solids Dried at 180°C	mg/L	14492	APHA 24th ed. 2540 C
5	Total Suspended Solids Dried from 103-105°C	mg/L	28	APHA 24th ed. 2540 D

Note: Joint Analysis will be entertained within 15 days from the date of sampling

Abbreviation: BDL – Below Detection Limit

Any addition to , deviations, or exclusions from the method : Not Applicable

Remarks :

Terms and conditions governing the test report issued

1. Sample is drawn by Narmada Clean Tech ; the results are applicable only to the Received samples from Customer.
2. The test report shall not be reproduced in full or part without the written approval of the Analytical Laboratory Narmada Clean Tech.
3. The test report in full or part shall not be used for promotional or publicity purpose without the written consent of Analytical Laboratory Narmada Clean Tech.
4. Waste water samples shall be stored for the period of Fifteen days after the date of issue of Report.

For Narmada Clean Tech

Twinkle Modi

Authorized By

Twinkle Modi
Sr. Executive QCD

End of Report



Analytical Laboratory
NARMADA CLEAN TECH
(A Subsidiary of GIDC)



Report No : NCT/MIAR/2026/FEB/N-469

Issue Date : 18/02/2026

URL No. : TC1159826000022641F

To :

ENVIRO TECHNOLOGY LIMITED

Plot No: 2413/14, GIDC ESTATE

ANKLESHWAR 393 002.

TEST REPORT

Kindly find here with the Test report.

Sample Description:	Waste Water	Sample Quantity:	750 ml
Sampling Location:	Free flow sample from Final Discharge Point	Sample Received Date:	17/02/2026
Sample Received By:	Mr. Upendra Rout	Sampling Plan & Procedure:	N.A.
Packing Details:	Preserved (250ml) and Unpreserved (500ml) sample in Plastic bottle	Analysis Start Date:	17/02/2026
Customer Sample Id	N-1	Analysis Completion Date:	17/02/2026
Sampling Start Date & Time:	16/02/2026 & 12:32	Sampling done By:	NCT Monitoring Team

Sr No.	Parameter	Unit	Results	Method Ref.
1	pH at Room Temperature	~	7.33	APHA 24th ed. 4500 H+B
2	Chemical Oxygen Demand	mg/L	872	APHA 24th ed. 5220 B
3	Ammonical Nitrogen	mg/L	BDL	APHA 24th ed. 4500 NH3C
4	Total Dissolved Solids Dried at 180°C	mg/L	21000	APHA 24th ed. 2540 C
5	Total Suspended Solids Dried from 103-105°C	mg/L	65	APHA 24th ed. 2540 D

Note: Joint Analysis will be entertained within 15 days from the date of sampling

Abbreviation: BDL – Below Detection Limit

Any addition to , deviations, or exclusions from the method : Not Applicable

Remarks :

Terms and conditions governing the test report issued

1. Sample is drawn by Narmada Clean Tech ; the results are applicable only to the Received samples from Customer.
2. The test report shall not be reproduced in full or part without the written approval of the Analytical Laboratory Narmada Clean Tech.
3. The test report in full or part shall not be used for promotional or publicity purpose without the written consent of Analytical Laboratory Narmada Clean Tech.
4. Waste water samples shall be stored for the period of Fifteen days after the date of issue of Report.

For Narmada Clean Tech

Twinkle Modi

Authorized By

Twinkle Modi
Sr. Executive QCD

End of Report

Format No. F/OPN/01/01 Issue no. 01 Issue date 01/04/2022 Rev no. 01 Rev date : 02/04/2024 Page 1 Of 1

Surti Bhagor, Nr. Gujarat Gas Office, Umarwada Road, Ankleshwar-393 001, Dist. Bharuch (Gujarat)
Tele : 8469745285, Email : info@nctc.co.in; website : www.nctc.co.in, CIN : U140101GJ2000NPL037236



AnyScanner



Analytical Laboratory
NARMADA CLEAN TECH
(A Subsidiary of GIDC)



Issue Date : 19/02/2026

Report No : NCT/MIAR/2026/FEB/N-512

URL No. : TC1159826000022692F

To :

ENVIRO TECHNOLOGY LIMITED

Plot No: 2413/14, GIDC ESTATE

ANKLESHWAR 393 002.

TEST REPORT

Kindly find here with the Test report.

Sample Description:	Waste Water	Sample Quantity:	750 ml
Sampling Location:	Free flow sample from Final Discharge Point	Sample Received Date:	18/02/2026
Sample Received By:	Mr. Upendra Rout	Sampling Plan & Procedure:	N.A.
Packing Details:	Preserved (250ml) and Unpreserved (500ml) sample in Plastic bottle	Analysis Start Date:	18/02/2026
Customer Sample Id	N-11	Analysis Completion Date:	18/02/2026
Sampling Start Date & Time:	17/02/2026 & 19:55	Sampling done By:	NCT Monitoring Team

Sr No.	Parameter	Unit	Results	Method Ref.
1	pH at Room Temperature	~	7.34	APHA 24th ed. 4500 H+B
2	Chemical Oxygen Demand	mg/L	869	APHA 24th ed. 5220 B
3	Ammonical Nitrogen	mg/L	BDL	APHA 24th ed. 4500 NH3C
4	Total Dissolved Solids Dried at 180°C	mg/L	21992	APHA 24th ed. 2540 C
5	Total Suspended Solids Dried from 103-105°C	mg/L	40	APHA 24th ed. 2540 D

Note: Joint Analysis will be entertained within 15 days from the date of sampling

Abbreviation: BDL – Below Detection Limit

Any addition to , deviations, or exclusions from the method : Not Applicable

Remarks :

Terms and conditions governing the test report issued

1. Sample is drawn by Narmada Clean Tech ; the results are applicable only to the Received samples from Customer.
2. The test report shall not be reproduced in full or part without the written approval of the Analytical Laboratory Narmada Clean Tech.
3. The test report in full or part shall not be used for promotional or publicity purpose without the written consent of Analytical Laboratory Narmada Clean Tech.
4. Waste water samples shall be stored for the period of Fifteen days after the date of issue of Report.

For Narmada Clean Tech

Twinkle Modi

Authorized By

Twinkle Modi
Sr. Executive QCD

End of Report

Format No. F/OPN/01/01 Issue no. 01 Issue date 01/04/2022 Rev no. 01 Rev date : 02/04/2024 Page 1 Of 1

Surti Bhagor, Nr. Gujarat Gas Office, Umarwada Road, Ankleshwar-393 001, Dist. Bharuch (Gujarat)



AnyScanner



Analytical Laboratory
NARMADA CLEAN TECH
(A Subsidiary of GIDC)



Report No : NCT/MIAR/2026/FEB/N-604

URL No. : TC1159826000022786F

To :

ENVIRO TECHNOLOGY LIMITED

Plot No: 2413/14, GIDC ESTATE

ANKLESHWAR 393 002.

Issue Date : 22/02/2026

TEST REPORT

Kindly find here with the Test report.

Sample Description:	Waste Water	Sample Quantity:	750 ml
Sampling Location:	Free flow sample from Final Discharge Point	Sample Received Date:	21/02/2026
Sample Received By:	Mr. Upendra Rout	Sampling Plan & Procedure:	N.A.
Packing Details:	Preserved (250ml) and Unpreserved (500ml) sample in Plastic bottle	Analysis Start Date:	21/02/2026
Customer Sample Id	N-8	Analysis Completion Date:	21/02/2026
Sampling Start Date & Time:	20/02/2026 & 17:00	Sampling done By:	NCT Monitoring Team

Sr No.	Parameter	Unit	Results	Method Ref.
1	pH at Room Temperature	~	7.36	APHA 24th ed. 4500 H+B
2	Chemical Oxygen Demand	mg/L	865	APHA 24th ed. 5220 B
3	Ammonical Nitrogen	mg/L	BDL	APHA 24th ed. 4500 NH3C
4	Total Dissolved Solids Dried at 180°C	mg/L	20944	APHA 24th ed. 2540 C
5	Total Suspended Solids Dried from 103-105°C	mg/L	32	APHA 24th ed. 2540 D

Note: Joint Analysis will be entertained within 15 days from the date of sampling

Abbreviation: BDL – Below Detection Limit

Any addition to , deviations, or exclusions from the method : Not Applicable

Remarks :

Terms and conditions governing the test report issued

1. Sample is drawn by Narmada Clean Tech ; the results are applicable only to the Received samples from Customer.
2. The test report shall not be reproduced in full or part without the written approval of the Analytical Laboratory Narmada Clean Tech.
3. The test report in full or part shall not be used for promotional or publicity purpose without the written consent of Analytical Laboratory Narmada Clean Tech.
4. Waste water samples shall be stored for the period of Fifteen days after the date of issue of Report.

For Narmada Clean Tech

Twinkle Modi

Authorized By

Twinkle Modi
Sr. Executive QCD

----- End of Report -----

Format No. F/OPN/01/01 Issue no. 01 Issue date 01/04/2022 Rev no. 01 Rev date : 02/04/2024 Page 1 Of 1

Surti Bhagor, Nr. Gujarat Gas Office, Umarwada Road, Ankleshwar-393 001, Dist. Bharuch (Gujarat)



AnyScanner



Analytical Laboratory
NARMADA CLEAN TECH
(A Subsidiary of GIDC)



Report No : NCT/MIAR/2026/FEB/N-699

Issue Date : 25/02/2026

URL No. : TC1159826000022883F

To :

ENVIRO TECHNOLOGY LIMITED

Plot No: 2413/14, GIDC ESTATE

ANKLESHWAR 393 002.

TEST REPORT

Kindly find here with the Test report.

Sample Description:	Waste Water	Sample Quantity:	750 ml
Sampling Location:	Free flow sample from Final Discharge Point	Sample Received Date:	24/02/2026
Sample Received By:	Mr. Upendra Rout	Sampling Plan & Procedure:	N.A.
Packing Details:	Preserved (250ml) and Unpreserved (500ml) sample in Plastic bottle	Analysis Start Date:	24/02/2026
Customer Sample Id	N-11	Analysis Completion Date:	24/02/2026
Sampling Start Date & Time:	24/02/2026 & 0:50	Sampling done By:	NCT Monitoring Team

Sr No.	Parameter	Unit	Results	Method Ref.
1	pH at Room Temperature	~	7.25	APHA 24th ed. 4500 H+B
2	Chemical Oxygen Demand	mg/L	853	APHA 24th ed. 5220 B
3	Ammonical Nitrogen	mg/L	BDL	APHA 24th ed. 4500 NH3C
4	Total Dissolved Solids Dried at 180°C	mg/L	22222	APHA 24th ed. 2540 C
5	Total Suspended Solids Dried from 103-105°C	mg/L	51	APHA 24th ed. 2540 D

Note: Joint Analysis will be entertained within 15 days from the date of sampling

Abbreviation: BDL – Below Detection Limit

Any addition to , deviations, or exclusions from the method : Not Applicable

Remarks :

Terms and conditions governing the test report issued

1. Sample is drawn by Narmada Clean Tech ; the results are applicable only to the Received samples from Customer.
2. The test report shall not be reproduced in full or part without the written approval of the Analytical Laboratory Narmada Clean Tech.
3. The test report in full or part shall not be used for promotional or publicity purpose without the written consent of Analytical Laboratory Narmada Clean Tech.
4. Waste water samples shall be stored for the period of Fifteen days after the date of issue of Report.

For Narmada Clean Tech

Twinkle Modi

Authorized By

Twinkle Modi
Sr. Executive QCD

End of Report

Format No. F/OPN/01/01 Issue no. 01 Issue date 01/04/2022 Rev no. 01 Rev date : 02/04/2024 Page 1 Of 1

Surti Bhagor, Nr. Gujarat Gas Office, Umarwada Road, Ankleshwar-393 001, Dist. Bharuch (Gujarat)
Tele : 8469745285, Email : info@nctc.co.in; website : www.nctc.co.in, CIN : U140101GJ2000NPL037236



AnyScanner



Analytical Laboratory
NARMADA CLEAN TECH
(A Subsidiary of GIDC)



Report No : NCT/MIAR/2026/FEB/N-785

Issue Date : 28/02/2026

URL No. : TC1159826000022972F

To :

ENVIRO TECHNOLOGY LIMITED

Plot No: 2413/14, GIDC ESTATE

ANKLESHWAR 393 002.

TEST REPORT

Kindly find here with the Test report.

Sample Description:	Waste Water	Sample Quantity:	750 ml
Sampling Location:	Sample collected from Autosampler	Sample Received Date:	27/02/2026
Sample Received By:	Mr. Upendra Rout	Sampling Plan & Procedure:	N.A.
Packing Details:	Preserved (250ml) and Unpreserved (500ml) sample in Plastic bottle	Analysis Start Date:	27/02/2026
Customer Sample Id	N-10	Analysis Completion Date:	27/02/2026
Sampling Start Date & Time:	26/02/2026 & 18:03	Sampling done By:	NCT Monitoring Team

Sr No.	Parameter	Unit	Results	Method Ref.
1	pH at Room Temperature	~	7.63	APHA 24th ed. 4500 H+B
2	Chemical Oxygen Demand	mg/L	860	APHA 24th ed. 5220 B
3	Ammonical Nitrogen	mg/L	BDL	APHA 24th ed. 4500 NH3C
4	Total Dissolved Solids Dried at 180°C	mg/L	22930	APHA 24th ed. 2540 C
5	Total Suspended Solids Dried from 103-105°C	mg/L	56	APHA 24th ed. 2540 D

Note: Joint Analysis will be entertained within 15 days from the date of sampling

Abbreviation: BDL – Below Detection Limit

Any addition to , deviations, or exclusions from the method : Not Applicable

Remarks :

Terms and conditions governing the test report issued

1. Sample is drawn by Narmada Clean Tech ; the results are applicable only to the Received samples from Customer.
2. The test report shall not be reproduced in full or part without the written approval of the Analytical Laboratory Narmada Clean Tech.
3. The test report in full or part shall not be used for promotional or publicity purpose without the written consent of Analytical Laboratory Narmada Clean Tech.
4. Waste water samples shall be stored for the period of Fifteen days after the date of issue of Report.

For Narmada Clean Tech

Twinkle Modi

Authorized By

Twinkle Modi
Sr. Executive QCD

----- End of Report -----

Format No. F/OPN/01/01 Issue no. 01 Issue date 01/04/2022 Rev no. 01 Rev date : 02/04/2024 Page 1 Of 1

Surti Bhagor, Nr. Gujarat Gas Office, Umarwada Road, Ankleshwar-393 001, Dist. Bharuch (Gujarat)
Tele : 8469745285, Email : info@nctc.co.in; website : www.nctc.co.in, CIN : U140101GJ2000NPL037236



AnyScanner



Analytical Laboratory
NARMADA CLEAN TECH
(A Subsidiary of GIDC)



Report No : NCT/MIAR/2026/MAR/N-36

Issue Date : 04/03/2026

URL No. : TC1159826000023095F

To :

ENVIRO TECHNOLOGY LIMITED

Plot No: 2413/14, GIDC ESTATE

ANKLESHWAR 393 002.

TEST REPORT

Kindly find here with the Test report.

Sample Description:	Waste Water	Sample Quantity:	750 ml
Sampling Location:	Free flow sample from Final Discharge Point	Sample Received Date:	03/03/2026
Sample Received By:	Mr. Upendra Rout	Sampling Plan & Procedure:	N.A.
Packing Details:	Preserved (250ml) and Unpreserved (500ml) sample in Plastic bottle	Analysis Start Date:	03/03/2026
Customer Sample Id	N-1	Analysis Completion Date:	03/03/2026
Sampling Start Date & Time:	02/03/2026 & 13:59	Sampling done By:	NCT Monitoring Team

Sr No.	Parameter	Unit	Results	Method Ref.
1	pH at Room Temperature	~	7.12	APHA 24th ed. 4500 H+B
2	Chemical Oxygen Demand	mg/L	809	APHA 24th ed. 5220 B
3	Ammonical Nitrogen	mg/L	BDL	APHA 24th ed. 4500 NH3C
4	Total Dissolved Solids Dried at 180°C	mg/L	22648	APHA 24th ed. 2540 C
5	Total Suspended Solids Dried from 103-105°C	mg/L	40	APHA 24th ed. 2540 D

Note: Joint Analysis will be entertained within 15 days from the date of sampling

Abbreviation: BDL – Below Detection Limit

Any addition to , deviations, or exclusions from the method : Not Applicable

Remarks :

Terms and conditions governing the test report issued

1. Sample is drawn by Narmada Clean Tech ; the results are applicable only to the Received samples from Customer.
2. The test report shall not be reproduced in full or part without the written approval of the Analytical Laboratory Narmada Clean Tech.
3. The test report in full or part shall not be used for promotional or publicity purpose without the written consent of Analytical Laboratory Narmada Clean Tech.
4. Waste water samples shall be stored for the period of Fifteen days after the date of issue of Report.

For Narmada Clean Tech

Twinkle Modi

Authorized By

Twinkle Modi
Sr. Executive QCD

End of Report

Format No. F/OPN/01/01 Issue no. 01 Issue date 01/04/2022 Rev no. 01 Rev date : 02/04/2024 Page 1 Of 1

Surti Bhagor, Nr. Gujarat Gas Office, Umarwada Road, Ankleshwar-393 001, Dist. Bharuch (Gujarat)



AnyScanner



Analytical Laboratory
NARMADA CLEAN TECH
(A Subsidiary of GIDC)



Report No : NCT/MIAR/2026/MAR/N-107

Issue Date : 06/03/2026

URL No. : TC1159826000023168F

To :

ENVIRO TECHNOLOGY LIMITED

Plot No: 2413/14, GIDC ESTATE

ANKLESHWAR 393 002.

TEST REPORT

Kindly find here with the Test report.

Sample Description:	Waste Water	Sample Quantity:	750 ml
Sampling Location:	Free flow sample from Final Discharge Point	Sample Received Date:	05/03/2026
Sample Received By:	Mr. Upendra Rout	Sampling Plan & Procedure:	N.A.
Packing Details:	Preserved (250ml) and Unpreserved (500ml) sample in Plastic bottle	Analysis Start Date:	05/03/2026
Customer Sample Id	N-9	Analysis Completion Date:	05/03/2026
Sampling Start Date & Time:	04/03/2026 & 16:48	Sampling done By:	NCT Monitoring Team

Sr No.	Parameter	Unit	Results	Method Ref.
1	pH at Room Temperature	~	7.26	APHA 24th ed. 4500 H+B
2	Chemical Oxygen Demand	mg/L	768	APHA 24th ed. 5220 B
3	Ammonical Nitrogen	mg/L	BDL	APHA 24th ed. 4500 NH3C
4	Total Dissolved Solids Dried at 180°C	mg/L	22480	APHA 24th ed. 2540 C
5	Total Suspended Solids Dried from 103-105°C	mg/L	30	APHA 24th ed. 2540 D

Note: Joint Analysis will be entertained within 15 days from the date of sampling
Abbreviation: BDL – Below Detection Limit
Any addition to , deviations, or exclusions from the method : Not Applicable

Remarks :

Terms and conditions governing the test report issued

1. Sample is drawn by Narmada Clean Tech ; the results are applicable only to the Received samples from Customer.
2. The test report shall not be reproduced in full or part without the written approval of the Analytical Laboratory Narmada Clean Tech.
3. The test report in full or part shall not be used for promotional or publicity purpose without the written consent of Analytical Laboratory Narmada Clean Tech.
4. Waste water samples shall be stored for the period of Fifteen days after the date of issue of Report.

For Narmada Clean Tech

Twinkle Modi

Authorized By

Twinkle Modi
Sr. Executive QCD

End of Report

Format No. F/OPN/01/01 Issue no. 01 Issue date 01/04/2022 Rev no. 01 Rev date : 02/04/2024 Page 1 Of 1

Surti Bhagor, Nr. Gujarat Gas Office, Umarwada Road, Ankleshwar-393 001, Dist. Bharuch (Gujarat)
Tele : 8469745285, Email : info@nctc.co.in; website : www.nctc.co.in, CIN : U140101GJ2000NPL037236



AnyScanner



Analytical Laboratory
NARMADA CLEAN TECH
(A Subsidiary of GIDC)



Report No : NCT/MIAR/2026/MAR/N-366

Issue Date : 14/03/2026

URL No. : TC1159826000023438F

To :

ENVIRO TECHNOLOGY LIMITED

Plot No: 2413/14, GIDC ESTATE

ANKLESHWAR 393 002.

TEST REPORT

Kindly find here with the Test report.

Sample Description:	Waste Water	Sample Quantity:	750 ml
Sampling Location:	Free flow sample from Final Discharge Point	Sample Received Date:	13/03/2026
Sample Received By:	Mr. Upendra Rout	Sampling Plan & Procedure:	N.A.
Packing Details:	Preserved (250ml) and Unpreserved (500ml) sample in Plastic bottle	Analysis Start Date:	13/03/2026
Customer Sample Id	N-14	Analysis Completion Date:	13/03/2026
Sampling Start Date & Time:	13/03/2026 & 2:21	Sampling done By:	NCT Monitoring Team

Sr No.	Parameter	Unit	Results	Method Ref.
1	pH at Room Temperature	~	7.26	APHA 24th ed. 4500 H+B
2	Chemical Oxygen Demand	mg/L	832	APHA 24th ed. 5220 B
3	Ammonical Nitrogen	mg/L	BDL	APHA 24th ed. 4500 NH3C
4	Total Dissolved Solids Dried at 180°C	mg/L	22368	APHA 24th ed. 2540 C
5	Total Suspended Solids Dried from 103-105°C	mg/L	44	APHA 24th ed. 2540 D

Note: Joint Analysis will be entertained within 15 days from the date of sampling

Abbreviation: BDL – Below Detection Limit

Any addition to , deviations, or exclusions from the method : Not Applicable

Remarks :

Terms and conditions governing the test report issued

1. Sample is drawn by Narmada Clean Tech ; the results are applicable only to the Received samples from Customer.
2. The test report shall not be reproduced in full or part without the written approval of the Analytical Laboratory Narmada Clean Tech.
3. The test report in full or part shall not be used for promotional or publicity purpose without the written consent of Analytical Laboratory Narmada Clean Tech.
4. Waste water samples shall be stored for the period of Fifteen days after the date of issue of Report.

For Narmada Clean Tech

Modi Twinkle H.

Authorized By

Twinkle Modi
Sr. Executive QCD

----- End of Report -----

Format No. F/OPN/01/01 Issue no. 01 Issue date 01/04/2022 Rev no. 01 Rev date : 02/04/2024 Page 1 Of 1

Surti Bhagor, Nr. Gujarat Gas Office, Umarwada Road, Ankleshwar-393 001, Dist. Bharuch (Gujarat)
Tele : 8469745285, Email : info@nctc.co.in; website : www.nctc.co.in, CIN : U140101GJ2000NPL037236



AnyScanner



Analytical Laboratory
NARMADA CLEAN TECH
(A Subsidiary of GIDC)



Report No : NCT/MIAR/2026/MAR/N-545

Issue Date : 20/03/2026

URL No. : TC1159826000023627F

To :

ENVIRO TECHNOLOGY LIMITED

Plot No: 2413/14, GIDC ESTATE

ANKLESHWAR 393 002.

TEST REPORT

Kindly find here with the Test report.

Sample Description:	Waste Water	Sample Quantity:	750 ml
Sampling Location:	Sample collected from Autosampler	Sample Received Date:	19/03/2026
Sample Received By:	Mr. Upendra Rout	Sampling Plan & Procedure:	N.A.
Packing Details:	Preserved (250ml) and Unpreserved (500ml) sample in Plastic bottle	Analysis Start Date:	19/03/2026
Customer Sample Id	N-12	Analysis Completion Date:	19/03/2026
Sampling Start Date & Time:	18/03/2026 & 18:53	Sampling done By:	NCT Monitoring Team

Sr No.	Parameter	Unit	Results	Method Ref.
1	pH at Room Temperature	~	7.5	APHA 24th ed. 4500 H+B
2	Chemical Oxygen Demand	mg/L	796	APHA 24th ed. 5220 B
3	Ammonical Nitrogen	mg/L	BDL	APHA 24th ed. 4500 NH3C
4	Total Dissolved Solids Dried at 180°C	mg/L	22866	APHA 24th ed. 2540 C
5	Total Suspended Solids Dried from 103-105°C	mg/L	36	APHA 24th ed. 2540 D

Note: Joint Analysis will be entertained within 15 days from the date of sampling

Abbreviation: BDL – Below Detection Limit

Any addition to , deviations, or exclusions from the method : Not Applicable

Remarks :

Terms and conditions governing the test report issued

1. Sample is drawn by Narmada Clean Tech ; the results are applicable only to the Received samples from Customer.
2. The test report shall not be reproduced in full or part without the written approval of the Analytical Laboratory Narmada Clean Tech.
3. The test report in full or part shall not be used for promotional or publicity purpose without the written consent of Analytical Laboratory Narmada Clean Tech.
4. Waste water samples shall be stored for the period of Fifteen days after the date of issue of Report.

For Narmada Clean Tech

Twinkle Modi

Authorized By

Twinkle Modi
Sr. Executive QCD

End of Report

Format No. F/OPN/01/01 Issue no. 01 Issue date 01/04/2022 Rev no. 01 Rev date : 02/04/2024 Page 1 Of 1

Surti Bhagor, Nr. Gujarat Gas Office, Umarwada Road, Ankleshwar-393 001, Dist. Bharuch (Gujarat)
Tele : 8469745285, Email : info@nctc.co.in; website : www.nctc.co.in, CIN : U140101GJ2000NPL037236



AnyScanner



Analytical Laboratory
NARMADA CLEAN TECH
(A Subsidiary of GIDC)



Report No : NCT/MIAR/2026/MAR/N-637

Issue Date : 23/03/2026

URL No. : TC1159826000023720F

To :

ENVIRO TECHNOLOGY LIMITED

Plot No: 2413/14, GIDC ESTATE

ANKLESHWAR 393 002.

TEST REPORT

Kindly find here with the Test report.

Sample Description:	Waste Water	Sample Quantity:	750 ml
Sampling Location:	Free flow sample from Final Discharge Point	Sample Received Date:	22/03/2026
Sample Received By:	Mr. Upendra Rout	Sampling Plan & Procedure:	N.A.
Packing Details:	Preserved (250ml) and Unpreserved (500ml) sample in Plastic bottle	Analysis Start Date:	22/03/2026
Customer Sample Id	N-8	Analysis Completion Date:	22/03/2026
Sampling Start Date & Time:	21/03/2026 & 12:20	Sampling done By:	NCT Monitoring Team

Sr No.	Parameter	Unit	Results	Method Ref.
1	pH at Room Temperature	~	7.4	APHA 24th ed. 4500 H+B
2	Chemical Oxygen Demand	mg/L	777	APHA 24th ed. 5220 B
3	Ammonical Nitrogen	mg/L	BDL	APHA 24th ed. 4500 NH3C
4	Total Dissolved Solids Dried at 180°C	mg/L	22226	APHA 24th ed. 2540 C
5	Total Suspended Solids Dried from 103-105°C	mg/L	42	APHA 24th ed. 2540 D

Note: Joint Analysis will be entertained within 15 days from the date of sampling

Abbreviation: BDL – Below Detection Limit

Any addition to , deviations, or exclusions from the method : Not Applicable

Remarks :

Terms and conditions governing the test report issued

1. Sample is drawn by Narmada Clean Tech ; the results are applicable only to the Received samples from Customer.

2. The test report shall not be reproduced in full or part without the written approval of the Analytical Laboratory Narmada Clean Tech.

3. The test report in full or part shall not be used for promotional or publicity purpose without the written consent of Analytical Laboratory Narmada Clean Tech.

4. Waste water samples shall be stored for the period of Fifteen days after the date of issue of Report.

For Narmada Clean Tech

Twinkle Modi

Authorized By

Twinkle Modi
Sr. Executive QCD

End of Report

Format No. F/OPN/01/01 Issue no. 01 Issue date 01/04/2022 Rev no. 01 Rev date : 02/04/2024 Page 1 Of 1

Surti Bhagor, Nr. Gujarat Gas Office, Umarwada Road, Ankleshwar-393 001, Dist. Bharuch (Gujarat)
Tele : 8469745285, Email : info@nctc.co.in; website : www.nctc.co.in, CIN : U140101GJ2000NPL037236



AnyScanner



Analytical Laboratory
NARMADA CLEAN TECH
(A Subsidiary of GIDC)



Report No : NCT/MIAR/2026/MAR/N-736

Issue Date : 26/03/2026

URL No. : TC1159826000023826F

To :

ENVIRO TECHNOLOGY LIMITED

Plot No: 2413/14, GIDC ESTATE

ANKLESHWAR 393 002.

TEST REPORT

Kindly find here with the Test report.

Sample Description:	Waste Water	Sample Quantity:	750 ml
Sampling Location:	Free flow sample from Final Discharge Point	Sample Received Date:	25/03/2026
Sample Received By:	Mr. Upendra Rout	Sampling Plan & Procedure:	N.A.
Packing Details:	Preserved (250ml) and Unpreserved (500ml) sample in Plastic bottle	Analysis Start Date:	25/03/2026
Customer Sample Id	N-11	Analysis Completion Date:	25/03/2026
Sampling Start Date & Time:	24/03/2026 & 17:55	Sampling done By:	NCT Monitoring Team

Sr No.	Parameter	Unit	Results	Method Ref.
1	pH at Room Temperature	~	7.48	APHA 24th ed. 4500 H+B
2	Chemical Oxygen Demand	mg/L	825	APHA 24th ed. 5220 B
3	Ammonical Nitrogen	mg/L	BDL	APHA 24th ed. 4500 NH3C
4	Total Dissolved Solids Dried at 180°C	mg/L	22006	APHA 24th ed. 2540 C
5	Total Suspended Solids Dried from 103-105°C	mg/L	57	APHA 24th ed. 2540 D

Note: Joint Analysis will be entertained within 15 days from the date of sampling

Abbreviation: BDL – Below Detection Limit

Any addition to , deviations, or exclusions from the method : Not Applicable

Remarks :

Terms and conditions governing the test report issued

1. Sample is drawn by Narmada Clean Tech ; the results are applicable only to the Received samples from Customer.
2. The test report shall not be reproduced in full or part without the written approval of the Analytical Laboratory Narmada Clean Tech.
3. The test report in full or part shall not be used for promotional or publicity purpose without the written consent of Analytical Laboratory Narmada Clean Tech.
4. Waste water samples shall be stored for the period of Fifteen days after the date of issue of Report.

For Narmada Clean Tech

Twinkle Modi

Authorized By

Twinkle Modi
Sr. Executive QCD

End of Report

Format No. F/OPN/01/01 Issue no. 01 Issue date 01/04/2022 Rev no. 01 Rev date : 02/04/2024 Page 1 Of 1

Surti Bhagor, Nr. Gujarat Gas Office, Umarwada Road, Ankleshwar-393 001, Dist. Bharuch (Gujarat)

Tele : 8469745285, Email : info@nctc.co.in; website : www.nctc.co.in, CIN : U140101GJ2000NPL037236



AnyScanner



Analytical Laboratory
NARMADA CLEAN TECH
(A Subsidiary of GIDC)



Report No : NCT/MIAR/2026/MAR/N-818

Issue Date : 29/03/2026

URL No. : TC1159826000023909F

To :

ENVIRO TECHNOLOGY LIMITED

Plot No: 2413/14, GIDC ESTATE

ANKLESHWAR 393 002.

TEST REPORT

Kindly find here with the Test report.

Sample Description:	Waste Water	Sample Quantity:	750 ml
Sampling Location:	Free flow sample from Final Discharge Point	Sample Received Date:	28/03/2026
Sample Received By:	Mr. Upendra Rout	Sampling Plan & Procedure:	N.A.
Packing Details:	Preserved (250ml) and Unpreserved (500ml) sample in Plastic bottle	Analysis Start Date:	28/03/2026
Customer Sample Id	N-1	Analysis Completion Date:	28/03/2026
Sampling Start Date & Time:	27/03/2026 & 13:27	Sampling done By:	NCT Monitoring Team

Sr No.	Parameter	Unit	Results	Method Ref.
1	pH at Room Temperature	~	7.28	APHA 24th ed. 4500 H+B
2	Chemical Oxygen Demand	mg/L	806	APHA 24th ed. 5220 B
3	Ammonical Nitrogen	mg/L	BDL	APHA 24th ed. 4500 NH3C
4	Total Dissolved Solids Dried at 180°C	mg/L	22924	APHA 24th ed. 2540 C
5	Total Suspended Solids Dried from 103-105°C	mg/L	56	APHA 24th ed. 2540 D

Note: Joint Analysis will be entertained within 15 days from the date of sampling

Abbreviation: BDL – Below Detection Limit

Any addition to , deviations, or exclusions from the method : Not Applicable

Remarks :

Terms and conditions governing the test report issued

1. Sample is drawn by Narmada Clean Tech ; the results are applicable only to the Received samples from Customer.
2. The test report shall not be reproduced in full or part without the written approval of the Analytical Laboratory Narmada Clean Tech.
3. The test report in full or part shall not be used for promotional or publicity purpose without the written consent of Analytical Laboratory Narmada Clean Tech.
4. Waste water samples shall be stored for the period of Fifteen days after the date of issue of Report.

For Narmada Clean Tech

Modi Twinkle N.

Authorized By

Twinkle Modi
Sr. Executive QCD

----- End of Report -----

Format No. F/OPN/01/01 Issue no. 01 Issue date 01/04/2022 Rev no. 01 Rev date : 02/04/2024 Page 1 Of 2

Surti Bhagor, Nr. Gujarat Gas Office, Umarwada Road, Ankleshwar-393 001, Dist. Bharuch (Gujarat)
Tele : 8469745285, Email : info@nctc.co.in; website : www.nctc.co.in, CIN : U140101GJ2000NPL037236



AnyScanner



Analytical Laboratory
NARMADA CLEAN TECH
(A Subsidiary of GIDC)



Report No : NCT/MIAR/2026/MAR/N-829

Issue Date : 29/03/2026

URL No. : TC1159826000023920F

To :

ENVIRO TECHNOLOGY LIMITED

Plot No: 2413/14, GIDC ESTATE

ANKLESHWAR 393 002.

TEST REPORT

Kindly find here with the Test report.

Sample Description:	Waste Water	Sample Quantity:	750 ml
Sampling Location:	Sample collected from Autosampler	Sample Received Date:	28/03/2026
Sample Received By:	Mr. Upendra Rout	Sampling Plan & Procedure:	N.A.
Packing Details:	Preserved (250ml) and Unpreserved (500ml) sample in Plastic bottle	Analysis Start Date:	28/03/2026
Customer Sample Id	N-12	Analysis Completion Date:	28/03/2026
Sampling Start Date & Time:	27/03/2026 & 18:04	Sampling done By:	NCT Monitoring Team

Sr No.	Parameter	Unit	Results	Method Ref.
1	pH at Room Temperature	~	7.83	APHA 24th ed. 4500 H+B
2	Chemical Oxygen Demand	mg/L	822	APHA 24th ed. 5220 B
3	Ammonical Nitrogen	mg/L	BDL	APHA 24th ed. 4500 NH3C
4	Total Dissolved Solids Dried at 180°C	mg/L	22784	APHA 24th ed. 2540 C
5	Total Suspended Solids Dried from 103-105°C	mg/L	54	APHA 24th ed. 2540 D

Note: Joint Analysis will be entertained within 15 days from the date of sampling

Abbreviation: BDL – Below Detection Limit

Any addition to , deviations, or exclusions from the method : Not Applicable

Remarks :

Terms and conditions governing the test report issued

1. Sample is drawn by Narmada Clean Tech ; the results are applicable only to the Received samples from Customer.
2. The test report shall not be reproduced in full or part without the written approval of the Analytical Laboratory Narmada Clean Tech.
3. The test report in full or part shall not be used for promotional or publicity purpose without the written consent of Analytical Laboratory Narmada Clean Tech.
4. Waste water samples shall be stored for the period of Fifteen days after the date of issue of Report.

For Narmada Clean Tech

Twinkle Modi

Authorized By

Twinkle Modi
Sr. Executive QCD

End of Report

Format No. F/OPN/01/01 Issue no. 01 Issue date 01/04/2022 Rev no. 01 Rev date : 02/04/2024 Page 2 Of 2

Surti Bhagor, Nr. Gujarat Gas Office, Umarwada Road, Ankleshwar-393 001, Dist. Bharuch (Gujarat)
Tele : 8469745285, Email : info@nctc.co.in; website : www.nctc.co.in, CIN : U140101GJ2000NPL037236



AnyScanner



National Accreditation Board for
Testing and Calibration Laboratories

CERTIFICATE OF ACCREDITATION

**ANALYTICAL LABORATORY, ENVIRO TECHNOLOGY
LIMITED**

has been assessed and accredited in accordance with the standard

ISO/IEC 17025:2017

**"General Requirements for the Competence of Testing &
Calibration Laboratories"**

for its facilities at

PLOT NO.2413/14, GIDC ESTATE, ANKLESHWAR, BHARUCH, GUJARAT, INDIA

in the field of

TESTING

Certificate Number: TC-5466

Issue Date: 14/03/2025

Valid Until: 13/03/2029

This certificate remains valid for the Scope of Accreditation as specified in the annexure subject to continued satisfactory compliance to the above standard & the relevant requirements of NABL.
(To see the scope of accreditation of this laboratory, you may also visit NABL website www.nabl-india.org)

Name of Legal Entity: ENVIRO TECHNOLOGY LIMITED

Signed for and on behalf of NABL




Anuja Anand
Director


N. Venkateswaran
Chief Executive Officer

ANNEXURE-1(C)

SRICT

SRICT ENVIRONMENTAL LABORATORY

(SHROFF S R ROTARY INSTITUTE OF CHEMICAL TECHNOLOGY)
(Managed by ANKLESHWAR ROTARY EDUCATIONAL SOCIETY)

(Block No. 402, At & Post: Vataria, Ta: Valia, Dist.: Bharuch, Pin code: 393135. Phone No.:02643-290825)



TC-13941

Page 1 of 1

Group : Waste Water
Discipline : Chemical

ULR No. : TC1394125000000435F

TEST REPORT

Customer's Name & Address: M/s. Enviro Technology Ltd Plot no. 2413/14, GIDC Estate, Ankleshwar, Dist: Bharuch. Contact Person: Mr. Dipak Meghapara	Report No : SEL/20251017/A-001 Issue Date : 29/10/2025
---	---

Lab Id Code	:	SRJCT/20251017/A-001			
Sample Description	:	Final O/L-001	Purpose	:	Testing
Date of Sample Received	:	17/10/2025	Test parameter	:	As mentioned by customer
Date of Starting Analysis	:	17/10/2025	Quantity	:	2 Lit
Date of Completion Analysis	:	29/10/2025	Packed/Seal	:	Sealed

Sr. No.	Parameter	Unit	Result	Acceptable Criteria	Test Method
1	pH	--	7.6	6.5 to 8.5	IS:3025(Part-11)2022
2	Total Suspended Solids	mg/L	132	150	IS:3025(Part-17)2022
3	Total Dissolved Solid	mg/L	20125	10000	IS:3025(Part-16)2023
4	COD	mg/L	810	1000	IS:3025(Part-58)2023
5	Total Phenol	mg/L	0.59	5	APHA 5530-D, 23 rd Ed.:2017
6	Ammonical Nitrogen	mg/L	33.6	50	IS:3025(Part-34/Section 1)2023
7	Chloride	mg/L	9358.09	1000	IS:3025(Part-32)1988

Note: Results shown in Bold are found above Permissible Limit.

Terms and conditions governing the test report issued

1. Sample is not drawn by SEL; the results are applicable only to the drawn samples.
2. The test report shall not be reproduced in full or part without the written approval of the SRICT Environmental Laboratory.
3. The test report in full or part shall not be used for promotional or publicity purpose without the written consent of SRICT Environmental Laboratory.
4. Water/Waste water samples shall be stored for the period of one month after the date of issue of Report.

END OF REPORTFor, SRICT Environmental Laboratory
Authorized Signatory

Dr. Snehal Lokhandwala
(Quality Manager)

Block No:402, At: Vataria, Ankleshwar-Valia Road, Ta: Valia, Dist: Bharuch
Phone No:02643-290825,9712177799, Mo: 9727745875/876 E-mail:hr.srict@gmail.com, www.srict.in

Group : Waste Water
Discipline : Chemical

TEST REPORT

Customer's Name & Address: M/s. Enviro Technology Ltd Plot no. 2413/14, GIDC Estate, Ankleshwar, Dist: Bharuch. Contact Person: Mr. Dipak Meghapara	Report No : SEL/20251017/A-001 Issue Date : 29/10/2025
---	---

Lab Id Code	:	SRICT/20251017/A-001			
Sample Description	:	Final O/L-001	Purpose	:	Testing
Date of Sample Received	:	17/10/2025	Test parameter	:	As mentioned by customer
Date of Starting Analysis	:	17/10/2025	Quantity	:	2 Lit
Date of Completion Analysis	:	29/10/2025	Packed/Seal	:	Sealed

Sr. No.	Parameter	Unit	Result	Permissible Limit (If Applicable)	Test Method
1	Temperature	°C	26	40	APHA 2550,23 rd Ed:2017
2	BOD	mg/L	14	200	IS:3025(Part-44)2023
3	Total Kjeldahl Nitrogen	mg/L	44.24	50	APHA-4500-N _{org} -B,23 rd Ed:2017
4	Phosphate	mg/L	5.35	5	IS3025(P-31):1988
5	Cyanide	mg/L	< 0.1	0.2	APHA 4500-B,23 rd Ed:2017
6	Fluorides	mg/L	7.01	15	APHA 4500-F-D,23 rd Ed:2017
7	Oil & Grease	mg/L	< 2.0	10	APHA 5520-B,23 rd Ed.:2017
8	Sulphide	mg/L	< 1.0	5	APHA 4500-S-2-F,23 rd Ed.:2017
9	Hexavalent Chromium	mg/L	< 0.1	0.1	APHA 3500Cr-B,23 rd Ed:2017
10	Total Chromium	mg/L	0.4	2	APHA 3111-B,23 rd Ed:2017
11	Copper	mg/L	1.06	3	APHA 3111-CU-B,23 rd Ed:2017
12	Nickel	mg/L	0.24	3	APHA 3111-Ni-B,23 rd Ed:2017
13	Zinc	mg/L	2.56	15	APHA 3111-Zn-B,23 rd Ed:2017
14	Iron	mg/L	1.15	3	IS:3025(Part-53)2024
15	Manganese	mg/L	0.37	2	APHA 3111-A,23 rd Ed:2017
16	Mercury	mg/L	< 0.001	0.01	APHA 3112-Hg-B,23 rd Ed:2017
17	Lead	mg/L	< 0.05	0.1	APHA 3111-Pb-B,23 rd Ed:2017
18	Arsenic	mg/L	< 0.005	0.2	APHA 3111-AS-B,23 rd Ed:2017
19	Vanadium	mg/L	< 0.1	0.2	APHA 3500-V-B,23 rd Ed:2017
20	Cadmium	mg/L	< 0.02	0.05	APHA 3111-Cd B,23 rd Ed:2017
21	Selenium	mg/L	< 0.004	0.05	APHA 3500-Se,B-C,23 rd Ed:2017
22	Color	Hazen	8236	100	APHA 2120-C,23 rd Ed:2017
23	Sulphate	mg/L	3485	1000	APHA 4500-SO ₄ -E,23 rd Ed:2017
24	Insecticide/Pesticides	mg/L	Absent	Absent	Pesticides & Insecticides Ref. USEPA 508,525.2



SRICT ENVIRONMENTAL LABORATORY

(SHROFF S R ROTARY INSTITUTE OF CHEMICAL TECHNOLOGY)
(Managed by ANKLESHWAR ROTARY EDUCATIONAL SOCIETY)

(Block No. 402, At & Post: Vataria, Ta: Valia, Dist.: Bharuch, Pin code: 393135. Phone No.:02643-290825)

Page 2 of 2

Remark: Results shown in Bold are found above Permissible Limit.

Terms and conditions governing the test report issued

1. Sample is not drawn by SEL; the results are applicable only to the drawn samples.
2. The test report shall not be reproduced in full or part without the written approval of the SRICT Environmental Laboratory.
3. The test report in full or part shall not be used for promotional or publicity purpose without the written consent of SRICT Environmental Laboratory.
4. Water/Waste water samples shall be stored for the period of one month after the date of issue of Report.

END OF REPORT

For SRICT Environmental Laboratory
Authorized Signatory


Dr. Sheha Lekhandwala
(Quality Manager)



Group : Waste Water

ULR No. : TC1394125000000474F

Discipline : Chemical

TEST REPORT

Customer's Name & Address: M/s. Enviro Technology Ltd Plot no. 2413/14, GIDC Estate, Ankleshwar, Dist. Bharuch.		Report No. : SEL/20251113/A1-001	
Contact Person: Mr. Dipak Meghapara		Issue Date : 17/11/2025	
Lab ID Code	: SRICT/20251113/A1-001		
Sample Description	: Final O/L-001	Purpose	: Testing
Date of Sample Received	: 13/11/2025	Test parameter	: As mentioned by customer
Date of Starting Analysis	: 14/11/2025	Quantity	: 2 Lit
Date of Completion Analysis	: 17/11/2025	Packed/Seal	: Sealed

Sr. No.	Parameter	Unit	Result	Acceptable Criteria	Test Method
1	pH	--	7.98	6.5 to 8.5	IS:3025(Part-11)2022
2	Total Suspended Solids	mg/L	116	150	IS:3025(Part-17)2022
3	Total Dissolved Solid	mg/L	16593	10000	IS:3025(Part-16)2023
4	COD	mg/L	800	1000	IS:3025(Part-58)2023
5	Total Phenol	mg/L	0.14	5	APHA 5530-D, 23 rd Ed. 2017
6	Ammonical Nitrogen	mg/L	28	50	IS:3025(Part-34/Section 1)2023
7	Chloride	mg/L	9332.21	1000	IS:3025(Part-32)1988

Note: Results shown in Bold are found above Permissible Limit.

Terms and conditions governing the test report issued

1. Sample is not drawn by SEL; the results are applicable only to the drawn samples.
2. The test report shall not be reproduced in full or part without the written approval of the SRICT Environmental Laboratory.
3. The test report in full or part shall not be used for promotional or publicity purpose without the written consent of SRICT Environmental Laboratory.
4. Water/Waste water samples shall be stored for the period of one month after the date of issue of Report.

END OF REPORT

For, SRICT Environmental Laboratory

Authorized Signatory

Dr. Snehal Lokhandwala
(Quality Manager)

SRICT ENVIRONMENTAL LABORATORY

(SHROFF S R ROTARY INSTITUTE OF CHEMICAL TECHNOLOGY)

(Managed by ANKLESHWAR ROTARY EDUCATIONAL SOCIETY)

(Block No. 402, At & Post: Vataria, Ta: Valia, Dist.: Bharuch, Pin code: 393135. Phone No.:02643-290825)

Page 1 of 2

Group : Waste Water
Discipline : Chemical

TEST REPORT

Customer's Name & Address: M/s. Enviro Technology Ltd Plot no. 2413 14, GIDC Estate, Ankleshwar, Dist: Bharuch. Contact Person: Mr. Dipak Meghapara	Report No : SEL/20251113/A1-001 Issue Date : 17/11/2025
---	--

Lab Id Code	:	SRICT/20251113/A-001		
Sample Description	:	Final O/L-001	Purpose	: Testing
Date of Sample Received	:	13/11/2025	Test parameter	: As mentioned by customer
Date of Starting Analysis	:	14/11/2025	Quantity	: 2 Lit
Date of Completion Analysis	:	17/11/2025	Packed/Seal	: Sealed

Sr. No.	Parameter	Unit	Result	Permissible Limit (If Applicable)	Test Method
1	Temperature	°C	25	40	APHA 2550, 23 rd Ed:2017
2	BOD	mg/L	18	200	IS:3025(Part-44)2023
3	Total Kjeldahl Nitrogen	mg/L	33.6	50	APHA-4500-N, B, 23 rd Ed:2017
4	Phosphate	mg/L	2	5	IS3025(P-31):1988
5	Cyanide	mg/L	< 0.1	0.2	APHA 4500-B, 23 rd Ed:2017
6	Fluorides	mg/L	2.56	15	APHA 4500-F-D, 23 rd Ed:2017
7	Oil & Grease	mg/L	< 2.0	10	APHA 5520-B, 23 rd Ed:2017
8	Sulphide	mg/L	< 1.0	5	APHA 4500-S-2-F, 23 rd Ed:2017
9	Hexavalent Chromium	mg/L	< 0.1	0.1	APHA 3500Cr-B, 23 rd Ed:2017
10	Total Chromium	mg/L	0.19	2	APHA 3111-B, 23 rd Ed:2017
11	Copper	mg/L	0.66	3	APHA 3111-CU-B, 23 rd Ed:2017
12	Nickel	mg/L	0.082	3	APHA 3111-Ni-B, 23 rd Ed:2017
13	Zinc	mg/L	1.15	15	APHA 3111-Zn-B, 23 rd Ed:2017
14	Iron	mg/L	2.10	3	IS:3025(Part-53)2024
15	Manganese	mg/L	0.086	2	APHA 3111-A, 23 rd Ed:2017
16	Mercury	mg/L	< 0.001	0.01	APHA 3112-Hg-B, 23 rd Ed:2017
17	Lead	mg/L	< 0.05	0.1	APHA 3111-Pb-B, 23 rd Ed:2017
18	Arsenic	mg/L	< 0.005	0.2	APHA 3111-AS-B, 23 rd Ed:2017
19	Vanadium	mg/L	< 0.1	0.2	APHA 3500-V-B, 23 rd Ed:2017
20	Cadmium	mg/L	< 0.02	0.05	APHA 3111-Cd B, 23 rd Ed:2017
21	Selenium	mg/L	< 0.004	0.05	APHA 3500-Se, B-C, 23 rd Ed:2017
22	Color	Hazen	8934	100	APHA 2120-C, 23 rd Ed:2017
23	Sulphate	mg/L	2861	1000	APHA 4500-SO ₄ -E, 23 rd Ed:2017
24	Insecticide Pesticides	mg/L	Absent	Absent	Pesticides & Insecticides Ref, USEPA 508, 525.2

Remark: Results shown in Bold are found above Permissible Limit.

SRICT

SRICT ENVIRONMENTAL LABORATORY

(SHROFF S R ROTARY INSTITUTE OF CHEMICAL TECHNOLOGY)

(Managed by ANKLESHWAR ROTARY EDUCATIONAL SOCIETY)

(Block No. 402, At & Post: Vataria, Ta: Valia, Dist.: Bharuch, Pin code: 393135. Phone No.:02643-290825)

Page 2 of 2


Terms and conditions governing the test report issued

1. Sample is not drawn by SEL; the results are applicable only to the drawn samples.
2. The test report shall not be reproduced in full or part without the written approval of the SRICT Environmental Laboratory.
3. The test report in full or part shall not be used for promotional or publicity purpose without the written consent of SRICT Environmental Laboratory.
4. Water Waste water samples shall be stored for the period of one month after the date of issue of Report.

END OF REPORT

For SRICT Environmental Laboratory

Authorized Signatory


Dr. Snehal Lokhandwala
(Quality Manager)

SRICT

SRICT ENVIRONMENTAL LABORATORY

(SHROFF S R ROTARY INSTITUTE OF CHEMICAL TECHNOLOGY)

(Managed by ANKLESHWAR ROTARY EDUCATIONAL SOCIETY)

(Block No. 402, At & Post: Vataria, Ta: Valia, Dist.: Bharuch, Pin code: 393135. Phone No.:02643-290825)



TC-13941

Page 1 of 1

Group : Waste Water
Discipline : Chemical

ULR No. : TC139412500000508F

TEST REPORT

Customer's Name & Address: M/s. Enviro Technology Ltd Plot no. 2426/14, GIDC Estate, Ankleshwar, Dist: Bharuch. Contact Person: Mr. Dipak Meghapara				Report No : SEL/20251203/A1-001 Issue Date : 06/12/2025	
Lab Id Code		: SRICT/20251203/A1-001			
Sample Description		: Final O/L-001	Purpose	: Testing	
Date of Sample Received		: 03/12/2025	Test parameter	: As mentioned by customer	
Date of Starting Analysis		: 03/12/2025	Quantity	: 2 Lit	
Date of Completion Analysis		: 06/12/2025	Packed/Seal	: Sealed	

Sr. No.	Parameter	Unit	Result	Acceptable Criteria	Test Method
1	pH	--	7.2	6.5 to 8.5	IS:3025(Part-11)2022
2	Total Suspended Solids	mg/L	105	150	IS:3025(Part-17)2022
3	Total Dissolved Solid	mg/L	15826	10000	IS:3025(Part-16)2023
4	COD	mg/L	798.4	1000	IS:3025(Part-58)2023
5	Total Phenol	mg/L	0.29	5	APHA 5530-D, 23 rd Ed.:2017
6	Ammonical Nitrogen	mg/L	27.44	50	IS:3025(Part-34/Section 1)2023
7	Chloride	mg/L	9318.58	1000	IS:3025(Part-32)1988


Note: Results shown in Bold are found above Permissible Limit.

Terms and conditions governing the test report issued

1. Sample is not drawn by SEL; the results are applicable only to the drawn samples.
2. The test report shall not be reproduced in full or part without the written approval of the SRICT Environmental Laboratory.
3. The test report in full or part shall not be used for promotional or publicity purpose without the written consent of SRICT Environmental Laboratory.
4. Water/Waste water samples shall be stored for the period of one month after the date of issue of Report.

END OF REPORT

For, SRICT Environmental Laboratory
Authorized Signatory


Dr. Snehal Lokhandwala
(Quality Manager)

Block No:402, At: Vataria, Ankleshwar-Valia Road, Ta: Valia, Dist: Bharuch
Phone No:02643-290825,9712177799, Mo: 9727745875/876 E-mail:hr.srict@gmail.com, www.srict.in

SRICT ENVIRONMENTAL LABORATORY

(SHROFF S R ROTARY INSTITUTE OF CHEMICAL TECHNOLOGY)

(Managed by ANKLESHWAR ROTARY EDUCATIONAL SOCIETY)

(Block No. 402, At & Post: Vataria, Ta: Valia, Dist.: Bharuch, Pin code: 393135. Phone No.:02643-290825)

Page 1 of 2

Group : Waste Water

Discipline : Chemical

TEST REPORT

Customer's Name & Address: M/s. Enviro Technology Ltd Plot no. 2426/14, GIDC Estate, Ankleshwar, Dist: Bharuch. Contact Person: Mr. Dipak Meghapara	Report No : SEL/20251203/A1-001 Issue Date : 06/12/2025
---	--

Lab Id Code	:	SRJCT/20251203/A-001			
Sample Description	:	Final O/L-001	Purpose	:	Testing
Date of Sample Received	:	03/12/2025	Test parameter	:	As mentioned by customer
Date of Starting Analysis	:	03/12/2025	Quantity	:	2 Lit
Date of Completion Analysis	:	06/12/2025	Packed/Seal	:	Sealed

Sr. No.	Parameter	Unit	Result	Permissible Limit (If Applicable)	Test Method
1	Temperature	°C	25	40	APHA 2550, 23 rd Ed:2017
2	BOD	mg/L	18	200	IS:3025(Part-44)2023
3	Total Kjeldahl Nitrogen	mg/L	34.16	50	APHA-4500-N _{total} -B, 23 rd Ed:2017
4	Phosphate	mg/L	1.28	5.0	IS3025(P-31):1988
5	Cyanide	mg/L	< 0.1	0.2	APHA 4500-B, 23 rd Ed:2017
6	Fluorides	mg/L	3	15	APHA 4500-F-D, 23 rd Ed:2017
7	Oil & Grease	mg/L	< 2.0	10	APHA 5520-B, 23 rd Ed.:2017
8	Sulphide	mg/L	< 1.0	5.0	APHA 4500-S-2-F, 23 rd Ed.:2017
9	Hexavalent Chromium	mg/L	< 0.1	0.1	APHA 3500Cr-B, 23 rd Ed:2017
10	Total Chromium	mg/L	< 0.5	2.0	APHA 3111-B, 23 rd Ed:2017
11	Copper	mg/L	0.23	3.0	APHA 3111-CU-B, 23 rd Ed:2017
12	Nickel	mg/L	0.085	3.0	APHA 3111-Ni-B, 23 rd Ed:2017
13	Zinc	mg/L	1	15	APHA 3111-Zn-B, 23 rd Ed:2017
14	Iron	mg/L	1.94	3.0	IS:3025(Part-53)2024
15	Manganese	mg/L	0.062	2.0	APHA 3111-A, 23 rd Ed:2017
16	Mercury	mg/L	< 0.01	0.01	APHA 3112-Hg-B, 23 rd Ed:2017
17	Lead	mg/L	< 0.5	0.1	APHA 3111-Pb-B, 23 rd Ed:2017
18	Arsenic	mg/L	< 0.01	0.2	APHA 3111-AS-B, 23 rd Ed:2017
19	Vanadium	mg/L	< 5.0	0.2	APHA 3500-V-B, 23 rd Ed:2017
20	Cadmium	mg/L	< 0.1	0.05	APHA 3111-Cd B, 23 rd Ed:2017
21	Selenium	mg/L	< 0.01	0.05	APHA 3500-Se, B-C, 23 rd Ed:2017
22	Color	Hazen	8930	100	APHA 2120-C, 23 rd Ed:2017
23	Sulphate	mg/L	2846	1000	APHA 4500-SO ₄ -E, 23 rd Ed:2017
24	Insecticide Pesticides	mg/L	Absent	Absent	Pesticides & Insecticides Ref, USEPA 508,525.2

Remark: Results shown in Bold are found above Permissible Limit.

SRICT

SRICT ENVIRONMENTAL LABORATORY

(SHROFF S R ROTARY INSTITUTE OF CHEMICAL TECHNOLOGY)

(Managed by ANKLESHWAR ROTARY EDUCATIONAL SOCIETY)

(Block No. 402, At & Post: Vataria, Ta: Valia, Dist.: Bharuch, Pin code: 393135. Phone No.:02643-290825)


Page 2 of 2

Terms and conditions governing the test report issued

1. Sample is not drawn by SEL; the results are applicable only to the drawn samples.
2. The test report shall not be reproduced in full or part without the written approval of the SRICT Environmental Laboratory.
3. The test report in full or part shall not be used for promotional or publicity purpose without the written consent of SRICT Environmental Laboratory.
4. Water/Waste water samples shall be stored for the period of one month after the date of issue of Report.

END OF REPORT

For SRICT Environmental Laboratory
Authorized Signatory


Dr. Sneha Lokhandwala
(Quality Manager)

SRICT

SRICT ENVIRONMENTAL LABORATORY



(SHROFF S R ROTARY INSTITUTE OF CHEMICAL TECHNOLOGY)

(Managed by ANKLESHWAR ROTARY EDUCATIONAL SOCIETY)

(Block No. 402, At & Post: Vataria, Ta: Valia, Dist.: Bharuch, Pin code: 393135. Phone No.:02643-290825)

TC-13941

Page 1 of 1

Group : Waste Water

Discipline : Chemical

ULR No. : TC1394126000000001F

TEST REPORT

Customer's Name & Address: M/s. Enviro Technology Ltd Plot no. 2426/14, GIDC Estate, Ankleshwar, Dist: Bharuch. Contact Person: Mr. Dipak Meghapara	Report No : SEL/20260101/A1-001 Issue Date : 06/01/2026
---	--

Contact Person: Mr. Dipak Meghapara			Issue Date: 01/01/2026		
Lab Id Code	:	SRIC/20260101/A1-001			
Sample Description	:	Final O/L-001	Purpose	:	Testing
Date of Sample Received	:	01/01/2026	Test parameter	:	As mentioned by customer
Date of Starting Analysis	:	02/01/2026	Quantity	:	2 Lit
Date of Completion Analysis	:	05/01/2026	Packed/Seal	:	Sealed

Sr. No.	Parameter	Unit	Result	Acceptable Criteria	Test Method
1	pH	--	7.6	6.5 to 8.5	IS:3025(Part-11):2022
2	Total Suspended Solids	mg/L	98	150	IS:3025(Part-17):2022
3	Total Dissolved Solid	mg/L	15825	10000	IS:3025(Part-16):2023
4	COD	mg/L	840	1000	IS:3025(Part-58):2023
5	Total Phenol	mg/L	0.2	5	APHA 5530-D, 23 rd Ed.:2017
6	Ammonical Nitrogen	mg/L	29.68	50	IS:3025(Part-34/Section 1):2023
7	Chloride	mg/L	9358.09	1000	IS:3025(Part-32):2025

Note: Results shown in Bold are found above Permissible Limit.

Terms and conditions governing the test report issued

1. Sample is not drawn by SEL; the results are applicable only to the drawn samples.
2. The test report shall not be reproduced in full or part without the written approval of the SRICT Environmental Laboratory.
3. The test report in full or part shall not be used for promotional or publicity purpose without the written consent of SRICT Environmental Laboratory.
4. Water/Waste water samples shall be stored for the period of one month after the date of issue of Report.

END OF REPORTFor, SRICT Environmental Laboratory
Authorized Signatory

Dr. Snehal Lokhandwala
(Quality Manager)

Block No:402, At: Vataria, Ankleshwar-Valia Road, Ta: Valia, Dist: Bharuch
Phone No:02643-290825,9712177799, Mo: 9727745875/876 E-mail:hr.srict@gmail.com, www.srict.in



AnyScanner

SRICT

SRICT ENVIRONMENTAL LABORATORY

(SHROFF S R ROTARY INSTITUTE OF CHEMICAL TECHNOLOGY)
 (Managed by ANKLESHWAR ROTARY EDUCATIONAL SOCIETY)
 (Block No. 402, At & Post: Vataria, Ta: Valia, Dist.: Bharuch, Pin code: 393135. Phone No.:02643-290825)

Page 1 of 2

Group : Waste Water
 Discipline : Chemical

TEST REPORT

TEST REPORT

Customer's Name & Address: M/s. Enviro Technology Ltd Plot no. 2426/14, GIDC Estate, Ankleshwar, Dist: Bharuch. Contact Person: Mr. Dipak Meghapara			Report No : SEL/20260101/A1-001			
			Issue Date : 06/01/2026			
Lab Id Code		:	SRICT/20260101/A1-001			
Sample Description		:	Final O/L-001	Purpose	:	Testing
Date of Sample Received		:	01/01/2026	Test parameter	:	As mentioned by customer
Date of Starting Analysis		:	02/01/2026	Quantity	:	2 Lit
Date of Completion Analysis		:	05/01/2026	Packed/Seal	:	Sealed

Sr. No.	Parameter	Unit	Result	Permissible Limit (If Applicable)	Test Method
1	Temperature	°C	23.9	40	APHA 2550, 23 rd Ed:2017
2	BOD	mg/L	21	200	IS:3025(Part-44)2023
3	Total Kjeldahl Nitrogen	mg/L	37.52	50	APHA-4500-N _{org} -B, 23 rd Ed:2017
4	Phosphate	mg/L	0.82	5.0	IS3025(P-31):1988
5	Cyanide	mg/L	< 0.1	0.2	APHA 4500-B, 23 rd Ed:2017
6	Fluorides	mg/L	2.01	15	APHA 4500-F-D, 23 rd Ed:2017
7	Oil & Grease	mg/L	< 2.0	10	APHA 5520-B, 23 rd Ed:2017
8	Sulphide	mg/L	< 1.0	5.0	APHA 4500-S-2-F, 23 rd Ed:2017
9	Hexavalent Chromium	mg/L	< 0.1	0.1	APHA 3500Cr-B, 23 rd Ed:2017
10	Total Chromium	mg/L	< 0.5	2.0	APHA 3111-B, 23 rd Ed:2017
11	Copper	mg/L	0.19	3.0	APHA 3111-CU-B, 23 rd Ed:2017
12	Nickel	mg/L	0.09	3.0	APHA 3111-Ni-B, 23 rd Ed:2017
13	Zinc	mg/L	1.03	15	APHA 3111-Zn-B, 23 rd Ed:2017
14	Iron	mg/L	0.69	3.0	IS:3025(Part-53)2024
15	Manganese	mg/L	0.08	2.0	APHA 3111-A, 23 rd Ed:2017
16	Mercury	mg/L	< 0.01	0.01	APHA 3112-Hg-B, 23 rd Ed:2017
17	Lead	mg/L	< 0.5	0.1	APHA 3111-Pb-B, 23 rd Ed:2017
18	Arsenic	mg/L	< 0.01	0.2	APHA 3111-AS-B, 23 rd Ed:2017
19	Vanadium	mg/L	< 5.0	0.2	APHA 3500-V-B, 23 rd Ed:2017
20	Cadmium	mg/L	< 0.1	0.05	APHA 3111-Cd B, 23 rd Ed:2017
21	Selenium	mg/L	< 0.01	0.05	APHA 3500-Se, B-C, 23 rd Ed:2017
22	Color	Hazen	9223	100	APHA 2120-C, 23 rd Ed:2017
23	Sulphate	mg/L	2541	1000	APHA 4500-SO ₄ -E, 23 rd Ed:2017
24	Insecticide/Pesticides	mg/L	Absent	Absent	Pesticides & Insecticides Ref, USEPA 508,525.2

Remark: Results shown in Bold are found above Permissible Limit.

SRICT

SRICT ENVIRONMENTAL LABORATORY

(SHROFF S R ROTARY INSTITUTE OF CHEMICAL TECHNOLOGY)
(Managed by ANKLESHWAR ROTARY EDUCATIONAL SOCIETY)

(Block No. 402, At & Post: Vataria, Ta: Valia, Dist.: Bharuch, Pin code: 393135. Phone No.:02643-290825)


Page 2 of 2

Terms and conditions governing the test report issued

1. Sample is not drawn by SEL; the results are applicable only to the drawn samples.
2. The test report shall not be reproduced in full or part without the written approval of the SRICT Environmental Laboratory.
3. The test report in full or part shall not be used for promotional or publicity purpose without the written consent of SRICT Environmental Laboratory.
4. Water/Waste water samples shall be stored for the period of one month after the date of issue of Report.

END OF REPORT

For SRICT Environmental Laboratory
Authorized Signatory


Dr. Snehal Lokhandwala
(Quality Manager)



Group : Waste Water
Discipline : Chemical

ULR No. : TC139412600000060F

TEST REPORT

Customer's Name & Address: M/s. Enviro Technology Ltd Plot no. 2426/14, GIDC Estate, Ankleshwar, Dist: Bharuch. Contact Person: Mr. Dipak Meghapara	Report No : SEL/20260212/A1-001 Issue Date : 18/02/2026
---	--

Lab Id Code	:	SRICT/20260212/A1-001			
Sample Description	:	Final O/L-001	Purpose	:	Testing
Date of Sample Received	:	12/02/2026	Test parameter	:	As mentioned by customer
Date of Starting Analysis	:	13/02/2026	Quantity	:	2 Lit
Date of Completion Analysis	:	17/02/2026	Packed/Seal	:	Sealed

Sr. No.	Parameter	Unit	Result	Acceptable Criteria	Test Method
1	pH	--	6.9	6.5 to 8.5	IS:3025(Part-11)2022
2	Total Suspended Solids	mg/L	101	150	IS:3025(Part-17)2022
3	Total Dissolved Solid	mg/L	16285	10000	IS:3025(Part-16)2023
4	COD	mg/L	798.4	1000	IS:3025(Part-58)2023
5	Total Phenol	mg/L	0.15	5	APHA 5530-D, 23 rd Ed.:2017
6	Ammonical Nitrogen	mg/L	29.12	50	IS:3025(Part-34/Section 1)2023
7	Chloride	mg/L	9263.08	1000	IS:3025(Part-32):2025

Note: Results shown in Bold are found above Permissible Limit.

Terms and conditions governing the test report issued

1. Sample is not drawn by SEL; the results are applicable only to the drawn samples.
2. The test report shall not be reproduced in full or part without the written approval of the SRICT Environmental Laboratory.
3. The test report in full or part shall not be used for promotional or publicity purpose without the written consent of SRICT Environmental Laboratory.
4. Water/Waste water samples shall be stored for the period of one month after the date of issue of Report.

END OF REPORT

For, SRICT Environmental Laboratory
Authorized Signatory

Dr. Snehal Lokhandwala
(Quality Manager)

Block No:402, At: Vataria, Ankleshwar-Valia Road, Ta: Valia, Dist: Bharuch
Phone No:02643-290825,9712177799, Mo: 9727745875/876 E-mail:hr.srict@gmail.com, www.srict.in

Group : Waste Water
Discipline : Chemical

TEST REPORT

Customer's Name & Address: M/s. Enviro Technology Ltd Plot no. 2426/14, GIDC Estate, Ankleshwar, Dist: Bharuch. Contact Person: Mr. Dipak Meghapara	Report No : SEL/20260212/A1-001 Issue Date : 18/02/2026
---	--

Lab Id Code	:	SRICT/20260212/A1-001			
Sample Description	:	Final O/L-001	Purpose	:	Testing
Date of Sample Received	:	12/02/2026	Test parameter	:	As mentioned by customer
Date of Starting Analysis	:	13/02/2026	Quantity	:	2 Lit
Date of Completion Analysis	:	17/02/2026	Packed/Seal	:	Sealed

Sr. No.	Parameter	Unit	Result	Permissible Limit (If Applicable)	Test Method
1	Temperature	°C	26	40	APHA 2550,23 rd Ed:2017
2	BOD	mg/L	18	200	IS:3025(Part-44)2023
3	Total Kjeldahl Nitrogen	mg/L	36.4	50	APHA-4500-N _{org} -B,23 rd Ed:2017
4	Phosphate	mg/L	0.65	5.0	IS3025(P-31):1988
5	Cyanide	mg/L	< 0.1	0.2	APHA 4500-B,23 rd Ed:2017
6	Fluorides	mg/L	2.03	15	APHA 4500-F-D,23 rd Ed:2017
7	Oil & Grease	mg/L	< 2.0	10	APHA 5520-B,23 rd Ed.:2017
8	Sulphide	mg/L	< 1.0	5.0	APHA 4500-S-2-F,23 rd Ed.:2017
9	Hexavalent Chromium	mg/L	< 0.1	0.1	APHA 3500Cr-B,23 rd Ed:2017
10	Total Chromium	mg/L	< 0.5	2.0	APHA 3111-B,23 rd Ed:2017
11	Copper	mg/L	0.16	3.0	APHA 3111-CU-B,23 rd Ed:2017
12	Nickel	mg/L	0.07	3.0	APHA 3111-Ni-B,23 rd Ed:2017
13	Zinc	mg/L	1.06	15	APHA 3111-Zn-B,23 rd Ed:2017
14	Iron	mg/L	0.78	3.0	IS:3025(Part-53)2024
15	Manganese	mg/L	0.08	2.0	APHA 3111-A,23 rd Ed:2017
16	Mercury	mg/L	< 0.01	0.01	APHA 3112-Hg-B,23 rd Ed:2017
17	Lead	mg/L	< 0.5	0.1	APHA 3111-Pb-B,23 rd Ed:2017
18	Arsenic	mg/L	< 0.01	0.2	APHA 3111-AS-B,23 rd Ed:2017
19	Vanadium	mg/L	< 5.0	0.2	APHA 3500-V-B,23 rd Ed:2017
20	Cadmium	mg/L	< 0.1	0.05	APHA 3111-Cd B,23 rd Ed:2017
21	Selenium	mg/L	< 0.01	0.05	APHA 3500-Se,B-C,23 rd Ed:2017
22	Color	Hazen	9275	100	APHA 2120-C,23 rd Ed:2017
23	Sulphate	mg/L	2632	1000	APHA 4500-SO ₄ -E,23 rd Ed:2017
24	Insecticide/Pesticides	mg/L	Absent	Absent	Pesticides & Insecticides Ref,USEPA 508,525.2

Remark: Results shown in Bold are found above Permissible Limit.

SRICT

SRICT ENVIRONMENTAL LABORATORY

(SHROFF S R ROTARY INSTITUTE OF CHEMICAL TECHNOLOGY)

(Managed by ANKLESHWAR ROTARY EDUCATIONAL SOCIETY)

(Block No. 402, At & Post: Vatarin, Tal: Vatin, Dist: Bharuch, Pin code: 393115, Phone No. 02663-291825)

Page 2 of 2

Terms and conditions governing the test report issued

1. Sample is not drawn by SEL, the results are applicable only to the drawn samples.
2. The test report shall not be reproduced in full or part without the written approval of the SRICT Environmental Laboratory.
3. The test report in full or part shall not be used for promotional or publicity purpose without the written consent of SRICT Environmental Laboratory.
4. Water & air water samples shall be stored for the period of one month after the date of issue of Report.

END OF REPORT

For SRICT Environmental Laboratory

Authorized Signatory

Dr. Shalini K. Chatterjee
(Quality Manager)

SRICT

SRICT ENVIRONMENTAL LABORATORY

(SHROFF S R ROTARY INSTITUTE OF CHEMICAL TECHNOLOGY)

(Managed by ANKLESHWAR ROTARY EDUCATIONAL SOCIETY)

(Block No. 402, At & Post: Vataria, Ta: Valia, Dist.: Bharuch, Pin code: 393135. Phone No.:02643-290825)



TC-13941

Page 1 of 1

Group : Waste Water
Discipline : Chemical

ULR No. : TC139412600000118F

TEST REPORT

Customer's Name & Address: M/s. Enviro Technology Ltd Plot no. 2426 14, GIDC Estate, Ankleshwar, Dist: Bharuch. Contact Person: Mr. Dipak Meghapara	Report No : SEL/20260313/A1-001 Issue Date : 19/03/2026
---	--

Contact Person: Mr. Dipak Meghapara			Issue Date: 19/03/2026		
Lab Id Code	:	SRICT/20260313/A1-001			
Sample Description	:	Final O/L-001	Purpose	:	Testing
Date of Sample Received	:	13/03/2026	Test parameter	:	As mentioned by customer
Date of Starting Analysis	:	16/03/2026	Quantity	:	2 Lit
Date of Completion Analysis	:	19/03/2026	Packed/Seal	:	Sealed

Sr. No.	Parameter	Unit	Result	Acceptable Criteria	Test Method
1	pH	--	6.8	6.5 to 8.5	IS:3025(Part-11)2022
2	Total Suspended Solids	mg/L	98	150	IS:3025(Part-17)2022
3	Total Dissolved Solid	mg/L	15362	10000	IS:3025(Part-16)2023
4	COD	mg/L	792	1000	IS:3025(Part-58)2023
5	BOD	mg/L	21	200	IS:3025(Part-44)2023
6	Total Phenol	mg/L	0.31	5	APHA 5530-D, 23 rd Ed.:2017
7	Ammonical Nitrogen	mg/L	28	50	IS:3025(Part-34/Section 1)2023
8	Chloride	mg/L	9073.07	1000	IS:3025(Part-32)2025

Note: Results shown in Bold are found above Permissible Limit.

Terms and conditions governing the test report issued

1. Sample is not drawn by SEL; the results are applicable only to the drawn samples.
2. The test report shall not be reproduced in full or part without the written approval of the SRICT Environmental Laboratory.
3. The test report in full or part shall not be used for promotional or publicity purpose without the written consent of SRICT Environmental Laboratory.
4. Water/Waste water samples shall be stored for the period of one month after the date of issue of Report.

END OF REPORT

For, SRICT Environmental Laboratory
Authorized Signatory


Dr. Snehal Lokhandwala
(Quality Manager)

Block No:402, At: Vataria, Ankleshwar-Valia Road, Ta: Valia, Dist: Bharuch
Phone No:02643-290825,9712177799, Mo: 9727745875/876 E-mail:hr.srict@gmail.com, www.srict.in

SRICT

SRICT ENVIRONMENTAL LABORATORY

(SHROFF S R ROTARY INSTITUTE OF CHEMICAL TECHNOLOGY)
(Managed by ANKLESHWAR ROTARY EDUCATIONAL SOCIETY)
(Block No. 402, At & Post: Vataria, Ta: Valia, Dist.: Bharuch, Pin code: 393135. Phone No.:02643-290825)

Page 1 of 2

Group : Waste Water
Discipline : Chemical

TEST REPORT

Customer's Name & Address: M/s. Enviro Technology Ltd Plot no. 2426 14. GIDC Estate. Ankleshwar, Dist: Bharuch. Contact Person: Mr. Dipak Meghapara	Report No : SEL/20260313/A1-001 Issue Date : 19/03/2026
---	--

Lab Id Code	:	SRICT/20260313/A1-001	:	Testing
Sample Description	:	Final O/L-001	:	Purpose
Date of Sample Received	:	13/03/2026	:	Test parameter
Date of Starting Analysis	:	16/03/2026	:	Quantity
Date of Completion Analysis	:	19/03/2026	:	Packed/Seal
			:	As mentioned by customer
			:	2 Lit
			:	Sealed

Sr. No.	Parameter	Unit	Result	Permissible Limit (If Applicable)	Test Method
1	Temperature	°C	27	40	APHA 2550,23 rd Ed:2017
2	Total Kjeldahl Nitrogen	mg/L	34.72	50	APHA-4500-N _{org} -B,23 rd Ed:2017
3	Phosphate	mg/L	0.74	5.0	IS3025(P-31):1988
4	Cyanide	mg/L	< 0.1	0.2	APHA 4500-B,23 rd Ed:2017
5	Fluorides	mg/L	2.05	15	APHA 4500-F-D,23 rd Ed:2017
6	Oil & Grease	mg/L	< 2.0	10	APHA 5520-B,23 rd Ed.:2017
7	Sulphide	mg/L	< 1.0	5.0	APHA 4500-S-2-F,23 rd Ed.:2017
8	Hexavalent Chromium	mg/L	< 0.1	0.1	APHA 3500Cr-B,23 rd Ed:2017
9	Total Chromium	mg/L	< 0.5	2.0	APHA 3111-B,23 rd Ed:2017
10	Copper	mg/L	0.11	3.0	APHA 3111-CU-B,23 rd Ed:2017
11	Nickel	mg/L	0.05	3.0	APHA 3111-Ni-B,23 rd Ed:2017
12	Zinc	mg/L	1.06	15	APHA 3111-Zn-B,23 rd Ed:2017
13	Iron	mg/L	0.69	3.0	IS:3025(Part-53)2024
14	Manganese	mg/L	0.06	2.0	APHA 3111-A,23 rd Ed:2017
15	Mercury	mg/L	< 0.01	0.01	APHA 3112-Hg-B,23 rd Ed:2017
16	Lead	mg/L	< 0.5	0.1	APHA 3111-Pb-B,23 rd Ed:2017
17	Arsenic	mg/L	< 0.01	0.2	APHA 3111-AS-B,23 rd Ed:2017
18	Vanadium	mg/L	< 5.0	0.2	APHA 3500-V-B,23 rd Ed:2017
19	Cadmium	mg/L	< 0.1	0.05	APHA 3111-Cd B,23 rd Ed:2017
20	Selenium	mg/L	< 0.01	0.05	APHA 3500-Se,B-C,23 rd Ed:2017
21	Color	Hazen	9365	100	APHA 2120-C,23 rd Ed:2017
22	Sulphate	mg/L	2631	1000	APHA 4500-SO ₄ -E,23 rd Ed:2017
23	Insecticide Pesticides	mg/L	Absent	Absent	Pesticides & Insecticides Ref,USEPA 508,525.2

Remark: Results shown in Bold are found above Permissible Limit.

SRICT

SRICT ENVIRONMENTAL LABORATORY

(SHROFF S R ROTARY INSTITUTE OF CHEMICAL TECHNOLOGY)

(Managed by ANKLESHWAR ROTARY EDUCATIONAL SOCIETY)

(Block No. 402, At & Post: Vataria, Ta: Valia, Dist.: Bharuch, Pin code: 393135. Phone No.:02643-290825)


Page 2 of 2

Terms and conditions governing the test report issued


1. Sample is not drawn by SEL; the results are applicable only to the drawn samples.
2. The test report shall not be reproduced in full or part without the written approval of the SRICT Environmental Laboratory.
3. The test report in full or part shall not be used for promotional or publicity purpose without the written consent of SRICT Environmental Laboratory.
4. Water Waste water samples shall be stored for the period of one month after the date of issue of Report.

END OF REPORT

For SRICT Environmental Laboratory
Authorized Signatory


Dr. Sneha Lokhandwala
(Quality Manager)

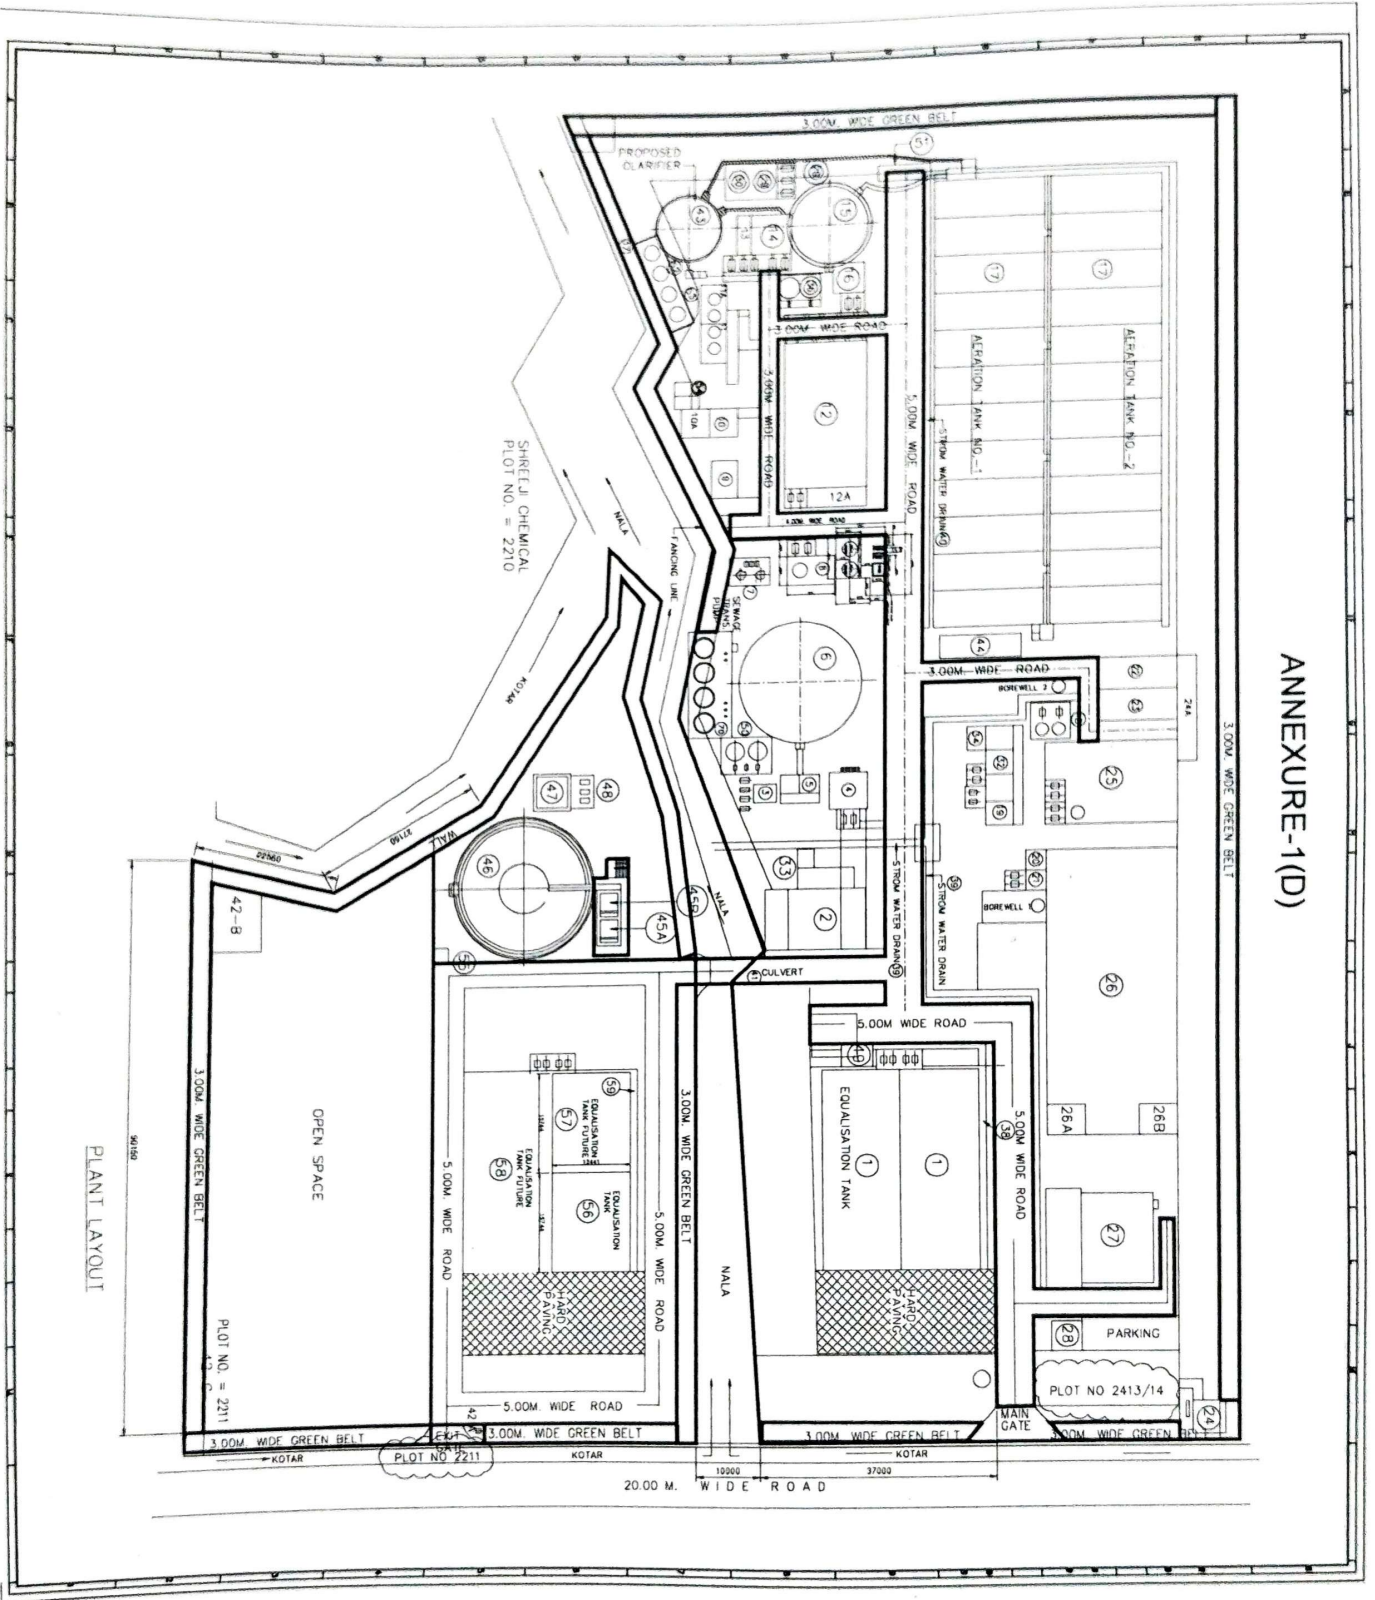ANNEXURE-1(D)



PLANT LAYOUT

ANNEXURE-1(E)

Letter No: DGVCLDANKI/0137/11/2024 Approved Date: 21-11-2024



Government of Gujarat

Dakshin Gujarat Vij Company Limited

(A Government of Gujarat Undertaking) CIN U40102GJ2003SGC042909

Industrial Division, Ankleshwar

Hall No. 02, Office No. 411, 412, 421 & 422, Forth Floor, Sargam Complex,
ONGC Road, Nr. Tran Rasta, Ta. Ankleshwar-393001, Dist. Bharuch, Gujarat.

Toll Free No.: 1800-233-3003, E-mail: eeank.dgvcl@gmail.com

Registered Office : "Urja Sadan" Nana Varachha Road, Kapodara, Nr. Gajjar Petrol Pump, Surat-395006 (Gujarat)



Certificate

To Whomsoever It May Concern

This is to certify, **ENVIRO TECHNOLOGY LIMITED**, at Plot No. 2413/2414 & 2211, GIDC Ankleshwar, Ankleshwar-393002, Bharuch, Gujarat. HT Connection having Consumer No. **39564**, Having Contract Demand **700 KVA**, Power release on dated **28-11-1996** is high tension has been assessed and meets the requirements for adequacy and reliability as per the applicable standards and regulations.

Executive Engineer
DGVCL, Ankleshwar

(REF.: Consumer letter dated 20-11-2024)

To,

ENVIRO TECHNOLOGY LIMITED

Plot No. 2413/2414 & 2211, GIDC Ankleshwar,

Ta. Ankleshwar-393002,

Dist. Bharuch, Gujarat.

(This document has been digitally signed, no physical signature is required.)

Signature valid

Signed by: Hemant
Rameshchandra Modi
Executive Engineer
Date: 2024.11.21 18:24:40
+05:30

File No: DGVCLDANKI/Revenue/e-file/4441/2024/1243/Account
Approved By: Executive Engineer, Technical, DGVCLDANKI
Open the document in Adobe Acrobat DC to verify the E-sign



1/1



AnyScanner

ANNEXURE-1(F)

BHARUCH ENVIRO INFRASTRUCTURE LIMITED



March 5, 2013

Enviro Technology Ltd.
Plot No.2413/2414,
GIDC, Ankleshwar.

Sub : Membership Certificate for Common Solid Waste Disposal Facility.

Dear Sir,

We hereby certify that you have become member for the common Solid/Hazardous waste disposal facility of Bharuch Enviro Infrastructure Ltd., at GIDC, Ankleshwar. You have booked solid waste quantity of 36,000 MT / Year. Your Membership No. is Ank/048.

Thanking you,

Yours faithfully,
For BHARUCH ENVIRO INFRASTRUCTURE LTD.

AUTHORISED SIGNATORY

ENVIRO TECHNOLOGY LIMITED

REL: C.T.L/ANN/2020/1055

Date: 11.01.2020
PCB ID: 15074

To,
Dr H V C Chary Guntapalli, Scientist D
Ministry of Environment, Forest & Climate Change
 Western Region Office,
 Kendriya Paryavaran Bhavan,
 Link Road No.3, E-5 Ravishankar Nagar
 Bhopal-462016

Sub: Compliance of newspaper advertisement for the Ec No. 10-82/2018-1A-III dated 16th December, 2019.

Ref: Environmental Clearance F. No. 10-82/2018-1A-III dated 16th December, 2019.

Dear Sir,

With Reference to the aforesaid Environmental Clearance F. No. 10-82/2018-1A-III dated 16th December, 2019, has been received on 25-December-2019 for proposed expansion with modification of existing common effluent treatment plant of M/s Enviro Technology limited (ETL), Ankleshwar.

As mentioned in the EC condition No. X (i), Ec receipt has to be published in newspaper within 7 days from the date of receipt of the clearance letter in at least two local newspapers.

We would like to inform that we have published in English (Times of India) on 01st January, 2020 and a vernacular language, Gujarati (Divya Bhaskar) Newspapers on 31st December, 2019.

The copies of the stated two newspapers are attached herewith for your reference and record.

Thanking you,

Yours Faithfully,
 For, Enviro Technology Limited

B. D. Dalwadi
 B. D. Dalwadi
 Chief Executive Officer

- C.C: (1) Member Secretary
 Gujarat Pollution Control Board
 Paryavaran Bhavan, Sector-10/A, Gandhinagar-382010
 (2) Regional Officer
 Gujarat Pollution Control Board
 Ankleshwar

18/01/2020
 Gujarat Pollution Control Board
 Head Office
 Sector No. 10-A,
 Gandhinagar-382010

Received
 Gujarat Pollution Control Board
 RO Ankleshwar
16/1/2020

CIN NO.:
 Works Office:

U72200GJ1994PLC023786

2413/2414 & 2211, GIDC Estate, Ankleshwar - 393 002 Dist. : Bharuch (Gujarat)
 Phone : (02646) 223569, 252768 Fax : (02646) 250707
 Email : dalwadibd@bell.co.in, darjiyam@bell.co.in

Reg. Office:

973146, GIDC Estate, Ankleshwar - 393 002 Dist. : Bharuch (Gujarat)

ter beans and several other vegetables have risen too.

According to Krishnakant Pawar, deputy secretary of APMC, Vashi, "Climate change happens to be the major factor for loss of production. The extended monsoon has badly hit farmers and destabilized the demand-

supply chain." At the wholesale APMC market in Vashi, supplies of onions have halved since September, say traders. The shortage of old onions and delay in harvesting the winter crop has kept prices high.

"Mumbai market needs at least 100-125 truckloads of

sale market. During September and November last year, the prices were Rs 25-35 per kg, which jumped to Rs 50-130 per kg this year.

To check prices, government stopped exports in September. This saw a slight dip in prices from Rs 50-60 per kg in the wholesale market to Rs 40-50 in October.

TO MARK A MILESTONE, it is retained in one of the HDIL Group companies, according to chargesheet submitted in court by the Enforcement Directorate (ED) in the PMC Bank scam. The ED questioned her about the source of funds for the purchase of a bungalow in Bandra along with flats in Golf Links Building, and bungalows in Alibaug and Vasai.

Man kills his ailing 62-yr-old mother to 'relieve' her of pain

Sandhya Nair
@timesgroup.com

Mumbai: A 30-year-old man allegedly killed his ailing 62-year-old mother to 'relieve' her of pain. The incident took place in the Bhabha Atomic Power Station (BARC) Colony at Tarapur on Sunday. The complainant, accused Jayprakash Dholi's brother, has told the police his younger sibling was mentally unstable.

According to the complaint, the victim, Chandravati, was preparing breakfast for Jayprakash when he hit her on the head with an iron rod. The accused is single and unemployed.

The complainant came to visit his mother after 11 am and saw Jayprakash sitting beside her body. An iron rod was lying next to him. Jayprakash told the police his mother was suffering from arthritis, blood pressure, diabetes

and cataract.

He told the police she often complained of pain and he killed her to liberate her. The victim lived along with her 70-year-old husband, a retired Tarapur Atomic Power Station (TAPS) employee and a daughter, who teaches at the (NPCIL) School in Tarapur. Jayprakash and his older brother resided in different homes in Duttatraye Nagar in Boisar. They would visit their mother every Sunday.

Gift of life: City set for record, 79 transplants in one year

TIMES NEWS NETWORK

Mumbai: The city witnessed 14 life-saving transplants in the last one week thanks to four families who donated the organs of their loved ones.

As the year ends, the city is set to witness a heartening record of 79 organ donations, the highest ever since cadaver donation programme started in 1997. Over 200 organ failure patients could undergo transplants owing to the cadaver donations.

The Zonal Transplant Coordination Committee data shows that the number of donations increased by 65% in 2019 when compared with 2018 (48). T

The number of donated organs too rose by 60% as compared to the previous year. This year also witnessed more bone donations and the first pancreas transplant in the city. Overall, 121 kidneys, 68 livers, 21 hearts, 10 lungs and one pancreas were donated.

"The programme has seen unprecedented success this year, but the challenge now would be to sustain the momentum," said Dr S Mathur, president of

VALSAD

ESI ACT 2002

repayment of the loans have been notices were financial Assets but they have public notices.

Date of NPA
05/07/2018
Four (4) as interest etc.

25/07/2017	Nine (9) as interest and
16/05/2019	Eight (8) as interest and

16/05/2019	Nine (9) as interest and
16/05/2019	Eight (8) as interest and

ver(s) and/or payment of falling which notice under Assets and

PUBLIC NOTICE FOR TITLE CLEARANCE REPORT

That Virenbhai Kurjibhai Bhrolia is absolute owner of below mentioned properties and he have obtained Title Clearance Report from me to obtain bank loan. Thereafter he informed that below original documents are lost. Therefore if any person, society, institution, group, trust, banks etc. Owing any right, interest, lien or claim of whatsoever nature in respect thereof are hereby informed to raise any such rights or claims within a period of 15 days from this notice along with all documentary proof, thereafter no any rights or claims shall be entertained and additional report will be issued.

Property Details:- All that piece and parcels of the immovable property of Industrial Plot No. 79, 80 totally admeasuring 265.52 sq. mtrs. in the Industrial estate which is known as "Swaminarayan Industrial Estate" situated on the land bearing Revenue Survey No. 385, 386, 387, 389 paiki having its Block No. 304 of Village: Talithaiya, Sub District: Palsana, District: Surat.

Lost Documents:- (1) Original sale deed No. 292 dated 27.03.2002, (2) Original sale deed No. 291 dated 27.03.2002 & (3) Original sale deed No. 475 dated 30.03.1994 alongwith original registration receipts of above all sale deeds.

Rakeen A. Wadhvani (Advocate) No. 202, Dalal Ch... Ph. 98251-37257

PUBLIC NOTICE ENVIRONMENTAL CLEARANCE


It is hereby informed that the Ministry of Environment, Forest and Climate change (IA, III Section), Indira Paryavaran Bhawan, Jor Bagh Road, New Delhi - 3, has accorded Environmental Clearance for Proposed Expansion with modification of existing Common Effluent treatment Plant of M/s. Enviro Technology Limited. (ETL) at Plot no.2413/2414 & 2211, GIDC Ankleshwar-393002 (Gujarat) vide letter No. F. No. 10-82/2018-IA-III dated 16/12/2019 under the provision of EIA Notification dated 14th September 2006, which we have received on 25/12/2019.

Copies of Clearance letter are available on website of MoEFCC/SEIAA.

Date: 30/12/2019

B D Dalwadi
(CHIEF EXECUTIVE OFFICER)

CADAVER DONATIONS IN MUMBAI



ZTCC. "Our next aim would be increase the donor pool and that could be achieved by recognizing more Non-transplant organ retrieval centres and encouraging them to identify donors," he said. TNN

શેષીઓ કનામુલ્યો કન માટે મોનીટરીંગ ટીમ આગામી મહિને આવી રહી છે. પુર્વે જ એન.સી.ટી.નું ઈનલેટ-આઉટ લેટની માત્ર વધુ આવતા હોડપામ મચી છે. છેલ્લા 2 મહિના ઈન-આઉટ કેતા પરિણામ બગડ્યા છે. પર્યાવરણવાદી દ્વારા ઉચ્ચસ્તરીય રજુઆત કરી છે. એન.સી.ટી.માં નિયત માત્રા કરતા વધુ સ્લજ સંગ્રહ દુર્ગમ ફેલાતા આજુબાજુ

જરા રહ્યા છે. અંકલેશ્વરના TATAP ફાઈનલ એક્સલુએન્ડ ટ્રીટમેન્ટ પ્લાન્ટ (NCT) જીપીસીબી ના માપ દરે મુજબ કામના કરતા ચિતામાં વપારો જોવા મળી રહ્યો છે. અંકલેશ્વર, પાનોલી અને ઝગડિયા વિસ્તારમાં આવેલા ઓથોગિક એકમોના ગંદા પાણીને શુદ્ધ કરી દરિયા સુધી લઈ જવાનું કાર્ય NCT દ્વારા થાય છે. જે છેલ્લા 2 મહિના ની માપ દરે

(આયાગક વરહ) નિર્ધારિત માત્રા થી વધુ જમા થયેલ છે જેનાથી પીરામણ અને અંકલેશ્વર સહિત આસપાસ ના વિસ્તારોમાં દુર્ગમ ફેલાઈ રહી છે અને હવાના આ પ્રદુષણને લીધે આસપાસ આવેલા માનવ વસાહતોની પ્રજાના સ્વસ્થામ પર ગંભીર અસરો ઉભી થઈ રહી છે. સ્થાનિક પ્રકૃતિ સુરક્ષા મંડળ દ્વારા આ અંગે જીપીસીબીમાં લેખિત ફરિયાદ કરી છે. ફાઈનલ એક્સલુએન્ડ

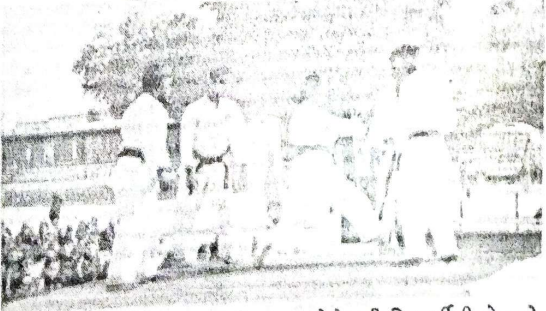
બે મહિના થી જીપીસીબીએ નિર્ધારિત કરેલ માપદંડો મુજબ કાર્ય કરતું નથી જેમાં મુખ્યત્વે કૃમિકલ ઓક્સીડેન ટ્રીમેન્ટ (COT) અને એમોનીકલ નાઈટ્રેટ (NAT-N) ટ્રીટમેન્ટ થયા પછી પણ તેના નિયત માત્રા થી વધુ NCT ના આઉટ લેટ માં નોંધવામાં આવેલ છે. અને આ પાઈપલાઈન દ્વારા કટીયાજાળના દરિયા સુધી જાય છે.

ખેતમાં તસ્કરો વીલા મોઢે પરત ફર્યા રિ-હર કોમ્પ્લેક્ષના મે નિશાન બનાવ્યા

પુષ્પકુંજ હરિ-હર કોમ્પ્લેક્ષના પ્કાન નંબર-39, 40માં હેમંતસિંહ કરિપ્રસાદ ઠાકોરનાઓ રહે છે. પાનિવાર તેમના બંધ બે મકાનોને ધત્રી દરમિયાન તસ્કરોએ નિશાન પનાવી મકાનના દરવાજાના નકુચા ધોડી મકાનમાં પ્રવેશ કર્યો હતો. તસ્કરોએ મકાનમાં મુકેલી તિજોરી પહીત કબાટો ખોલીને સમાનને મસ્તાબસ્ત કરી નાખ્યો હતો. જોકે

તસ્કરોને કોઈ પણ કિમતી ચીજ વસ્તુ હાથ નહિ લાગતા માત્ર 5 જેટલી સાડીઓ લઈને પલાયન થઈ ગયા હતા. બનાવની જાણ થતાં જ પરિવારે મકાનમાં તપાસ કરતા સાડી સિવાય કોઈ પણ વસ્તુ નહીં ગઈ હોવાથી રાહતનો શ્વાસ લીધો હતો. સી ડિવિઝન પોલીસે તસ્કરોને ઝડપી પાડવાના ચક્રોગતિમાન કર્યા છે.

ઓન્ટે સેલ્ફ ડિફેન્સની તાલીમ આપી અને મેગા ડેમોન્સ્ટ્રેશન 2000 યુવતીઓએ શક્તિનું પ્રદર્શન કર્યું



ભરૂચના હોસ્ટેલ ગ્રાઉન્ડ ખાતે સ્કૂલ, કોલેજની વિદ્યાર્થીનીઓ માટે એ.બી.વી.પી દ્વારા મિશન સાહસીનું આયોજન કરાયું હતું. ● અન્વેષણ

6 હજાર ઉપરાંતનો ઈંગ્લિશ દારૂ જપ્ત કર્યો અંકલેશ્વર GIDCમાં પાનના ગલ્લામાંથી દારૂ ઝડપાયો LCBએ ચામુંડા પાન કોર્નરમાં દારૂ ઝડપી પાડ્યો

ભાસ્કર ન્યૂઝ | અંકલેશ્વર

અંકલેશ્વર જીઆઈડીસી પાનના ગલ્લા માંથી ઈંગ્લીશ દારૂ એલ.સી. બી ઝડપી પાડ્યો હતો. 31 ડિસેમ્બર પુર્વે પોલીસ ચેકિંગ દરમિયાન જી.આઈ. એલ.ચોકડી પર ચામુંડા પાન કોર્નરમાં દારૂ મળી આવ્યો હતો. 6 હજાર ઉપરાંતનો ઈંગ્લીશ દારૂ જપ્ત કર્યો હતો. તેમજ પાનના ગલ્લા સંચાલક ધરપકડ કરી હતી.



અંકલેશ્વર પોલીસ દ્વારા 31 ડિસેમ્બરની ઉજાણીને લઈ ઈંગ્લીશ દારૂનો જથ્થો

ઝડપી પાડવાની કવાયત હાથ ધરી હતી. દરમિયાન ભરૂચ એલસીબી પોલીસ દ્વારા ચોકસ માત્રામાં આધારે જી.આઈ.એલ. ચોકડી શાકમાર્કેટ પાસે ચામુંડા પાન કોર્નર પર સર્ચ કરતા અંદર થી ઈંગ્લીશદારૂ નો જથ્થો મળી આવ્યો હતો. પોલીસે વિવિધ બ્રાન્ડની ઈંગ્લીશ દારૂ બોટલ જપ્ત કરી હતી. તેમજ પાનના ગલ્લા સંચાલક જીતેન્દ્ર ઈશ્વર ચાવડાની ધરપકડ કરી હતી.

કેનેડા-ઓસ્ટ્રેલિયા
3 વર્ષ વર્ક પર્મીટ (2 લાખ પગાર)
અમેરીકા
૧૦ વર્ષના વિઝીટર વિઝા
૮૧૪૦૯૫૫૯૨૦

ગ્રાહક સુચના

પર્યાવરણીય મંજૂરી

આ સાથે જણાવવામાં આવે છે કે, મિનિસ્ટ્રિ ઓફ એન્વાયરોમેન્ટ, ફોરેસ્ટ એન્ડ ક્લાયમેટ રોન્જ(1A, III section) ઇન્ટિરા પર્યાવરણ ભવન, પોર બાગ રોડ, નવી દિલ્હી-3, દ્વારા એલપીસે ટેકનોલોજી લિમિટેડ, પ્લોટ નં.૨૪૧૩, ૨૪૧૪ & ૨૨૧૧, જી.આઈ.ડી.સી. ઈન્ડસ્ટ્રીયલ ઇસ્ટેટ, અંકલેશ્વર-૩૯૩૦૦૨ (ગુજરાત) ખાતે હાલનાં કોમનએક્સલુએન્ડ ટ્રીટમેન્ટ પ્લાન્ટ માં ફેરફાર સાથે સુચીત વધારો કરવા માટેની પર્યાવરણીય મંજૂરી ફાઈલ નં. F. NO. 10-82/2018-1A-III તારીખ ૧૪-૧૨-૨૦૧૯ દ્વારા ઈ.આઈ.એ.નોટીફિકેશન તારીખ ૧૪ સપ્ટેમ્બર ૨૦૦૬ ખેંગવાઈ હેઠળ આપેલ છે, જે અમલે તારીખ ૨૬-૧૨-૨૦૧૯ ના રોજ મળેલ છે. ક્લીયરન્સ પત્રની નકલ મિનિસ્ટ્રિ ઓફ એન્વાયરોમેન્ટ, ફોરેસ્ટ એન્ડ ક્લાયમેટ રોન્જ ની વેબસાઈટ ઉપર ઉપલબ્ધ છે.






બી.દી.દલપાડી

(ચીફ એક્ઝીક્યુટીવ ઓફીસર)

તા.૩૦-૧૨-૨૦૧૯

ANNEXURE-1(H)

Environment Clearance for proposed expansion with modification of CETP – ETL Ankleshwar

Sr. No.	Address	Sign
1	Jilla Panchayat office, Bharuch	 જિલ્લા પંચાયત, ભરૂચ. તા. 16.11.2020
2	Taluka Panchayat Office Ankleshwar	 તા. 8-20
3	Taluka Panchayat Office Jhagadia	 15/02/2020
4	The Sarpanch Gram Panchayat – Dadhal	
5	The Sarpanch Gram Panchayat – Kosambdi	 સરપંચ કોસમ્બડી
6	The Sarpanch Gram Panchayat – Kapodara	તા. 16/02/2020
7	The Sarpanch Gram Panchayat – Bhadkodara	 સરપંચ, ભાદકોદરા તા. 16/02/2020
8	The Sarpanch Gram Panchayat – Andada	
9	The Sarpanch Gram Panchayat – Jitali	
10	The Sarpanch Gram Panchayat – Gadkholi	 

11	The Sarpanch Gram Panchayat – Piraman, Piraman, Ankleshwar	આચાર્ય શ્રી પીરમાન ગ્રામ પંચાયત તા. અંકલેશ્વર, જિ. અમરેલી 15-1-2020
12	The Sarpanch Gram Panchayat – Sarangpur	તા. અંકલેશ્વર, જિ. અમરેલી (PPT)
13	Mr. Yogesh P. Panua Safety Health and Environment Association	Bhumen જિટ
14	Mr. Jayesh Patel Centre For Environment Science and Community,	
15	Manish Rana Paryavaran Mitra	(P)
16	Ankleshwar Nagar Palika,	(P) 15-1-2020 અંકલેશ્વર નગર પેચા સદન
17	Notified Area Office, Ankleshwar	NOTIFIED AREA RECEIVED 13/1/2020
18	Notified Area Office, Panoli	Date:- 15/1/2020 Notified Area Office GIDC, Panoli.
19	Notified Area Office, Jhagadia	જિહાગડા 15/1/20
20	Collector District Collector office, Bharuch	અધિકારી કચેરી ભરૂચ 15/1/20
21	The principle, Footwear Design & Development Institute	ફૂટવેર ડિઝાઇન & ડેવલપમેન્ટ ઇન્સ્ટિટ્યુટ જાગૃત
22	The Principle, Pioneer School, Jitali	I/C Belim MS. આચાર્ય શ્રી

પાયોનિયર માધ્યમિક અને
ઉચ્ચતર માધ્યમિક શાળા
જિતાલી તા. અંકલેશ્વર જિ. અમરેલી



23	The Principle, P. S School, Jitali	<i>E/C</i> <i>13/11/20</i>
24	The Principle Shree Gattu Vidyalaya, Ankleshwar	<i>Principal</i> <i>Shree Gattu Vidyalaya</i> <i>Ankleshwar</i>
25	The Principle, Smt Puspavati Devidas Shroff Sanskardeep Vidhyalaya Ankleshwar	<i>Principal</i> <i>Smt Puspavati Devidas Shroff Sanskardeep Vidhyalaya</i> <i>Ankleshwar</i>
26	The Principle Lions International Academy, Ankleshwar	<i>Principal</i> <i>Lions International Academy</i> <i>Ankleshwar</i> <i>13/11/2020 8530950076</i>
27	The Principle Lion School Ankleshwar	<i>R.D. 10/11/20</i>
28	The Principle, Chandrabala Modi, academy, Ankleshwar	<i>Principal</i> <i>Chandrabala Modi Academy</i> <i>P.O. KONDH VALLA ROAD,</i> <i>ANKLESHWAR - 390 001</i> <i>DIST. BHARUCH (GUJARAT)</i>
29	The Principle, R.B.L.P S School, Ankleshwar	
30	Dr. A. K. Patel Ankleshwar	<i>Dr. A.K. Patel</i> <i>02646-246535</i>
31	Dr. Mahesh Mistry Ankleshwar	
32	Administration office, ESIC Hospital	<i>Smt</i> <i>15/11/2020</i>
33	Smt. Jayaben Modi Hospital	<i>Smt</i> <i>13/11/20</i>



ENVIRO TECHNOLOGY LIMITED

Ref: ETL/ANK/JUNE/2025/312

GPCB ID: 15074

Date: 26th June 2025

To,
The Member Secretary
Gujarat Pollution Control Board
Paryavaran Bhavan
Sector - 10 / A,
Gandhinagar

Sub: Environmental Statement for the year 2024-25

Dear Sir,

We are forwarding herewith an Environmental Statement (Form V) for our Common Effluent Treatment Plant situated at Plot No.2413 / 2414 & 2211 G.I.D.C., Ankleshwar - 393 002, Dist. Bharuch, for the year 2024-2025. The treated effluent is being sent to FETP of NCT for further treatment and disposal.

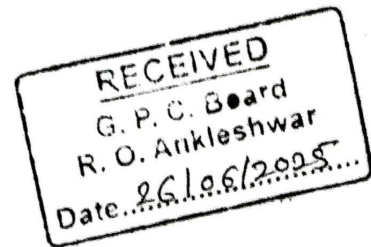
Thanking you.

Yours faithfully,

For, Enviro Technology Ltd


A. P. Karkhanis
(Unit Head)

CC: The Regional Officer, GPCB, Ankleshwar



CIN NO. :
Works Office :

Reg. Office :

U72200GJ1994PLC023786

2413/2414 & 2211, GIDC Estate, Ankleshwar - 393 002 Dist. : Bharuch (Gujarat)

Phone : (02646) 223569, 252768, 253104

Email : dalwadibd@bell.co.in, akhlkarkhanis@bell.co.in

9701-16, GIDC Estate, Ankleshwar - 393 002 Dist. : Bharuch (Gujarat)

ENVIRONMENTAL STATEMENT

PART - A


01	Name and address of the owner / occupier of the industry / operation or process	Director – Mr. Ashok Panjwani Unit Head – Mr. A. P. Karkhanis Enviro Technology Ltd. 2413 – 2414, & 2211 GIDC Estate Ankleshwar – 393 002
02	Industry Category	Primary – STC Code Secondary – SIC Code
03	Production capacity	Units Not applicable, it is a Common Effluent Treatment Plant
04	Year of establishment	1997
05	Date of the last Environmental Statement submitted	15 th June, 2024

PART - B

Water and Raw material Consumption

01	Water Consumption	≈ 64.53 m ³ / day	Water is consumed for Di sodium Hydrogen phosphate & Magnesium chloride solution preparation, Primary & Tertiary Sand Filter & Activated Carbon Filter Backwash, Bioaugmentation and domestic purpose.
	Process	28.49 m ³ / Day	
	Cooling	14.98 m ³ / Day	
	Domestic	21.06 m ³ / day	

Sr. No.	Name of Products (*)	Process Water Consumption per unit of product output	
		During the previous financial year	During the current financial year
1.	There is no manufacturing activity as this is a Common Effluent Treatment Plant. Our design capacity is to treat 2200 m ³ / day of Industrial effluent.		
(*)	Industry may use codes if disclosing details of raw material would violate contractual obligations, otherwise all industries must name the raw material used.		



02: Raw Material Consumption

Sr. No.	Name of Products (*)	Consumption of raw material (In Kgs)	
		During the previous financial year 2023 -2024	During the current financial year 2024 -2025
1.	Hy. Lime	544093.90	630089
2.	Hydrogen Peroxide	200	0
3.	Ferrous Sulphate (Solid)	0	4513
4.	Deforming Agent	2039	3706
5.	Polyelectrolyte (Type - 2)	108	131
6.	Phosphoric Acid	7025	11600
7.	Magnesium Salt	9837	22131
8.	Sodium Salt	5334.82	9873
9.	Sodium Tri-poly Phosphate (STPP)	1612	1998
10.	Poly Aluminum Chloride (PAC)	4400	13204
11.	Deformer (Silicon Base Fin-18)	54760	59020
12.	C.S. Lye (30%)	449315.40	670651

PART - C

Pollution discharged to environment / unit of output.
(Parameters as specified in the Consent issued)

Sr. No.	Pollutants	Quantity of pollutants discharged. (mass / day)		Concentrations of pollutants in discharges (mass / volume)	Percentage of variation from prescribed Standards with reasons
a	Water	COD	2655 Kg/ day	966 mg/l	-3.4%
		BOD	28 Kg/day	10 mg/l	-95%
		Ammonical Nitrogen	136 Kg/day	49 mg/l	-2%
b	Air	All parameters specified In consent for D.G.set stack & ambient air are within limit.			



PART – D

HAZARDOUS WASTE

(as specified under Hazardous Wastes [Management Handling & Trans – boundary Movement] Rules, 2008)

Hazardous Wastes		Total Quantity	
		During the previous financial year-23-24	During the current financial year-24-25
Category	Hazardous waste		
A) From Process			
35.3	Chemical Sludge from wastewater treatment	3592.600 MT	4668.420 MT
33.1	Discarded Containers	0 Nos.	3.34 MT
5.1	Used Oil	187 Liters	192 Liters
B) From Pollution Control Facilities			
Nil			

PART – E

SOLID WASTE

Hazardous Wastes		Total Quantity in M ³ /MT	
		During the current financial year 2023-2024	During the current financial year 2024-2025
a	From Process	NIL	NIL
b	From pollution control facilities (generation)	NIL	NIL

PART – F

- Please specify the characteristics (in terms of composition and quantum) of hazardous as well as solid wastes and indicate disposal practices adopted for both these categories of wastes.
- The major source of solid waste generation in the CETP is from primary treatment & MAP treatment of effluent from the member industries. The sludge generated is dewatered with the help of a super decanter.
- ETP sludge is disposed to the Centralized Secured Landfill Facility at BEIL-Ankleshwar.




PART – G

- Impact of the pollution abatement measures taken on conservation of natural resources and on the cost of production.
- CETP was started to sort out the environmental problems faced by industries especially small-scale industries in this region. With commissioning and operation of the CETP, the waste disposal problem of member industries has been solved.
 - As suggested by NEERI, we are adding Sewage to secondary treatment which helps better reduction of organics.
 - The treated effluent is sent to FETP of NCT for further treatment and disposal up to deep sea through closed pipeline system. ETL is making a payment of approximately Rs.56.90 Lacs per month to NCT for further treatment and disposal of the treated effluent.
 - Under the guidance of IIT Mumbai & Kanpur improved the performance of the CETP including bio-augmentation by Implementing new ASP + MLE system.
 - With the segregation and treatment of effluent for removal of Ammonical Nitrogen with physico chemical treatment, the Ammonical Nitrogen at the CETP outlet is maintained 25 to 45 mg/l consistently.
 - Implemented ASP + MLE system in biological process.

PART – H

- Addition measures / investment proposal for environmental protection including abatement of pollution, prevention of pollution.
- The sludge generated will be disposed off at the secured landfill of BEIL and Monthly expenditure will be approx. Rs. 15.14 Lacs.
 - Engaged IIT (Kanpur + Mumbai) for further studies to reduce refractory COD & Improve CETP performance. Approximately Rs 118.94 Lacs is spent on studies.
 - We have Installed TOC/TN Meter at a cost of Rs 35 Lacs in November- 2012 and updated the new TOC-4200 meter at a cost of Rs. 29 Lacs in July-2024 & Connected to CPCB.
 - ETL has sponsored a project on "Electro Chemical Oxidation "studies with Engg. College, SRICT. Annual expenditure Rs. 6 lacks.
 - We are displaying COD/BOD/pH/TSS & Flow on vendor's server by which real time monitoring by GPCB/CPCB.
 - We are planning to install solar panels above aeration tank of 257.985 kW capacity.




PART - I

Any other particulars for improving the quality of the environment.

- 1 Display of information with respect to operation, at the front of the Company, for the public
- 2 Students / Community are permitted to visit the CETP. Required guidance are given to the students who are doing Environmental Courses
- 3 Tree plantation is taken up as an important activity.
- 4 ETL has integrated system for ISO 14001:2015 & ISO 45001:2018.
- 5 ETL Laboratory has got NABL accreditation as per ISO 17025:2005.
- 6 Microbiological laboratory is set up and is in operation.
- 7 Treatability studies are conducted, and it is an on-going activity.
- 8 GPS System installed on tankers and helps in tracking.
- 9 Manifest system for transporting effluent from member industry to ETL.
- 10 Studies are conducted through IIT Kanpur / Mumbai for improving performance.
- 11 Electrochemical oxidation studies are carried out through SRICT Ankleshwar.
- 12 We have installed Solar panels above office building and generating approximately 3571.4 Units per month.

For, Enviro Technology Limited


A.P. Karkhanis
Unit Head



Date: 26.06.2025
Place :- Ankleshwar


ENVIRO TECHNOLOGY LTD., ANKLESHWAR

EFFLUENT RECEIPT DATA APRIL-2024 TO MARCH-2025

Month	Total No. of Tankers received	Average COD ppm	Average NH4-N ppm
April 2024	5122	4091	66
May 2024	5229	4013	63
June 2024	5128	4017	52
July 2024	5241	3593	53
August 2024	5392	3741	54
September 2024	5215	3963	57
October 2024	5630	4041	74
November 2024	4571	4431	113
December 2024	5520	4388	94
January 2025	5537	4140	87
February 2025	5014	4086	87
March 2025	4783	4011	82

HAZARDOUS WASTE DETAILS (CETP SLUDGE) ALL QTY. IN KGS

Month	Opening Balance	Generation	Dispatched to BEIL for Landfilling	Closing Balance
April 2024	0	364600	364600	0
May 2024	0	340680	340680	0
June 2024	0	333330	333330	0
July 2024	0	389120	389120	0
August 2024	0	434160	434160	0
September 2024	0	387350	387350	0
October 2024	0	454760	454760	0
November 2024	0	473180	473180	0
December 2024	0	420020	420020	0
January 2025	0	446640	446640	0
February 2025	0	379490	379490	0
March 2025	0	485050	485050	0
Total		4668420	4668420	




SLUDGE ANALYSIS REPORT

Sr. No.	Parameters	Unit	Result	Method Ref.
ETP SLUDGE ANALYSIS				
1	CaSO ₄	%	7.12	IS-4256
2	CaCO ₃	%	71.23	IS 2720: Part 23
3	LOD at 105 °C	%	56.06	APHA 2540 B
4	Total Inorganic Solids	%	95.69	APHA 2540-G
ETP SLUDGE 10 % LEACHATE ANALYSIS				
5	Total Acidity	mg/L	NIL	APHA 2310-B
6	Total Alkalinity	mg/L	761	APHA 2320-B
7	COD	mg/L	582	APHA 5220-B
8	Oil % Oil emulsion	mg/L	2.09	APHA 5520 - B
9	Cyanide	mg/L	BDL	APHA 4500-CN -G
10	Fluoride	mg/L	0.82	APHA 4500-F -D
11	Phenolic Compound	mg/L	BDL	APHA 5530 - D
12	Iron	mg/L	2.0562	APHA 3111-Fe- B
13	Total Chromium	mg/L	0.3847	APHA 3111-Cr-B
14	Manganese	mg/L	0.1963	APHA 3111-Mn- B
15	Zinc	mg/L	0.3174	APHA 3111-Zn- B
16	Copper	mg/L	0.0963	APHA 3111-Cu-B
17	Lead	mg/L	0.2189	APHA 3111-Pb-B
18	Nickel	mg/L	0.3763	APHA 3111-Ni- B

SOIL ANALYSIS REPORT

Sr.No.	Parameters	Results of sampling Done on 31.08.24	Results of sampling Done on 28.02.25
1	pH	7.62	7.74
2	Conductivity (mS/m)	504.2	597.6
3	Organic Matter (%)	12.43	13.74
4	Phosphorous (P) (mg/kg)	682.2	607.5
5	Copper (Cu) (mg/kg)	0.382	0.446
6	Nickel (N) (mg/kg)	0.624	0.517
7	Manganese (Mn) (mg/kg)	0.887	0.961
8	Zinc (Zn) (mg/kg)	4.89	5.03

BDL = Below Detectable Limit




AMBIENT AIR MONITORING DATA APRIL 2024 TO MARCH 2025

Sr.No.	Month	PM10	PM2.5	SO2	NOx
		$\mu\text{g} / \text{Nm}^3$			
1	April 2024	66.74	23.28	22.57	36.4
2	May 2024	68.13	23.23	22.91	36.62
3	June 2024	66.70	22.41	21.48	34.99
4	July 2024	59.05	20.66	20.17	31.38
5	August 2024	55.45	20.23	19.32	30.13
6	September 2024	56.48	21.39	20.22	33.03
7	October 2024	64.62	22.2	21.55	35.27
8	November 2024	73.23	22.58	22.01	36.22
9	December 2024	75.39	22.49	21.94	36.36
10	January 2025	76.56	22.83	21.87	36.41
11	February 2025	77.73	22.8	21.63	36.56
12	March 2025	78.36	23.02	22.1	36.92

D.G STACK MONITORING APRIL 2024 TO MARCH 2025

Sr.No.	Month	SPM milligram/NM3	SO2 ppm	NOx ppm
1	April 2024	32.53	12.74	18.63
2	May 2024	30.78	13.69	19.02
3	June 2024	32.47	11.93	17.39
4	July 2024	36.32	12.41	18.69
5	August 2024	39.17	11.28	19.23
6	September 2024	37.42	10.94	17.26
7	October 2024	35.72	11.82	15.33
8	November 2024	34.21	10.26	16.04
9	December 2024	36.47	12.08	18.13
10	January 2025	35.28	11.98	17.18
11	February 2025	33.57	12.21	18.04
12	March 2025	36.38	14.27	19.81





Shri S.R. Rotary Institute of Chemical Technology

UPL

Principal Supporter & Sponsor – UPL Ltd & Shroff Family
Managed by Ankleshwar Rotary Education Society
Constituent Institute of UPL University of Sustainable Technology

Rotary
Ankleshwar

Group : Waste Water
Discipline : Chemical

TEST REPORT

Customer's Name & Address: M/s. Enviro Technology Ltd Plot no. 2413/14, GIDC Estate, Ankleshwar, Dist: Bharuch. Contact Person: Mr. Dipak Meghapara	Report No : SEL/20241008/A-001 Issue Date: 14/10/2024
---	--

Lab Id Code	: SRICT/20241008/A-001	Purpose	: Testing
Sample Description	: Final O/L-001	Test parameter	: As-mentioned by customer
Date of sample received	: 08/10/2024	Quantity	: 2 Lit
Date of starting Analysis	: 09/10/2024	Packed/Seal	: Sealed
Date of completion Analysis	: 14/10/2024		

Sr No	Parameter	Unit	Result	Permissible Limit (If Applicable)	Test Method
1	Temperature	°C	25.2	40	APHA (23rd Ed) 2550
2	Total Kjeldahl Nitrogen	mg/l	34.16	50	APHA-4500-Norg-B, Macro- Kjeldahl Method, 23rd Ed.
3	Phosphate	mg/l	1.75	5	IS: 3025(P-31)1988Re-2003, Stannous chloride Method.
4	Cyanide	mg/l	BDL	0.2	APHA(23rd Ed) 4500-D, Titrimetric method
5	Fluorides	mg/l	BDL	15	APHA 4500-F- D, 4-90 TO 4-91, 23rd Ed., : 2017, SPADNS Method
6	Hexavalent Chromium	mg/l	BDL	0.1	APHA(23rd Ed) 3500Cr-B, Colourimetric Method
7	Total Chromium	mg/l	0.26	2	AAS-APHA (23rd Ed) 3111-B, Colourimetric Method
8	Copper	mg/l	0.78	3	APHA 3111-CU-B, 3-20 TO 3-31, 23 rd. ED.2017 AAS
9	Nickel	mg/l	0.52	3	AAS-APHA 3111-Ni-B, 3-20 to 3-21, 23 rd. ED.2017
10	Zinc	mg/l	0.54	15	AAS-APHA, 3111-Zn-B, 3-20 TO 3-21, 23 rd. ED.2017
11	Iron	mg/l	1.04	3	APHA-3111-Fe-B, 3-20 to 3-21, 23 rd. ED.2017

Block No :402, At & Po : Vataria, Ankleshwar-Valia Road, Ta: Valia, Dist: Bharuch, Pin: 392135,
Ph. no : +91-9712177799, Mo :+91-9727745875/76, E-mail: hr@sriect.in, Website: www.sriect.in





Shroff S.R. Rotary Institute of Chemical Technology

UPL
University of Sustainable Technology

Principal Supporter & Sponsor – UPL Ltd & Shroff Family
Managed by Ankleshwar Rotary Education Society
Constituent Institute of UPL University of Sustainable Technology

Rotary
Ankleshwar

12	Manganese	mg/l	0.64	2	APHA 3111 A, 23 rd. ED.2017-AAS
13	Mercury	mg/l	BDL	0.01	APHA-3112-Hg-B,23 rd. ED.2017-AAS
14	Lead	mg/l	BDL	0.1	AAS-APHA 3111-Pb-B,3-20 to 3-21,23 rd. ED.2017
15	Arsenic	mg/l	BDL	0.2	APHA 3111-AS-B,23 rd. ED.2017-AAS
16	Vanadium	mg/l	BDL	0.2	APHA-3500-V.B-AAS
17	Cadmium	mg/l	BDL	0.05	APHA 3111-Cd B, 23 rd. ED.2017-AAS
18	Selenium	mg/l	BDL	0.05	APHA-3500-Se, B-C-23 rd. ED.2017-AAS
19	Color	Hazen	5895	100	APHA 2120 C, 2-7 to 2-8, 23rd Ed.: 2017,Spectrophotometric Single Wavelength Method
20	Sulphate	mg/l	2318	1000	APHA ,4500-SO4-E, 4-199 to 200, 23rd Ed.: 2017,Turbidimetric Method
21	Insecticide/ Pesticides	mg/l	Absent	Absent	Pesticides &Insecticides Ref. USEPA 508,525.2

BDL: Below Detection Limit

Note: Results shown in Bold are found above Permissible Limit.

Prepared and checked By

Authorized Signatory

Terms and conditions governing the test report issued

1. Sample is not drawn by SBL; the results are applicable only to the drawn samples.
2. The test report shall not be reproduced in full or part without the written approval of the SRICT Environmental Laboratory.
3. The test report in full or part shall not be used for promotional or publicity purpose without the written consent of SRICT Environmental Laboratory.
4. Water/Waste water samples shall be stored for the period of one month after the date of issue of Report.

END OF REPORT

Block No :402, At & Po : Vataria, Ankleshwar-Valia Road, Ta: Valia, Dist: Bharuch, Pin-393135,
Ph. no : +91-9712177799, Mo :+91-9727745875/76, E-mail: hr@sriect.in, Website: www.sriect.in



SRICT ENVIRONMENTAL LABORATORY

(SHROFF S R ROTARY INSTITUTE OF CHEMICAL TECHNOLOGY)

(Managed by ANKLESHWAR ROTARY EDUCATIONAL SOCIETY)

(Block No. 402, At & Post: Vataria, Ta: Valia, Dist.: Bharuch, Pin code: 393135. Phone No.: 02643-290825)



TC-13941

Page 1 of 1

Group : Waste Water

Discipline : Chemical

ULR No. : TC1394124000000205F

TEST REPORT

Customer's Name & Address: M/s. Enviro Technology Ltd Plot no. 2413/14, GIDC Estate, Ankleshwar, Dist: Bharuch.	Report No : SEL/20241008/A-001
Contact Person: Mr. Dipak Meghapara	Issue Date: 14/10/2024

Lab Id Code	: SRICT/20241008/A-001		
Sample Description	: Final O/L-001	Purpose	: Testing
Date of sample received	: 08/10/2024	Test parameter	: As mentioned by customer
Date of starting Analysis	: 09/10/2024	Quantity	: 2 Lit
Date of completion Analysis	: 14/10/2024	Packed/Seal	: Sealed

Sr No	Parameter	Unit	Result	Acceptable Criteria	Test Method
1	pH	--	7.51	6.5 to 8.5	IS 3025(P-11) : 2022, Electrometric Method
2	Total Suspended solids (TSS)	mg/l	78.2	150	IS3025(P-17) 2022, Gravimetric Method
3	Total Dissolved Solid (TDS)	mg/l	13110	10000	IS3025(P-16), 2023, Gravimetric Method
4	BOD	mg/l	24.0	200	IS:3025 (Part 44), 2023, Oxygen Depletion Method
5	COD	mg/l	720	1000	IS: 3025-Part 58, 2023, Open Reflux Method
6	Oil & Grease	mg/l	BDL	10	APHA 5520-B, 5-42 to 44, 23rd Ed.: 2017, Liquid Partition Gravimetric Method
7	Total Phenol	mg/l	0.15	5	APHA, 5530-D, Page No. 5-52, 23rd Ed.: 2017, Direct Photometric Method
8	Sulphide	mg/l	BDL	5	APHA 4500-S-2-F, 4-187, 23rd Ed.: 2017, Iodometric Method
9	Ammonical Nitrogen	mg/l	26.88	50	IS: 3025-Part 34, 1988, Titrimetric Method
10	Chloride	mg/l	4607.79	1000	IS: 3025-Part 32, 1988, Argentometric Method

BDL: Below Detection Limit, Note: Results shown in Bold are found above Permissible Limit.

Terms and conditions governing the test report issued

1. Sample is not drawn by SEL; the results are applicable only to the drawn samples.
2. The test report shall not be reproduced in full or part without the written approval of the SRICT Environmental Laboratory.
3. The test report in full or part shall not be used for promotional or publicity purpose without the written consent of SRICT Environmental Laboratory.
4. Water/Waste water samples shall be stored for the period of one month after the date of issue of Report.

END OF REPORT

Prepared and checked By
Dr. Pratibha Gautam
(Technical Manager)

Authorized Signatory
Dr. Snehal Lokhandwala
(Quality Manager)

Block No:402, At: Vataria, Ankleshwar-Valia Road, Ta: Valia, Dist: Bharuch
Phone No:02643-290825,9712177799, Mo: 9727745875/876 E-mail:hr.srict@gmail.com, www.srict.in



Compliance Status for the period of October'25 to March'26 Environment clearance to M/s Enviro Technology Limited for proposed expansion with modification of existing Common Effluent Treatment Plant at Ankleshwar within the existing premises at plot no 2413/14, Notified G.I.D.C. Estate, Ankleshwar. In category B- 7(h) of schedule with EIA notification, 2006.

Note: We received NOC on 22.04.2020 but due to Pandemic Covid-19, the project was delayed. The plant is complete and ready for use since 13.10.2022. CCA was applied but not received as FETP (Narmada Clean Technology Ltd., Ankleshwar where ETL discharges final treated water) is not complying with norms. However, CCA has been re-applied on 27.04.2026, and we are awaiting CCA. Therefore, this EC has not yet been implemented.

Environmental Clearance No. 10-82/2018-IA-III dated 16th December 2019

1. This has reference to your online proposal No. INGJ/MIS/84597/2018 dated 9th April 2019, submitted to this Ministry for grant of Environmental Clearance (EC) in terms of the provisions of the Environment Impact Assessment (EIA) Notification, 2006 under the Environment (Protection) Act, 1986.:

Noted

2. The proposal for grant of environmental clearance to the project Proposed expansion with modification of existing Common Effluent Treatment Plant at Ankleshwar within the existing premises by M/s Enviro Technology Limited, was considered by the Expert Appraisal Committee (Infra-2) in its 41st meeting held during 27-29 May, 2019 and 42nd meeting held during 10-12 July, 2019. The details of the project, as per the documents submitted by the project proponent, and also as informed during the above meeting are as under:

- (i) M/s Enviro Technology Ltd. is the operator of existing CETP (capacity 2.2 MLD effluent with sewage of 1.7 MLD), since 1996 at plot No 2413/14 GIDC Notified Industrial Estate Ankleshwar. Raw Effluent from more than 250-member industries such as dyes, intermediate, pigment, chemicals, textile, pharmaceuticals etc. that are flourishing in and around Ankleshwar industrial estate is collected in tankers and treated at CETP having Primary, Secondary and Tertiary Treatment facilities. Treated effluent from CETP is being discharged through GIDC drain into Final Effluent Treatment Plant (FETP) operated by M/s. Narmada Clean Technology Ltd. (NCT), Ankleshwar for further treatment and disposal to deep sea. The plant is in operation with valid Consent to Operate & Authorization valid up to 18.03.2024.:

Noted

- (ii) The Enviro Technology Limited had obtained Environment Clearance (EC) vide letter No.10 2/2008-IA.III dated 23.07.2009 for proposed capacity enhancement of Common Effluent Treatment Plant (CETP) for treatment of industrial effluent from 1.8 to 3.5 MLD. The Validity of Environmental Clearance (EC) for expansion was extended up to 22.07.2019 vide Letter No 10-2/2008-IA. III dated 03.07.2017 for treatment of 3500 m3/day industrial wastewaters and use of 1445 m3/day GIDC water. Consequent to notification of Moratorium imposed on Critically Polluted Areas which included Ankleshwar Industrial Estate vide OM No. J-11013/5/2010-IA. 11 (1) on 13.01.2010, there has been no expansion, and no new industries came up as a result there has been no increase in effluent quantity. Accordingly, ETL did not expand the capacity of

CETP and continued to operate on existing capacity of 2.2 MLD of raw effluent as earlier. In the year 2016, the Moratorium has been lifted for Ankleshwar Vide Letter No. J-11013/5/2010-1A. II (A) dated 25.11.2016 based on CEPI index.:

Noted

- (iii) M/s ETL proposes expansion from 1.8 to 3.5 MLD industrial effluent with modification in the treatment technology plans to utilize the modified quantity sewage mixed with industrial wastewater and fresh water used for chemical dosing & other uses as detailed below:

Sr. No.	Particular	Existing (MLD)	Proposed (MLD)
1.	Industrial Effluent from Member Industries (including 600 m ³ /day of effluent stream of high Ammoniacal Nitrogen)	1.8	3.5
2.	Sewage	1.7	1.7
3.	Fresh/Raw Water	0.725	0.465
4.	Quantity of discharge of Effluent from CETP	3.5	5.548

Noted

- (iv) Treated effluent from ETL is discharged to GIDC Drainage system which goes to FETP of NCTL (Narmada Clean Technology Ltd) along with effluent from other industries, for further treatment and disposal up to deep sea through closed pipeline system. ETL has also obtained membership for discharge of additional quantity of effluent after proposed expansion:

Noted

- (v) The hazardous wastes generated from different process are listed below & shall be disposed according to Hazardous waste management handling rule.

Hazardous Waste / quantity per year	Source	Mode of disposal
ETP Sludge/36500 MT	ETP	BEIL, TSDF site
Used oil/1.8 MT	lubrication of equipment, DG set	Sold to approved recycler
Discarded Container/ 730 Nos.	Raw material packing container	Sold to authorized dealers
Spent Carbon from Tertiary Treatment / 54 MT	Filters	BEIL, TSDF site

Noted

- (vi) As per the EIA Notification, 2006 [as amended], the Common Effluent Treatment Units (CETP) units listed at Serial no. 7 (h) of the Schedule of EIA Notification of categorized under Category However due to location of the existing CETP in the Critically Polluted Area the project has been categorized as "A" category.:

Noted

- (vii) Salient Features of the Project are:

Sr.no.	Parameters	Description
1.	Proposed plant capacity	Industrial wastewater: 3500 m ³ /day (including 600 m ³ /day of effluent stream of high ammonical nitrogen). Sewage: 1700 m ³ /day Raw water: 465 m ³ /day Total Influent: 5625 m ³ /day Total Discharge: 5548 m ³ /day
2.	Existing plant capacity	Effluent: 1800 m ³ /day Sewage: 1700 m ³ /day Raw water: 725 m ³ /day Total Discharge: 3500 m ³ /day (as per valid consent of GPCB)
3.	Plot Area	26543.79 sqm
4.	Location	Notified Industrial Area, Ankleshwar, Gujarat
	Coordinates	Latitude: 21°37'11.03"N Longitude: 73°01'38.52" E
5.	Source of Water	GIDC water supply
6.	Electricity requirement /Power	600 KVA Existing & 600 KVA Proposed. In case of power failure D.G. Set (2*1010 KVA Capacity) will be used.

Noted

- (viii) ToR was approved by MoEF & CC (EAC), New Delhi vide letter F.No. 10 82/2018-IA-III dated 13.12.2018.:

Noted

- (ix) Baseline monitoring of UPL-1 is also collected by us during from 8th March 2018 to 3rd June, 2018 and same was revalidated for one month during 17th December 2018 to 15th January 2019.:

Noted

- (x) Public hearing was exempted as the project area falls under notified Industrial zone of Ankleshwar.:

Noted

(xi) Investment Cost of the project is approx. Rs. 19.35 Crores.:

Noted

(xii) Benefits of the project: The proposed CETP shall help in the economical treatment of industrial effluent from small scale industries. Thereby, improving the surrounding environment. Increase in direct/indirect employment opportunities thereby improving overall socio-economic condition.:

Noted

(xiii) Employment potential: During operation phase, total no of employee would be around 50.:

Noted

3. The project/activity is covered under category 'B' of item 7 ('Common Effluent Treatment plants (CETPs)' of the Schedule to the EIA Notification, 2006 and its subsequent amendments, and requires appraisal at State level. However, due to applicability of general conditions i.e. project location in Critically Polluted Area, Ankleshwar, the proposal has been appraised at Central Level.:

Noted

4. The proposal was considered by EAC (Infra-2) in its 41st meeting held during 27-29 May 2019 and 42nd meeting held during 10-12 July 2019. The EAC during its meeting deliberated on the certified compliance report letter No. 5-283/2009(ENV)/161 dated 7.3.2019 issued by the MoEF&CC Regional Office Bhopal. As per Compliance report out of total 32 conditions, 7 are fully complied, 02 are compiled subject to condition, 4 are in which compliance are not applicable to the project proponent, 15 are agreed to comply and 4 are noted. As per the compliance report, the project proponent i.e. M/s Enviro Technology Limited had received 12 show-cause notices and 02 Directions for closure in past 3 years. All of which have been complied. No closure notice received in the past three years.:

Noted

5. The EAC, based on the information submitted and clarifications provided by the Project Proponent and detailed discussions held on all the issues, recommended for grant of Environmental Clearance to the project with stipulated specific conditions along with other Standard EC Conditions as specified by the Ministry vide OM dated 4th January 2019 for the said project/activity, while considering for accord of environmental clearance. As per recommendations of the EAC, the Ministry of Environment, Forest and Climate Change hereby accords Environmental Clearance to the project Proposed expansion with modification of existing Common Effluent Treatment Plant at Ankleshwar within the existing premises by M/s Enviro Technology Limited, under the provisions of the EIA Notification, 2006 and amendments/circulars issued thereon, and subject to the specific and general conditions as under: -

Noted

A. SPECIFIC CONDITION:

Sr. No	Description	Status
I.	The project proponents will implement the project only after getting consent to establish from the SPCB.	Complied We received CTE from SPCB on 22.04.20, but due to Pandemic Covid -19, we have not implemented the project. We had Completed Our Construction Work. We have applied for CC&A on 07.10.2025 and is awaited. Hence this EC has not yet been implemented.
II	It shall be ensured that primary treatment of effluents to the level of influent quality standards as prescribed by the board, is ascertained at the member units.	Shall be Complied We are complying with the same for existing operation (i.e. 2.2 MLD industrial effluent) and will comply with the same after implementation of 3.5 MLD industrial effluent project.
III.	Member shall only be allowed access to the CETP if they have consent from the SPCB.	Shall be Complied. We are complying with the same for existing operation (i.e. 2.2 MLD industrial effluent) and comply with only the same after implementation of 3.5 MLD industrial effluent project.
IV.	A dedicated access-controlled conveyance system shall be provided for transporting effluents from the member units of CETP.	Shall be Complied Conveyance of effluent is through dedicated tankers controlled by ETL. This system is followed presently, and we shall ensure compliance after project implementation. The tankers are also installed with GPS(LCS) System.
V.	Conformance to the influent and effluent standards shall be the responsibilities of CETP.	Shall be Complied We are complying with the same for existing operation (i.e. 2.2 MLD industrial effluent) and comply with the same after implementation of the project.
VI.	The design of the CETP should be as approved by PCB.	Complied We submitted the layout and details to GPCB when taking CTE.

VII.	There shall be flow meters at inlet and outlet of CETP to monitor the flow. Suitable meters shall be provided to measure the quantity of effluent received, quantity of effluent recycled/reused and discharged.	Shall be Complied Effluent is received in 10 KL Capacity tankers, and the details are maintained. At the outlet, we have a Magnetic flow meter installed and readings are transmitted to NCT and noted. Based on this the quantities of inlet and outlet are measured. Same system or other adequate system shall be adopted on implementation of the project. Details of effluent received, and effluent discharged currently are attached below: <table border="1"> <thead> <tr> <th>Month</th><th>Average Inlet Effluent (MLD) (2.2 MLD Industrial Effluent)</th><th>Final Discharge Quantity Along with 1.1 MLD sewage (Avg. MLD)</th></tr> </thead> <tbody> <tr> <td>October'25</td><td>1.445</td><td>2.205</td></tr> <tr> <td>November'25</td><td>1.608</td><td>2.295</td></tr> <tr> <td>December'25</td><td>1.480</td><td>2.200</td></tr> <tr> <td>January'26</td><td>1.301</td><td>1.887</td></tr> <tr> <td>February'26</td><td>1.441</td><td>2.044</td></tr> <tr> <td>March'26</td><td>1.317</td><td>1.881</td></tr> </tbody> </table>	Month	Average Inlet Effluent (MLD) (2.2 MLD Industrial Effluent)	Final Discharge Quantity Along with 1.1 MLD sewage (Avg. MLD)	October'25	1.445	2.205	November'25	1.608	2.295	December'25	1.480	2.200	January'26	1.301	1.887	February'26	1.441	2.044	March'26	1.317	1.881
Month	Average Inlet Effluent (MLD) (2.2 MLD Industrial Effluent)	Final Discharge Quantity Along with 1.1 MLD sewage (Avg. MLD)																					
October'25	1.445	2.205																					
November'25	1.608	2.295																					
December'25	1.480	2.200																					
January'26	1.301	1.887																					
February'26	1.441	2.044																					
March'26	1.317	1.881																					
VIII.	The units and the CETP shall maintain daily logbook of the quantity and quality of discharge from units, quantity of inflow into the CETP, details of the treatment at each stage of the CETP including the raw materials used, quantity of the treatment water sent back to the units, quantity of the salts extracted from the treatment process and detail of the selling of such salts. All the above information shall be provided on the line of the website exclusive prepared from the purpose by the CETP owner. The website shall be accessible by the public. The financial and energy details of the CETP will also be provided along with details of the workers of the CETP	Shall be Complied We are having digital display board in front of CETP, and all the required details are displayed. Records of wastewater received from member units and effluent discharge details are submitted to GPCB. It may be noted that ETL is not sending back treated water to member units and is also not extracting salt. EC compliance report comprising the above information is uploaded on the website. We will also follow the same for proposed expanded capacity.																					
IX.	Periodical monitoring shall be carried out for the functioning of CETP and outlet parameters.	Shall be Complied For the existing system of 2.2 MLD effluent: Effluent characteristics at each stage of CETP are daily monitored to ensure proper functioning of the CETP.																					

		b) Outlet parameters are also monitored daily in-house and by a third party monthly. <table><tr><th colspan="8">Monthly Average of Final Discharge Quality for 2.2 MLD (Internal)</th></tr><tr><th>Month</th><th>Oct' 25</th><th>Nov' 25</th><th>Dec' 25</th><th>Jan' 26</th><th>Feb' 26</th><th>Mar' 26</th><th>GPCB Permissible Limits</th></tr><tr><td>pH</td><td>7.6</td><td>7.98</td><td>7.2</td><td>7.6</td><td>6.9</td><td>6.8</td><td>6.5 to 8.5</td></tr><tr><td>COD</td><td>810</td><td>800</td><td>798.4</td><td>840</td><td>798.4</td><td>792</td><td>1000 mg/L</td></tr><tr><td>BOD</td><td>14</td><td>18</td><td>18</td><td>21</td><td>18</td><td>21</td><td>200 mg/L</td></tr><tr><td>TSS</td><td>132</td><td>116</td><td>105</td><td>98</td><td>101</td><td>98</td><td>150 mg/L</td></tr><tr><td>NH4-N</td><td>33.6</td><td>28</td><td>27.44</td><td>29.68</td><td>29.12</td><td>28</td><td>50 mg/L</td></tr></table> We are carrying out stagewise monitoring to ensure proper treatment. Microbial monitoring is also carried out. Internal monitoring & third-party monitoring shall be carried out on implementation of the project. Third party monitoring reports for existing system are attached as Annexure – 1(A).	Monthly Average of Final Discharge Quality for 2.2 MLD (Internal)								Month	Oct' 25	Nov' 25	Dec' 25	Jan' 26	Feb' 26	Mar' 26	GPCB Permissible Limits	pH	7.6	7.98	7.2	7.6	6.9	6.8	6.5 to 8.5	COD	810	800	798.4	840	798.4	792	1000 mg/L	BOD	14	18	18	21	18	21	200 mg/L	TSS	132	116	105	98	101	98	150 mg/L	NH4-N	33.6	28	27.44	29.68	29.12	28	50 mg/L
Monthly Average of Final Discharge Quality for 2.2 MLD (Internal)																																																										
Month	Oct' 25	Nov' 25	Dec' 25	Jan' 26	Feb' 26	Mar' 26	GPCB Permissible Limits																																																			
pH	7.6	7.98	7.2	7.6	6.9	6.8	6.5 to 8.5																																																			
COD	810	800	798.4	840	798.4	792	1000 mg/L																																																			
BOD	14	18	18	21	18	21	200 mg/L																																																			
TSS	132	116	105	98	101	98	150 mg/L																																																			
NH4-N	33.6	28	27.44	29.68	29.12	28	50 mg/L																																																			
X.	The MOU between CETP and member units shall indicate the maximum quantity of effluent to be sent to the CETP along with the quality.	Shall be Complied This procedure is being followed for the existing system and shall be compiled in the future also.																																																								
XI.	Individual members to the CETP shall treat their effluents in primary treatment systems to the inlet quality standards of the CETP as prescribed by the SPCB.	Shall be Complied.																																																								
XII.	Individual members shall segregate their wastes in to concentrated and diluted streams and also as per the nature of chemical contamination and store them as per conditions to be specifically imposed in this regard by the SPCB.	Shall be Complied. Currently, Segregation of effluent is done by industries. High Ammonia streams are sent separately for MAP treatment & remaining effluent is treated in the General Treatment section. This shall be complied for 3.5 MLD.																																																								
XIII.	Chemical recovery and reuse, either in-house or outside shall be practiced to the satisfaction of the SPCB. Use in agriculture shall be exercised with caution after getting the irrigation	Noted																																																								

	management plan approved by the SPCB.	
XIV.	All tankers carrying untreated wastes and all hazardous and other wastes shall be properly labeled and transported as per the hazardous and other wastes rules 2016.	Shall be Complied We are complying the same for existing operation (i.e. 2.2 MLD industrial effluent) and will comply the same after implementation of expansion.
XV.	The detailed design of the various unit operation shall strictly conform to the directions of the SPCB as given in the CTE.	Shall be Complied
XVI.	The project proponent and SPCB should ensure that the member ship of CETP is restricted to only those industries which legitimately exist in the area. A list of industries in this regard shall be prepared by the association which will have the following details. • Name of industry • Office address • Location of industry • Status of consent under water act along with order number. • Status of consent under air act along with order number. • Production capacity as per consent orders. Total industrial effluent to CETP as per consent order.	Complied Before giving membership to any industry, we take their CCA issued by GPCB.
XVII	The unit shall inform the SPCB at least a week prior to undertaking maintenance activities in the recycle system and store/dispose treated effluents under their advice in the matter.	Shall be Complied. We are complying the same for existing operation (i.e., 2.2 MLD industrial effluent) and will comply the same after implementation of proposed project.
XVIII	The unit shall also immediately inform the PCB of any breakdown in the recycling system, store the effluents in the interim period and dispose effluents only as advised by the PCB.	Shall be Complied We are complying the same for existing operation (i.e. 2.2 MLD industrial effluent) and will comply the same after implementation of proposed project.
XIX	The unit shall maintain a robust system of conveyance for primary treated effluents from the member units and	Shall be Complied

	constantly monitor the influent quality to the CETP. The management of the CETP and the individual member shall be jointly and severally responsible for conveyance and pretreatment of effluents. Only those units will be authorized to send their effluents to the CETP which have a valid consent of the PCB and which meet the primary treated standards as prescribed. The CETP operator shall with the consent of the SPCB retain the powers to delink the defaulter unit from entering the conveyance system.	The effluent is conveyed to CETP through dedicated tankers of CETP. We are complying the same for existing operation (i.e., 2.2 MLD industrial effluent) and will comply the same after implementation of proposed project.
XX	The CETP operator will maintain an annual register of member units which will contain the details of products with installed capacities and quality of effluents accepted for discharge. This will form a part of the initial and renewal applications for CTO to be made before the SPCB.	Noted
XXI	Any changes in the manufacturing process, installed capacity or the quality or quantity of effluents as agreed upon in the initial MOU between the operator and the member units, will only be done after an approval of the SPCB.	Noted and Shall be Complied. MOU between the ETL(CETP) and the member units will be done. In MOU, details of manufacturing Process, installed capacity are described. Any changes in MOU is done only upon capacity changes of CCA from members. We are complying the same for existing operation (i.e. 2.2 MLD industrial effluent) and will comply the same after implementation of proposed project.
XXII	The treated effluent from CETP shall be blended with treated sewage prior to its discharge in river.	Not Applicable In our existing as well as proposed system for 3.5 MLD effluent, sewage is mixed with effluent before the effluent enters biological (secondary) treatment process. The treated effluent is not blended with treated sewage. Also, our discharge is to FETP for further treatment and disposal to sea and not in river.
XXIII	Domestic water requirement is 0.675 KLD, which will be met through water tanker supply.	Shall be Complied We are getting Water from GIDC through pipeline and is used for all requirements.

		In case of non-availability of water from GIDC, water from borewell is drawn. NOC from CGWA for withdrawal of ground water is received.																
XXIV	The quantity of hazardous waste i.e. ETP sludge to be generated from CETP facility shall be handled and disposed to nearby authorized TSDF site as per HWM Rules, 2016.	Shall be Complied Unit is disposing sludge to Common TSDF –BEIL for their existing operation and will continue the same for proposed operation after implementation. Sludge disposal quantity for existing facility is given below: (October'25 to March'26). <table border="1"> <thead> <tr> <th>Month</th><th>Sludge Quantity (MT)</th><th>Consented Qty. in MT/Year</th></tr> </thead> <tbody> <tr> <td>October'25</td><td>337.21</td><td rowspan="6">36500</td></tr> <tr> <td>November'25</td><td>309.31</td></tr> <tr> <td>December'25</td><td>394.57</td></tr> <tr> <td>January'26</td><td>480.84</td></tr> <tr> <td>February'26</td><td>239.16</td></tr> <tr> <td>March'26</td><td>282.90</td></tr> </tbody> </table> Membership certificate of BEIL to dispose sludge is attached as Annexure -1(B)	Month	Sludge Quantity (MT)	Consented Qty. in MT/Year	October'25	337.21	36500	November'25	309.31	December'25	394.57	January'26	480.84	February'26	239.16	March'26	282.90
Month	Sludge Quantity (MT)	Consented Qty. in MT/Year																
October'25	337.21	36500																
November'25	309.31																	
December'25	394.57																	
January'26	480.84																	
February'26	239.16																	
March'26	282.90																	
XXV	Non-hazardous solid wastes and sludges arising out of the operation of the CETP shall be adequately disposed as per the consent to be availed from the SPCB. Non-hazardous solid wastes and sludges shall not be mixed with hazardous waste.	Shall be complied We are complying the same for existing operation (i.e., 2.2 MLD industrial effluent) and will comply the same after implementation of proposed project.																
XXVI	The effluent from member units shall be transported through pipeline. In case the effluent is transported through road, it shall be transported through CETP tankers only duly maintaining proper manifest system. The vehicle shall be fitted with proper GPS system.	Shall be Complied Currently also the effluent is transported through road by CETP tankers fitted with GPS and proper manifest system.																
XXVII	Before accepting any effluent from member units, the same shall be as permitted by the SPCB in the consent order. No effluent from any unit shall be accepted without consent from SPCB under the water Act, 1974 as amended.	Shall be Complied We are complying the same for existing operation (i.e., 2.2 MLD industrial effluent) and will comply the same after implementation of proposed project.																
XXVIII	The CETP shall have adequate power back up facility, to meet the energy requirement in case of power failure from the grid.	Shall be Complied As power back up, ETL has installed DG Set of 1010 KVA for smooth operation during power failure-																

XXIX	All the recommendation of the EMP shall be complied with letter and spirit. All the mitigation measures submitted in the EIA report shall be prepared in a matrix format and the compliance for each mitigation plan shall be submitted to RO, MOEF and CC along with half yearly compliance report.	Shall be Complied.																												
XXX	The project proponent shall set up separate environmental management cell for effective implementation of the stipulated environment safeguards under the supervision of a senior executive.	Complied Details are as under: <table><tr><th>Sr. No</th><th>Name of the employee</th><th>Designation</th><th>Educational Qualification</th></tr><tr><td>1.</td><td>Mr. B. D. Dalwadi</td><td>C.E.O.</td><td>B.E. Chemical</td></tr><tr><td>2.</td><td>Mr. A. M. Darji</td><td>Advisor</td><td>M.Sc.- Biochemistry, L.L.B</td></tr><tr><td>3.</td><td>Mr. Dipak Meghpara</td><td>Manager</td><td>M. Sc & PG Dip in Env. Mgt. & Tech.</td></tr><tr><td>4.</td><td>Mr. Akhil P. Karkhanis</td><td>Unit Head</td><td>M.E. Chemical</td></tr><tr><td>5.</td><td>Ms. Rakshita Vyas</td><td>D.G.M. (Env.)</td><td>M.Sc. Environment</td></tr><tr><td>6.</td><td>Ms. Priya Patel</td><td>Officer (Env.)</td><td>B.E. Environment</td></tr></table>	Sr. No	Name of the employee	Designation	Educational Qualification	1.	Mr. B. D. Dalwadi	C.E.O.	B.E. Chemical	2.	Mr. A. M. Darji	Advisor	M.Sc.- Biochemistry, L.L.B	3.	Mr. Dipak Meghpara	Manager	M. Sc & PG Dip in Env. Mgt. & Tech.	4.	Mr. Akhil P. Karkhanis	Unit Head	M.E. Chemical	5.	Ms. Rakshita Vyas	D.G.M. (Env.)	M.Sc. Environment	6.	Ms. Priya Patel	Officer (Env.)	B.E. Environment
Sr. No	Name of the employee	Designation	Educational Qualification																											
1.	Mr. B. D. Dalwadi	C.E.O.	B.E. Chemical																											
2.	Mr. A. M. Darji	Advisor	M.Sc.- Biochemistry, L.L.B																											
3.	Mr. Dipak Meghpara	Manager	M. Sc & PG Dip in Env. Mgt. & Tech.																											
4.	Mr. Akhil P. Karkhanis	Unit Head	M.E. Chemical																											
5.	Ms. Rakshita Vyas	D.G.M. (Env.)	M.Sc. Environment																											
6.	Ms. Priya Patel	Officer (Env.)	B.E. Environment																											
XXXI	The funds earmarked for environment management plan shall be included in the budget and this shall not be diverted for any other purposes.	Complied Our unit is a CETP and hence all the expenditure is for the purpose of environment protection measures.																												
XXXII	Project proponent should develop green belt all along the periphery of the site with native plant species that are significant and used for the pollution abatement.	Complied Green belt is developed along the periphery.																												
XXXIII	The company shall draw up and implement corporate social responsibility plan as per the company act of 2013.	Shall be Complied For the existing system, the company performs CSR as per the company act and after implementation of the project also the same shall be continued.																												
XXXIV	As per the ministry's office memorandum F No. 22-65/2017-IA.III dated 1 st May 2018, and proposed by the project proponent, an amount of Rs. 19.35 Lakhs @ 1.0% of project cost shall be earmarked under corporate	Complied. Year wise expenditure on environmental protection is as below:																												

	environment responsibility for the activities such as health, education, employability, and environment etc. the activities proposed under CER shall be restricted to the affected area around the project. The entire activities proposed under the CER shall be treated as project and shall be monitored. The monitoring report shall be submitted to the RO as a part of half yearly compliance report, and to the district collector. It should be posted on the website of the project proponent.	<table><tr><th>Year</th><th>Expenses (in Lacs.)</th></tr><tr><td>2020-21</td><td>10.00</td></tr><tr><td>2021-22</td><td>5.50</td></tr><tr><td>2022-23</td><td>5.00</td></tr></table>	Year	Expenses (in Lacs.)	2020-21	10.00	2021-22	5.50	2022-23	5.00
Year	Expenses (in Lacs.)									
2020-21	10.00									
2021-22	5.50									
2022-23	5.00									
XXXV	The project proponent shall also comply with the mechanism prescribed by the ministry vide letter No. Q*-16017/38/2018-CPA dated 24.10.2019 and O.M. F. No.22-23/2018-IA.III(pt.) dated 31.10.2019 for the instant project.	Noted								

B. STANDARD CONDITION:
Statutory compliance:

I.	The project proponent shall obtain forest clearance under the provisions of forest act,1980, in case of the diversion of forest land for non-forest purpose involved in the project.	Not Applicable
II.	The project proponent shall obtain clearance from the national board for wildlife, if applicable.	Not Applicable
III.	The project proponent shall prepare a site-specific conservation plan and wildlife management plan and approved by the chief wildlife warden. The recommendations of the approved site-specific conservation plan/wildlife management plan shall be implemented in consultation with the state forest department. The implementation report shall be furnished along with the six-monthly compliance report.	Not Applicable
IV.	The project proponent shall obtain CTE/CTO under the provision of air act,1981 and the water act,1974 from the concerned SPCB.	complied. We have obtained CTE from GPCB. Applied for CTO.
V.	The project proponent shall obtain the necessary permission from the central ground water authority, in case of drawl of ground water/from the competent authority concerned in case of drawl of surface water required for the project.	Complied. Currently, the borewells are sealed from September 2020. No ground water is utilized at site; water supply is from GIDC Notified Area Authority only. Ground water is utilized only when GIDC cannot supply required water.
VI.	A certificate of adequacy of available power from the agency supplying power to the project along with the load allowed for the project should be obtained.	Shall be complied. We have requested DGVCL (Power Supplying agency) to provide and said certificate attached as Annexure -1 (C).
VII.	All other statutory clearances such as the approvals for storage of diesel from chief controller of explosives, fire	Not applicable

	department, etc. shall be obtained, as applicable by project proponent from the respective competent authority.	No such clearances are required for our CETP, but if required in future, it shall be obtained.
--	---	--

I. Air quality monitoring and preservation:

I	The gaseous emission from DG set shall be dispersed through adequate stack height as per CPCB standards. Diesel generating sets shall be installed, in the downwind direction.	Complied
II	Appropriate air pollution control system shall be provided for fugitive dust from all vulnerable sources, so as to comply prescribed standards.	Noted

II. Water quality monitoring and preservation:

I	The project proponent shall install 24*7 continuous effluent monitoring system with respect to standards prescribed in environment rules 1986 as amended from time to time and connected to SPCB and CPCB online server and calibrate these system from time to time according to equipment supplier specification through labs recognized under environment act, 1986 or NABL accredited laboratories.	Complied. CEMS is installed in outlet and connected to SPCB and CPCB Server. Calibration of CEMS is done regularly
II	Total freshwater use shall not exceed the proposed requirement as provided in the project details. Prior permission from competent authority shall be obtained for use of fresh water.	Shall be Complied We are complying the same for existing operation (i.e. 2.2 MLD industrial effluent) and will comply the same after implementation of proposed project. Total water requirement of 465 KLD is met through GIDC pipeline. In case of non-availability of water from GIDC, water from borewell is drawn. NOC from CGWA for withdrawal of ground water is received.
III	There shall be flow meters at inlet and outlet of CETP to monitor the flow. Suitable meters shall be provided to measure the quantity of effluent received. Quantity of effluent recycled/reused and discharged.	Shall be Complied. Effluent is brought to CETP through tankers of 10 Kl capacity and these data are maintained. Magnetic Flow meter is installed at the outlet.

		Phosphoric Acid	450	450	470	455	450	675
		Poly Aluminum Chloride (PAC)	1406	1283	1193	1339	1317	1266
		Sodium Tripolyphosphate (STTP)	166	184	167	157	186	168
		MgCl ₂	688	841	731	771	777	678
		Caustic Soda (NaOH)	336	377	336	336	335.5 2	684.3 2
V	The CETP operator will maintain an annual register of member units which will contain the details of products with installed capacities and quality and quantity of effluents accepted for discharged. This will form a part of the initial and renewal applications for consent to operate to be made before the SPCB.	Noted						
VI	No changes in installed capacity, quantity or quality of effluents as agreed upon in the initial MOU between the operator and the member units, addition of any new member units shall be carried without prior approval of ministry.	Noted						
VII	The unit shall inform the SPCB at least a week prior to undertaking maintenance activities in the recycle system and store treated effluents under their advice in the matter.	Shall be complied. We are complying the same for existing operation (i.e., 2.2 MLD industrial effluent) and will comply the same after implementation of proposed project.						
VIII	The unit shall also immediately inform the PCB of any breakdown in the recycling system, store the effluents in the interim period and dispose effluents only as advised by the PCB.	Shall be complied. We are complying the same for existing operation (i.e. 2.2 MLD industrial effluent) and will comply the same after implementation of proposed project.						
IX	The MOU between CETP and member units shall indicate the maximum quantity of effluent to be sent to the CETP along with the quality.	Complied We are complying the same for existing operation (i.e., 2.2 MLD industrial effluent) and will comply the same after implementation of proposed project.						
X	The unit shall maintain a robust system of conveyance for primary treated effluents from the member units and constantly monitor the influent quality to the CETP.	Complied.						

	The management of the CETP and the individual member shall be jointly and severally responsible for conveyance and pre-treatment of effluents to the CETP which have a valid consent of the PCB and which meet the primary treated standards as prescribed. the CETP operator shall with the consent of the SPCB retain the powers to delink the defaulter unit from entering the conveyance system.	We are transporting primary treated effluent from small scale member industrial units in tankers and each tanker effluent is sampled and analyzed.
XI	The effluent from member units shall be transported through pipeline. In case the effluent is transported through road, it shall be transported through CETP tankers only duly maintaining proper manifest system. The vehicles shall be fitted with proper GPS system.	Shall be Complied Currently also the effluent is transported through road by CETP tankers fitted with GPS and proper manifest system.
XII	Before accepting any effluent from member units, the same shall be as permitted by the SPCB in the consent order. No effluent from any unit shall be accepted without consent from SPCB under the Water Act, 1974 as amended.	Shall be Complied We are complying the same for existing operation (i.e. 2.2 MLD industrial effluent) and will comply the same after implementation of proposed project.
XIII	Treated water shall be disposed on land for irrigation. An irrigation management plan shall be drawn up in consultation with and to the satisfaction of the SPCB.	Not Applicable
XIV	The project proponents will build operate and maintain the collection and conveyance system to transport effluents from the industrial units in consultation with and to the satisfaction of the SPCB and ensure that the industrial units meet the primary effluent standards prescribed by the SPCB.	Shall be Complied. The conveyance of effluent from member units to CETP is done through dedicated rubber lined tankers, which is approved by SPCB. We are monitoring the effluent quality of every tanker received.
XV	The SPCB will also evaluate the treatment efficiency of the effluent treatment plant and its capability of meeting the prescribed standards. The final scheme of treatment would be such as is approved by the PCB in the CTE.	Noted
XVI	The project proponents will create an institutional arrangement for the involvement of individual members in the management of the CETP.	Complied. In the board of Directors of company, two representatives are included.

III. Noise monitoring and preservation:

Noise level survey shall be carried as per the prescribed guidelines and report in this regard shall be submitted to regional officer of the ministry as a part of six-monthly compliance report.

complied.

We are complying the same for existing operation (i.e. 2.2 MLD industrial effluent) and will comply the same after implementation of 3.5 MLD industrial effluent project.

SR.NO.	DATE	LOCATION	DAY TIME NOISE MONITORING	NIGHT TIME NOISE MONITORING
			LIMIT 75 dba	LIMIT 70 dba
1	16.10.2025	Near Main Gate	59.9	47.6
		Near Decanter	58.9	50.6
		Near Aeration	65.1	64.7
		Near Secondary Clarifier-I	58.2	51.7
		Near Final Discharge	53.7	47.8
2	15.11.2025	Near Main Gate	60.5	47.7
		Near Decanter	59.1	51.4
		Near Aeration	64.5	65.2
		Near Secondary Clarifier-I	59.3	52.6
		Near Final Discharge	52.4	48.2
3	22.12.2025	Near Main Gate	64.1	49.1
		Near Decanter	61.4	50.6
		Near Aeration	65.8	63.5
		Near Secondary Clarifier-I	55.8	51.2
		Near Final Discharge	52.2	47.8
4	23.01.2026	Near Main Gate	65.2	48.6

				Near Decanter	61.7	50.8
				Near Aeration	65.2	62.9
				Near Secondary Clarifier-I	56.2	50.2
				Near Final Discharge	51.9	47.6
		5	22.02.2026	Near Main Gate	64.3	49.2
				Near Decanter	62.1	51.2
				Near Aeration	63.8	63.4
				Near Secondary Clarifier-I	55.9	51.4
				Near Final Discharge	49.6	47.4
		6	30.03.2026	Near Main Gate	65.9	46.9
				Near Decanter	62.3	52.2
				Near Aeration	65.9	64.8
				Near Secondary Clarifier-I	61.2	52.4
				Near Final Discharge	54.1	49.2
II	Noise from vehicles, power machinery and equipment should be regularly serviced. Attention should also be given to muffler maintenance and enclosure of noisy equipment's.	Complied Vehicles and machinery are monitored regularly.				
III	Acoustic enclosures for DG set, noise barriers for ground-run bays, ear plugs for operating personnel shall be implemented as mitigation measures for noise impact due to ground sources.	Complied PPEs are Provided near High noise area.				

IV. Waste management:

I	ETP sludge generated from CETP facility shall be handled and disposed to nearby authorized TSDF site as per hazardous and other wastes rules, 2016.	Complied. Unit is disposing sludge to Common TSDF –BEIL for their existing operation and will continue the same for proposed operation after implementation. Sludge disposal quantity for existing facility is under: (April'25 to September'25) Noted for compliance as the 1.8 to 3.5 MLD effluent project is not yet implemented. <table border="1"> <thead> <tr> <th>Month</th><th>Sludge Quantity (MT)</th><th>Consented Qty. in MT/Year</th></tr> </thead> <tbody> <tr> <td>October'25</td><td>337.21</td><td rowspan="6">36500</td></tr> <tr> <td>November'25</td><td>309.31</td></tr> <tr> <td>December'25</td><td>394.57</td></tr> <tr> <td>January'26</td><td>480.84</td></tr> <tr> <td>February'26</td><td>239.16</td></tr> <tr> <td>March'26</td><td>282.90</td></tr> </tbody> </table> Membership certificate of BEIL TSDF to dispose ETP sludge is attached as Annexure -1(B)	Month	Sludge Quantity (MT)	Consented Qty. in MT/Year	October'25	337.21	36500	November'25	309.31	December'25	394.57	January'26	480.84	February'26	239.16	March'26	282.90
Month	Sludge Quantity (MT)	Consented Qty. in MT/Year																
October'25	337.21	36500																
November'25	309.31																	
December'25	394.57																	
January'26	480.84																	
February'26	239.16																	
March'26	282.90																	
II	Non-hazardous solid wastes and sludge arising out of the operation of the CETP shall be adequately disposed as per the consent to be availed from the state pollution control board. Non-hazardous solid waste and sludge shall not be mixed with hazardous wastes.	Complied We are complying the same for existing operation (i.e. 2.2 MLD industrial effluent) and will comply the same after implementation of proposed project.																
III	The CETP shall have adequate power back up facility, to meet the energy requirement in case of power failure from the grid.	Complied As power back ETL has installed D G Set of 1010 KVA for smooth operation during power failure.																
IV	The site for aerobic composting shall be selected and developed in consultation with and to the satisfaction of the SPCB. Odor and inspect nuisance shall be adequately controlled.	Not applicable																
V	Any wastes from construction and demolition activities related thereto shall be managed so as to strictly conform to the construction and demolition waste, management rules, 2016.	Noted																

VI	The solid wastes shall be segregated, managed, and disposed as per the norms of the solid waste management rules,2016.	Noted
----	--	-------

V. Energy conservation measures:

I	Provide solar power generation on roof tops of buildings, for solar light system for all common areas, streetlights, parking around project area and maintain the same regularly.	Noted We are working out the viability.
II	Provide LED lights in their offices and residential areas.	complied.

VI. Green belt:

I	Green belt shall be developed in area as provided in project details, with native tree green belt shall be developed in an area equal to 33% of the plant area with a native tree species in accordance with CPCB guidelines. The greenbelt shall inter alia cover the entire periphery of the plant.	Shall be complied. There is no increase in land area for the proposed 3.5 MLD project, therefore green belt will remain the same. Trees Plantation outside the premises will be carried out to comply 33% requirement. Plant Layout attached as Annexure-1(D)
---	---	--

VII. Public hearing and human health issues:

I	Emergency preparedness plan based on the hazard identification and risk assessment and disaster management plan shall be implemented.	Complied. We have Onsite Emergency Action Plan attached as Annexure-1(E).
II	Adequate infrastructure, including power, shall be provided for emergency situations and disaster management.	Complied Adequate firefighting system is installed at site. For existing operation, as power back up, ETL has installed D G Set of 1010 KVA for smooth operation during power failure.
III	Provision shall be made for the housing of construction labour within the site with all necessary infrastructure and facilities such as fuel for cooking, mobile toilets, mobile STP, safe drinking water, medical health care, creche etc. the housing may be in the form of temporary structures to be	Noted Not Applicable. Contract Labor are not housed within the premises.

	removed after the completion of the project.	
IV	Occupational health surveillance of the workers shall be done on a regular basis.	Complied. Health surveillance of workers is carried out six monthly.

IX. Corporate Environment Responsibility:

I	The company shall have a well laid down environmental policy duly approve by the board of directors. The environmental policy should prescribe for standard operating procedures to have proper checks and balances and to bring into focus any infringements/deviation/violation of the environmental/forest/wildlife norms/ condition. The company shall have defined system of reporting infringements/deviation/violation of the environmental/forest/wildlife norms/conditions and/or shareholders/stake holders. The copy of the board resolution in this regard shall be submitted to the MoEF&CC as a part of six-monthly report.	Complied. The company has EHS policy and is implementing all aspects. The compliance status is presented in the Board of Directors meeting. A copy of Board resolution is attached as Annexure-1 (F)
II	A separate Environmental cell both at the project and company head quarter level with qualified personal shall be set up under the control of senior executive, who will directly to the head of the organization.	Complied. The EHS Head is reporting to CEO.
III	Action plan for implementing EMP and environmental conditions along with responsibility matrix of the company shall be prepared and shall be duly approved by competent authority. The year wise funds earmarked for environmental protection measures shall be kept in separate account and not to be diverted for any other purpose. Year wise progress of implementation of action plan shall be reported to the ministry/regional office along with six monthly compliance report.	Complied. Our unit is a CETP and hence all the expenditure is for the purpose of environment protection measures.

IV	Self-environmental audit shall be conducted annually. Every three years third party environmental audit shall be carried out.	Complied. An environment audit is carried out by a third party every year. The third party (Schedule – I) auditors are appointed by GPCB.
----	---	--

X. Miscellaneous:

I	The project proponent shall prominently advertise it at least in two local newspapers of the district or state, of which one shall be in the vernacular language within seven days indicating that the project has been accorded environment clearance and the details of MoEF&CC/SEIAA website where it is displayed.	Complied Having received the EC on 26 th December, we have advertised in two local newspapers (Times of India and Divya Bhaskar) on date 01 st January 2020 & 31 st December 2019 informing that the "project has been accorded EC". Copy is attached as Annexure - 1 (G)
II	The copies of the environmental clearance shall be submitted by the project proponents to the heads of local bodies, panchayats, and municipal bodies in addition to the relevant offices of the government who in turn has to display the same for 30 days from the date of receipts.	Complied We have submitted the copy of EC to concerned panchayat, Zilla Parishad/municipal Corporation, Urban Local body, and the local NGO. Acknowledgement sheet attached as Annexure-1 (H)
III	The project proponent shall upload the status of compliance of the stipulated environment clearance conditions, including results of monitored data on their website and update the same on half yearly basis.	Complied Half yearly EC Compliance report uploaded on website.
IV	The project proponent shall submit six-monthly reports on the status of the compliance of stipulated environmental conditions on the website of the ministry of Environmental, Forest and Climate change at environmental clearance portal.	Complied
V	The project proponent shall submit the environmental statement for each financial year in Form-5 to the concerned state pollution control board as prescribed under the environment rules, 1986, as amended	Complied Copy of Environmental statement for the year of 2024-25 is attached as Annexure – (I)

	subsequently and put on the website of the company.	
VI	The criteria pollutant levels or critical sectoral parameters indicated for the project shall be monitored and displayed at a convenient location near the main gate of the company in the public domain.	Complied. We are displaying information outside gate Digital display board is installed
VII	The project proponent shall inform the regional office as well as the ministry, the date of financial closure and final approval of the project by the concerned authorities, commencing the land development work and start of operation by the project.	Shall be complied.
VIII	The project authorities must strictly adhere to the stipulations made by the state pollution control board and the state government.	Noted
IX	The project proponent shall abide by all commitments and recommendations made in the EIA/EMP report, commitment made during public hearing and also that during their presentation to the expert appraisal committee.	Noted
X	No further expansion or modifications in the plant shall be carried out without prior approval of the ministry of environment, forest, and climate change.	Noted
XI	Concealing factual data or submission of false/fabricated data may result in revocation of this environment clearance and attract under the provisions of environment act 1986.	Noted
XII	The ministry may revoke or suspend the clearance, if implementation of any of the above conditions is not satisfactory.	Noted
XIII	The ministry reserves the right to stipulate additional conditions if found necessary. The company in a time	Noted

	bound manner shall implement these conditions.	
XI V	The regional office of the ministry shall monitor compliance of the stipulated conditions. The project authorities should extend full corporation to the officer of the regional office by furnishing the requisite data/information/monitoring reports.	Noted
XV	The above conditions shall be enforced, inter-alia under the provisions of the water(prevention & control of pollution) Act, 1974, the Air (prevention & control of pollution) Act, 1981, the Environment (protection) Act, 1986, Hazardous and other wastes (Management and transboundary movement)Rules, 2016 and the public liability insurance Act,1991 along with their amendments and rules and any other order passed by the Hon'ble supreme Court of India/High courts and any other court of Law relating the subject matter.	Noted
XVI	Any appeal against this EC shall lie with the national green tribunal, if preferred within a period of 30 days as prescribed under section 16 of the national green tribunal act 2010.	Noted

6. This issues with the approval of the Competent authority. – Noted.

ANNEXURE-1(A)

SRICT ENVIRONMENTAL LABORATORY

(SHROFF S R ROTARY INSTITUTE OF CHEMICAL TECHNOLOGY)

(Managed by ANKLESHWAR ROTARY EDUCATIONAL SOCIETY)

(Block No. 402, At & Post: Vataria, Ta: Valia, Dist.: Bharuch, Pin code: 393135. Phone No.:02643-290825)



TC-13941

Page 1 of 1

Group : Waste Water

ULR No. : TC1394125000000435F

Discipline : Chemical

TEST REPORT

Customer's Name & Address: M/s. Enviro Technology Ltd Plot no. 2413/14, GIDC Estate, Ankleshwar, Dist: Bharuch. Contact Person: Mr. Dipak Meghapara	Report No : SEL/20251017/A-C Issue Date : 29/10/2025
---	---


Contact Person: Mr. Dipak Meghnapara		Issue Date: 29/10/2025	
Lab Id Code	:	SRICT/20251017/A-001	
Sample Description	:	Final O/L-001	Purpose : Testing
Date of Sample Received	:	17/10/2025	Test parameter : As mentioned by customer
Date of Starting Analysis	:	17/10/2025	Quantity : 2 Lit
Date of Completion Analysis	:	29/10/2025	Packed/Seal : Sealed

Sr. No.	Parameter	Unit	Result	Acceptable Criteria	Test Method
1	pH	--	7.6	6.5 to 8.5	IS:3025(Part-11)2022
2	Total Suspended Solids	mg/L	132	150	IS:3025(Part-17)2022
3	Total Dissolved Solid	mg/L	20125	10000	IS:3025(Part-16)2023
4	COD	mg/L	810	1000	IS:3025(Part-58)2023
	l Phenol	mg/L	0.59	5	APHA 5530-D, 23 rd Ed.:2017
6	Ammonical Nitrogen	mg/L	33.6	50	IS:3025(Part-34/Section 1)2023
7	Chloride	mg/L	9358.09	1000	IS:3025(Part-32)1988

Note: Results shown in Bold are found above Permissible Limit.

Terms and conditions governing the test report issued

1. Sample is not drawn by SEL; the results are applicable only to the drawn samples.
2. The test report shall not be reproduced in full or part without the written approval of the SRICT Environmental Laboratory.
3. The test report in full or part shall not be used for promotional or publicity purpose without the written consent of SRICT Environmental Laboratory.
4. Water/Waste water samples shall be stored for the period of one month after the date of issue of Report.

END OF REPORTFor, SRICT Environmental Laboratory
Authorized Signatory

Dr. Snehal Lokhandwala
(Quality Manager)

Block No:402, At: Vataria, Ankleshwar-Valia Road, Ta: Valia, Dist: Bharuch
Phone No:02643-290825,9712177799, Mo: 9727745875/876 E-mail:hr.srict@gmail.com, www.srict.in



SRICT ENVIRONMENTAL LABORATORY

(SHROFF S R ROTARY INSTITUTE OF CHEMICAL TECHNOLOGY)

(Managed by ANKLESHWAR ROTARY EDUCATIONAL SOCIETY)

(Block No. 402, At & Post: Vataria, Ta: Valia, Dist.: Bharuch, Pin code: 393135. Phone No.:02643-290825)

Page 1 of 2

Group : Waste Water
Discipline : Chemical

TEST REPORT

Customer's Name & Address: M/s. Enviro Technology Ltd Plot no. 2413/14, GIDC Estate, Ankleshwar, Dist: Bharuch. Contact Person: Mr. Dipak Meghapara	Report No : SEL/20251017/A-001 Issue Date : 29/10/2025
---	---

Contact Person: Mr. Dhanraj Singh					
Lab Id Code	:	SRICT/20251017/A-001			
Sample Description	:	Final O/L-001	Purpose	:	Testing
Date of Sample Received	:	17/10/2025	Test parameter	:	As mentioned by customer
Date of Starting Analysis	:	17/10/2025	Quantity	:	2 Lit
Date of Completion Analysis	:	29/10/2025	Packed/Seal	:	Sealed

Sr. No.	Parameter	Unit	Result	Permissible Limit (If Applicable)	Test Method
1	Temperature	°C	26	40	APHA 2550, 23 rd Ed:2017
2	BOD	mg/L	14	200	IS:3025(Part-44)2023
3	Total Kjeldahl Nitrogen	mg/L	44.24	50	APHA-4500-N _{org} -B, 23 rd Ed:2017
4	Phosphate	mg/L	5.35	5	IS3025(P-31):1988
5	Cyanide	mg/L	< 0.1	0.2	APHA 4500-B, 23 rd Ed:2017
6	Fluorides	mg/L	7.01	15	APHA 4500-F-D, 23 rd Ed:2017
7	Oil & Grease	mg/L	< 2.0	10	APHA 5520-B, 23 rd Ed.:2017
8	Sulphide	mg/L	< 1.0	5	APHA 4500-S-2-F, 23 rd Ed.:2017
9	Hexavalent Chromium	mg/L	< 0.1	0.1	APHA 3500Cr-B, 23 rd Ed:2017
10	Total Chromium	mg/L	0.4	2	APHA 3111-B, 23 rd Ed:2017
11	Copper	mg/L	1.06	3	APHA 3111-CU-B, 23 rd Ed:2017
12	Nickel	mg/L	0.24	3	APHA 3111-Ni-B, 23 rd Ed:2017
13	Zinc	mg/L	2.56	15	APHA 3111-Zn-B, 23 rd Ed:2017
14	Iron	mg/L	1.15	3	IS:3025(Part-53)2024
15	Manganese	mg/L	0.37	2	APHA 3111-A, 23 rd Ed:2017
16	Mercury	mg/L	< 0.001	0.01	APHA 3112-Hg-B, 23 rd Ed:2017
17	Lead	mg/L	< 0.05	0.1	APHA 3111-Pb-B, 23 rd Ed:2017
18	Arsenic	mg/L	< 0.005	0.2	APHA 3111-AS-B, 23 rd Ed:2017
19	Vanadium	mg/L	< 0.1	0.2	APHA 3500-V-B, 23 rd Ed:2017
20	Cadmium	mg/L	< 0.02	0.05	APHA 3111-Cd B, 23 rd Ed:2017
21	Selenium	mg/L	< 0.004	0.05	APHA 3500-Se, B-C, 23 rd Ed:2017
22	Color	Hazen	8236	100	APHA 2120-C, 23 rd Ed:2017
23	Sulphate	mg/L	3485	1000	APHA 4500-SO ₄ -E, 23 rd Ed:2017
24	Insecticide/Pesticides	mg/L	Absent	Absent	Pesticides & Insecticides Ref. USEPA 508,525.2



SRICT ENVIRONMENTAL LABORATORY

(SHROFF S R ROTARY INSTITUTE OF CHEMICAL TECHNOLOGY)

(Managed by ANKLESHWAR ROTARY EDUCATIONAL SOCIETY)

(Block No. 402, At & Post: Vataria, Ta: Valia, Dist.: Bharuch, Pin code: 393135. Phone No.:02643-290825)

Page 2 of 2

Remark: Results shown in Bold are found above Permissible Limit.

Terms and conditions governing the test report issued

1. Sample is not drawn by SEL; the results are applicable only to the drawn samples.
2. The test report shall not be reproduced in full or part without the written approval of the SRICT Environmental Laboratory.
3. The test report in full or part shall not be used for promotional or publicity purpose without the written consent of SRICT Environmental Laboratory.
4. Water/Waste water samples shall be stored for the period of one month after the date of issue of Report.

END OF REPORT

For SRICT Environmental Laboratory
Authorized Signatory


Dr. Sheha Lekhandwala
(Quality Manager)

SRICT

SRICT ENVIRONMENTAL LABORATORY

(SHROFF S R ROTARY INSTITUTE OF CHEMICAL TECHNOLOGY)

(Managed by ANKLESHWAR ROTARY EDUCATIONAL SOCIETY)

(Block No. 402, At & Post: Vataria, Ta: Valia, Dist.: Bharuch, Pin code: 393135. Phone No.: 02643-290825)



TC-13941

Page 1 of 1

Group : Waste Water
Discipline : Chemical

ULR No. : TC139412500000474F

TEST REPORT

Customer's Name & Address: M/s. Enviro Technology Ltd Plot no. 2413/14, GIDC Estate, Ankleshwar, Dist: Bharuch. Contact Person: Mr. Dipak Meghapara	Report No : SEL/20251113/A1-001 Issue Date : 17/11/2025
---	--

Contact Person: Mr. Dipak Meghpara					
Lab Id Code	:	SRIC/20251113/A1-001			
Sample Description	:	Final O/L-001	Purpose	:	Testing
Date of Sample Received	:	13/11/2025	Test parameter	:	As mentioned by customer
Date of Starting Analysis	:	14/11/2025	Quantity	:	2 Lit
Date of Completion Analysis	:	17/11/2025	Packed/Seal	:	Sealed

Sr. No.	Parameter	Unit	Result	Acceptable Criteria	Test Method
1	pH	--	7.98	6.5 to 8.5	IS:3025(Part-11)2022
2	Total Suspended Solids	mg/L	116	150	IS:3025(Part-17)2022
3	Total Dissolved Solid	mg/L	16593	10000	IS:3025(Part-16)2023
4	COD	mg/L	800	1000	IS:3025(Part-58)2023
5	Total Phenol	mg/L	0.14	5	APHA 5530-D, 23 rd Ed.:2017
6	Ammonical Nitrogen	mg/L	28	50	IS:3025(Part-34/Section 1)2023
7	Chloride	mg/L	9332.21	1000	IS:3025(Part-32)1988

Note: Results shown in Bold are found above Permissible Limit.

Terms and conditions governing the test report issued

1. Sample is not drawn by SEL; the results are applicable only to the drawn samples.
2. The test report shall not be reproduced in full or part without the written approval of the SRICT Environmental Laboratory.
3. The test report in full or part shall not be used for promotional or publicity purpose without the written consent of SRICT Environmental Laboratory.
4. Water/Waste water samples shall be stored for the period of one month after the date of issue of Report.

END OF REPORT

For, SRICT Environmental Laboratory

Authorized Signatory


Dr. Snehal Lokhandwala
(Quality Manager)

Block No:402, At: Vataria, Ankleshwar-Valia Road, Ta: Valia, Dist: Bharuch

Phone No: 02643-290825, 9712177799, Mo: 9727745875/876 E-mail: srict@gmail.com, www.srict.in



AnyScanner

SRICT

SRICT ENVIRONMENTAL LABORATORY

(SHROFF S R ROTARY INSTITUTE OF CHEMICAL TECHNOLOGY)

(Managed by ANKLESHWAR ROTARY EDUCATIONAL SOCIETY)

(Block No. 402, At & Post: Vataria, Ta: Valia, Dist.: Bharuch, Pin code: 393135. Phone No.:02643-290825)

Page 1 of 2

Group : Waste Water
Discipline : Chemical

TEST REPORT

Customer's Name & Address: M/s. Enviro Technology Ltd Plot no. 2413 14, GIDC Estate, Ankleshwar, Dist: Bharuch. Contact Person: Mr. Dipak Meghapara	Report No : SEL/20251113/A1-001 Issue Date : 17/11/2025
---	--

Lab Id Code	:	SRICT/20251113/A-001			
Sample Description	:	Final O/L-001	Purpose	:	Testing
Date of Sample Received	:	13/11/2025	Test parameter	:	As mentioned by customer
Date of Starting Analysis	:	14/11/2025	Quantity	:	2 Lit
Date of Completion Analysis	:	17/11/2025	Packed/Seal	:	Sealed

Sr. No.	Parameter	Unit	Result	Permissible Limit (If Applicable)	Test Method
1	Temperature	°C	25	40	APHA 2550,23 rd Ed:2017
2	BOD	mg/L	18	200	IS:3025(Part-44)2023
3	Total Kjeldahl Nitrogen	mg/L	33.6	50	APHA-4500-N _{org} -B,23 rd Ed:2017
4	Phosphate	mg/L	2	5	IS3025(P-31):1988
5	Cyanide	mg/L	< 0.1	0.2	APHA 4500-B,23 rd Ed:2017
6	Fluorides	mg/L	2.56	15	APHA 4500-F-D,23 rd Ed:2017
7	Oil & Grease	mg/L	< 2.0	10	APHA 5520-B,23 rd Ed.:2017
8	Sulphide	mg/L	< 1.0	5	APHA 4500-S-2-F,23 rd Ed.:2017
9	Hexavalent Chromium	mg/L	< 0.1	0.1	APHA 3500Cr-B,23 rd Ed:2017
10	Total Chromium	mg/L	0.19	2	APHA 3111-B,23 rd Ed:2017
11	Copper	mg/L	0.66	3	APHA 3111-CU-B,23 rd Ed:2017
12	Nickel	mg/L	0.082	3	APHA 3111-Ni-B,23 rd Ed:2017
13	Zinc	mg/L	1.15	15	APHA 3111-Zn-B,23 rd Ed:2017
14	Iron	mg/L	2.10	3	IS:3025(Part-53)2024
15	Manganese	mg/L	0.086	2	APHA 3111-A,23 rd Ed:2017
16	Mercury	mg/L	< 0.001	0.01	APHA 3112-Hg-B,23 rd Ed:2017
17	Lead	mg/L	< 0.05	0.1	APHA 3111-Pb-B,23 rd Ed:2017
18	Arsenic	mg/L	< 0.005	0.2	APHA 3111-AS-B,23 rd Ed:2017
19	Vanadium	mg/L	< 0.1	0.2	APHA 3500-V-B,23 rd Ed:2017
20	Cadmium	mg/L	< 0.02	0.05	APHA 3111-Cd B,23 rd Ed:2017
21	Selenium	mg/L	< 0.004	0.05	APHA 3500-Se,B-C,23 rd Ed:2017
22	Color	Hazen	8934	100	APHA 2120-C,23 rd Ed:2017
23	Sulphate	mg/L	2861	1000	APHA 4500-SO ₄ -E,23 rd Ed:2017
24	Insecticide Pesticides	mg/L	Absent	Absent	Pesticides & Insecticides Ref,USEPA 508,525.2

Remark: Results shown in Bold are found above Permissible Limit.

SRIT

SRICT ENVIRONMENTAL LABORATORY

(SHROFF S R ROTARY INSTITUTE OF CHEMICAL TECHNOLOGY)
(Managed by ANKLESHWAR ROTARY EDUCATIONAL SOCIETY)
(Block No. 402, At & Post: Vataria, Ta: Valia, Dist.: Bharuch, Pin code: 393135. Phone No.:02643-290825)


Page 2 of 2

Terms and conditions governing the test report issued

1. Sample is not drawn by SEL; the results are applicable only to the drawn samples.
2. The test report shall not be reproduced in full or part without the written approval of the SRICT Environmental Laboratory.
3. The test report in full or part shall not be used for promotional or publicity purpose without the written consent of SRICT Environmental Laboratory.
4. Water Waste water samples shall be stored for the period of one month after the date of issue of Report.

END OF REPORT

For SRICT Environmental Laboratory
Authorized Signatory


Dr. Snehal Lokhandwala
(Quality Manager)

SRICT ENVIRONMENTAL LABORATORY

(SHROFF S R ROTARY INSTITUTE OF CHEMICAL TECHNOLOGY)

(Managed by ANKLESHWAR ROTARY EDUCATIONAL SOCIETY)

(Block No. 402, At & Post: Vataria, Ta: Valia, Dist.: Bharuch, Pin code: 393135. Phone No.:02643-290825)



TC-13941

Page 1 of 1

Group : Waste Water
Discipline : Chemical

ULR No. : TC139412500000508F

TEST REPORT

Customer's Name & Address: M/s. Enviro Technology Ltd Plot no. 2426 14, GIDC Estate, Ankleshwar, Dist: Bharuch. Contact Person: Mr. Dipak Meghapara	Report No : SEL/20251203/A1-001 Issue Date : 06/12/2025
---	--

Lab Id Code	:	SRICT/20251203/A1-001			
Sample Description	:	Final O/L-001	Purpose	:	Testing
Date of Sample Received	:	03/12/2025	Test parameter	:	As mentioned by customer
Date of Starting Analysis	:	03/12/2025	Quantity	:	2 Lit
Date of Completion Analysis	:	06/12/2025	Packed/Seal	:	Sealed

Sr. No.	Parameter	Unit	Result	Acceptable Criteria	Test Method
1	pH	--	7.2	6.5 to 8.5	IS:3025(Part-11)2022
2	Total Suspended Solids	mg/L	105	150	IS:3025(Part-17)2022
3	Total Dissolved Solid	mg/L	15826	10000	IS:3025(Part-16)2023
4	COD	mg/L	798.4	1000	IS:3025(Part-58)2023
5	Total Phenol	mg/L	0.29	5	APHA 5530-D, 23 rd Ed.:2017
6	Ammonical Nitrogen	mg/L	27.44	50	IS:3025(Part-34/Section 1)2023
7	Chloride	mg/L	9318.58	1000	IS:3025(Part-32)1988

Note: Results shown in Bold are found above Permissible Limit.


Terms and conditions governing the test report issued

1. Sample is not drawn by SEL; the results are applicable only to the drawn samples.
2. The test report shall not be reproduced in full or part without the written approval of the SRICT Environmental Laboratory.
3. The test report in full or part shall not be used for promotional or publicity purpose without the written consent of SRICT Environmental Laboratory.
4. Water/Waste water samples shall be stored for the period of one month after the date of issue of Report.

END OF REPORT

For, SRICT Environmental Laboratory

Authorized Signatory


Dr. Snehal Lokhandwala
(Quality Manager)

Block No:402, At: Vataria, Ankleshwar-Valia Road, Ta: Valia, Dist: Bharuch
Phone No:02643-290825,9712177799, Mo: 9727745875/876 E-mail:hr.srict@gmail.com, www.srict.in

Group : Waste Water
Discipline : Chemical

TEST REPORT

Customer's Name & Address: M/s. Enviro Technology Ltd Plot no. 2426/14, GIDC Estate, Ankleshwar, Dist: Bharuch. Contact Person: Mr. Dipak Meghapara	Report No : SEL/20251203/A1-001 Issue Date : 06/12/2025
---	--

Lab Id Code	:	SRICT/20251203/A-001			
Sample Description	:	Final O/L-001	Purpose	:	Testing
Date of Sample Received	:	03/12/2025	Test parameter	:	As mentioned by customer
Date of Starting Analysis	:	03/12/2025	Quantity	:	2 Lit
Date of Completion Analysis	:	06/12/2025	Packed/Seal	:	Sealed

Sr. No.	Parameter	Unit	Result	Permissible Limit (If Applicable)	Test Method
1	Temperature	°C	25	40	APHA 2550,23 rd Ed:2017
2	BOD	mg/L	18	200	IS:3025(Part-44)2023
3	Total Kjeldahl Nitrogen	mg/L	34.16	50	APHA-4500-N _{org} -B,23 rd Ed:2017
4	Phosphate	mg/L	1.28	5.0	IS3025(P-31):1988
5	Cyanide	mg/L	< 0.1	0.2	APHA 4500-B,23 rd Ed:2017
6	Fluorides	mg/L	3	15	APHA 4500-F-D,23 rd Ed:2017
7	Oil & Grease	mg/L	< 2.0	10	APHA 5520-B,23 rd Ed.:2017
8	Sulphide	mg/L	< 1.0	5.0	APHA 4500-S-2-F,23 rd Ed.:2017
9	Hexavalent Chromium	mg/L	< 0.1	0.1	APHA 3500Cr-B,23 rd Ed:2017
10	Total Chromium	mg/L	< 0.5	2.0	APHA 3111-B,23 rd Ed:2017
11	Copper	mg/L	0.23	3.0	APHA 3111-CU-B,23 rd Ed:2017
12	Nickel	mg/L	0.085	3.0	APHA 3111-Ni-B,23 rd Ed:2017
13	Zinc	mg/L	1	15	APHA 3111-Zn-B,23 rd Ed:2017
14	Iron	mg/L	1.94	3.0	IS:3025(Part-53)2024
15	Manganese	mg/L	0.062	2.0	APHA 3111-A,23 rd Ed:2017
16	Mercury	mg/L	< 0.01	0.01	APHA 3112-Hg-B,23 rd Ed:2017
17	Lead	mg/L	< 0.5	0.1	APHA 3111-Pb-B,23 rd Ed:2017
18	Arsenic	mg/L	< 0.01	0.2	APHA 3111-AS-B,23 rd Ed:2017
19	Vanadium	mg/L	< 5.0	0.2	APHA 3500-V-B,23 rd Ed:2017
20	Cadmium	mg/L	< 0.1	0.05	APHA 3111-Cd B,23 rd Ed:2017
21	Selenium	mg/L	< 0.01	0.05	APHA 3500-Se,B-C,23 rd Ed:2017
22	Color	Hazen	8930	100	APHA 2120-C,23 rd Ed:2017
23	Sulphate	mg/L	2846	1000	APHA 4500-SO ₄ -E,23 rd Ed:2017
24	Insecticide/Pesticides	mg/L	Absent	Absent	Pesticides & Insecticides Ref,USEPA 508,525.2

Remark: Results shown in Bold are found above Permissible Limit.

SRICT

SRICT ENVIRONMENTAL LABORATORY

(SHROFF S R ROTARY INSTITUTE OF CHEMICAL TECHNOLOGY)

(Managed by ANKLESHWAR ROTARY EDUCATIONAL SOCIETY)

(Block No. 402, At & Post: Vataria, Ta: Valia, Dist.: Bharuch, Pin code: 393135. Phone No.:02643-290825)


Page 2 of 2

Terms and conditions governing the test report issued

1. Sample is not drawn by SEL; the results are applicable only to the drawn samples.
2. The test report shall not be reproduced in full or part without the written approval of the SRICT Environmental Laboratory.
3. The test report in full or part shall not be used for promotional or publicity purpose without the written consent of SRICT Environmental Laboratory.
4. Water/Waste water samples shall be stored for the period of one month after the date of issue of Report.

END OF REPORT

For SRICT Environmental Laboratory
Authorized Signatory


Dr. Sneha Lokhandwala
(Quality Manager)

SRICT SRICT ENVIRONMENTAL LABORATORY

(SHROFF S R ROTARY INSTITUTE OF CHEMICAL TECHNOLOGY)

(Managed by ANKLESHWAR ROTARY EDUCATIONAL SOCIETY)

(Block No. 402, At & Post: Vataria, Ta: Valia, Dist.: Bharuch, Pin code: 393135. Phone No.:02643-290825)



TC-13941

Page 1 of 1

Group : Waste Water
Discipline : Chemical

ULR No. : TC139412600000001F

TEST REPORT

Customer's Name & Address: M/s. Enviro Technology Ltd Plot no. 2426/14, GIDC Estate, Ankleshwar, Dist: Bharuch. Contact Person: Mr. Dipak Meghapara				Report No : SEL/20260101/A1-001	
Lab Id Code				Issue Date : 06/01/2026	
Sample Description		Final O/L-001	Purpose	Testing	
Date of Sample Received		01/01/2026	Test parameter	As mentioned by customer	
Date of Starting Analysis		02/01/2026	Quantity	2 Lit	
Date of Completion Analysis		05/01/2026	Packed/Seal	Sealed	
Sr. No.	Parameter	Unit	Result	Acceptable Criteria	Test Method
1	pH	--	7.6	6.5 to 8.5	IS:3025(Part-11)2022
2	Total Suspended Solids	mg/L	98	150	IS:3025(Part-17)2022
3	Total Dissolved Solid	mg/L	15825	10000	IS:3025(Part-16)2023
4	COD	mg/L	840	1000	IS:3025(Part-58)2023
5	Total Phenol	mg/L	0.2	5	APHA 5530-D,23 rd Ed.:2017
6	Ammonical Nitrogen	mg/L	29.68	50	IS:3025(Part-34/Section 1)2023
7	Chloride	mg/L	9358.09	1000	IS:3025(Part-32):2025


Note: Results shown in Bold are found above Permissible Limit.

Terms and conditions governing the test report issued

1. Sample is not drawn by SEL; the results are applicable only to the drawn samples.
2. The test report shall not be reproduced in full or part without the written approval of the SRICT Environmental Laboratory.
3. The test report in full or part shall not be used for promotional or publicity purpose without the written consent of SRICT Environmental Laboratory.
4. Water/Waste water samples shall be stored for the period of one month after the date of issue of Report.

END OF REPORT

For, SRICT Environmental Laboratory
Authorized Signatory


Dr. Snehal Lokhandwala
(Quality Manager)

Block No:402, At: Vataria, Ankleshwar-Valia Road, Ta: Valia, Dist: Bharuch
Phone No:02643-290825,9712177799, Mo: 9727745875/876 E-mail:hr.srict@gmail.com, www.srict.in

SRICT

SRICT ENVIRONMENTAL LABORATORY

(SHROFF S R ROTARY INSTITUTE OF CHEMICAL TECHNOLOGY)

(Managed by ANKLESHWAR ROTARY EDUCATIONAL SOCIETY)

(Block No. 402, At & Post: Vataria, Ta: Valia, Dist.: Bharuch, Pin code: 393135. Phone No.:02643-290825)

Page 1 of 2

Group : Waste Water
Discipline : Chemical

TEST REPORT

Customer's Name & Address: M/s. Enviro Technology Ltd
Plot no. 2426/14, GIDC Estate, Ankleshwar, Dist: Bharuch.
Contact Person: Mr. Dipak Meghapara

Report No : SEL/20260101/A1-001

Issue Date : 06/01/2026

Lab Id Code	:	SRICT/20260101/A1-001			
Sample Description	:	Final O/L-001	Purpose	:	Testing
Date of Sample Received	:	01/01/2026	Test parameter	:	As mentioned by customer
Date of Starting Analysis	:	02/01/2026	Quantity	:	2 Lit
Date of Completion Analysis	:	05/01/2026	Packed/Seal	:	Sealed

Sr. No.	Parameter	Unit	Result	Permissible Limit (If Applicable)	Test Method
1	Temperature	°C	23.9	40	APHA 2550,23 rd Ed:2017
2	BOD	mg/L	21	200	IS:3025(Part-44)2023
3	Total Kjeldahl Nitrogen	mg/L	37.52	50	APHA-4500-N _{org} -B,23 rd Ed:2017
4	Phosphate	mg/L	0.82	5.0	IS3025(P-31):1988
5	Cyanide	mg/L	< 0.1	0.2	APHA 4500-B,23 rd Ed:2017
6	Fluorides	mg/L	2.01	15	APHA 4500-F-D,23 rd Ed:2017
7	Oil & Grease	mg/L	< 2.0	10	APHA 5520-B,23 rd Ed.:2017
8	Sulphide	mg/L	< 1.0	5.0	APHA 4500-S-2-F,23 rd Ed.:2017
9	Hexavalent Chromium	mg/L	< 0.1	0.1	APHA 3500Cr-B,23 rd Ed:2017
10	Total Chromium	mg/L	< 0.5	2.0	APHA 3111-B,23 rd Ed:2017
11	Copper	mg/L	0.19	3.0	APHA 3111-CU-B,23 rd Ed:2017
12	Nickel	mg/L	0.09	3.0	APHA 3111-Ni-B,23 rd Ed:2017
13	Zinc	mg/L	1.03	15	APHA 3111-Zn-B,23 rd Ed:2017
14	Iron	mg/L	0.69	3.0	IS:3025(Part-53)2024
15	Manganese	mg/L	0.08	2.0	APHA 3111-A,23 rd Ed:2017
16	Mercury	mg/L	< 0.01	0.01	APHA 3112-Hg-B,23 rd Ed:2017
17	Lead	mg/L	< 0.5	0.1	APHA 3111-Pb-B,23 rd Ed:2017
18	Arsenic	mg/L	< 0.01	0.2	APHA 3111-AS-B,23 rd Ed:2017
19	Vanadium	mg/L	< 5.0	0.2	APHA 3500-V-B,23 rd Ed:2017
20	Cadmium	mg/L	< 0.1	0.05	APHA 3111-Cd B,23 rd Ed:2017
21	Selenium	mg/L	< 0.01	0.05	APHA 3500-Se,B-C,23 rd Ed:2017
22	Color	Hazen	9223	100	APHA 2120-C,23 rd Ed:2017
23	Sulphate	mg/L	2541	1000	APHA 4500-SO ₄ -E,23 rd Ed:2017
24	Insecticide/Pesticides	mg/L	Absent	Absent	Pesticides & Insecticides Ref,USEPA 508,525.2

Remark: Results shown in Bold are found above Permissible Limit.

SRICT

SRICT ENVIRONMENTAL LABORATORY

(SHROFF S R ROTARY INSTITUTE OF CHEMICAL TECHNOLOGY)

(Managed by ANKLESHWAR ROTARY EDUCATIONAL SOCIETY)

(Block No. 402, At & Post: Vataria, Ta: Valia, Dist.: Bharuch, Pin code: 393135. Phone No.:02643-290825)


Page 2 of 2


Terms and conditions governing the test report issued

1. Sample is not drawn by SEL; the results are applicable only to the drawn samples.
2. The test report shall not be reproduced in full or part without the written approval of the SRICT Environmental Laboratory.
3. The test report in full or part shall not be used for promotional or publicity purpose without the written consent of SRICT Environmental Laboratory.
4. Water/Waste water samples shall be stored for the period of one month after the date of issue of Report.

END OF REPORT

For SRICT Environmental Laboratory
Authorized Signatory


Dr. Snehal Lokhandwala
(Quality Manager)



Group : Waste Water
Discipline : Chemical

ULR No. : TC1394126000000060F

TEST REPORT

Customer's Name & Address: M/s. Enviro Technology Ltd Plot no. 2426/14, GIDC Estate, Ankleshwar, Dist: Bharuch. Contact Person: Mr. Dipak Meghapara				Report No : SEL/20260212/A1-001 Issue Date : 18/02/2026	
Lab Id Code		: SRICT/20260212/A1-001			
Sample Description		: Final O/L-001	Purpose	:	Testing
Date of Sample Received		: 12/02/2026	Test parameter	:	As mentioned by customer
Date of Starting Analysis		: 13/02/2026	Quantity	:	2 Lit
Date of Completion Analysis		: 17/02/2026	Packed/Seal	:	Sealed

Sr. No.	Parameter	Unit	Result	Acceptable Criteria	Test Method
1	pH	--	6.9	6.5 to 8.5	IS:3025(Part-11)2022
2	Total Suspended Solids	mg/L	101	150	IS:3025(Part-17)2022
3	Total Dissolved Solid	mg/L	16285	10000	IS:3025(Part-16)2023
4	COD	mg/L	798.4	1000	IS:3025(Part-58)2023
5	Total Phenol	mg/L	0.15	5	APHA 5530-D,23 rd Ed.:2017
6	Ammonical Nitrogen	mg/L	29.12	50	IS:3025(Part-34/Section 1)2023
7	Chloride	mg/L	9263.08	1000	IS:3025(Part-32):2025


Note: Results shown in Bold are found above Permissible Limit.

Terms and conditions governing the test report issued

1. Sample is not drawn by SEL; the results are applicable only to the drawn samples.
2. The test report shall not be reproduced in full or part without the written approval of the SRICT Environmental Laboratory.
3. The test report in full or part shall not be used for promotional or publicity purpose without the written consent of SRICT Environmental Laboratory.
4. Water/Waste water samples shall be stored for the period of one month after the date of issue of Report.

END OF REPORT

For, SRICT Environmental Laboratory
Authorized Signatory


Dr. Snehal Lokhandwala
(Quality Manager)

Group : Waste Water

Discipline : Chemical

TEST REPORT

Customer's Name & Address: M/s. Enviro Technology Ltd Plot no. 2426/14, GIDC Estate, Ankleshwar, Dist: Bharuch. Contact Person: Mr. Dipak Meghapara	Report No : SEL/20260212/A1-001 Issue Date : 18/02/2026
---	--

Lab Id Code	:	SRICT/20260212/A1-001			
Sample Description	:	Final O/L-001	Purpose	:	Testing
Date of Sample Received	:	12/02/2026	Test parameter	:	As mentioned by customer
Date of Starting Analysis	:	13/02/2026	Quantity	:	2 Lit
Date of Completion Analysis	:	17/02/2026	Packed/Seal	:	Sealed

Sr. No.	Parameter	Unit	Result	Permissible Limit (If Applicable)	Test Method
1	Temperature	°C	26	40	APHA 2550, 23 rd Ed:2017
2	BOD	mg/L	18	200	IS:3025(Part-44)2023
3	Total Kjeldahl Nitrogen	mg/L	36.4	50	APHA-4500-N _{org} -B, 23 rd Ed:2017
4	Phosphate	mg/L	0.65	5.0	IS3025(P-31):1988
5	Cyanide	mg/L	< 0.1	0.2	APHA 4500-B, 23 rd Ed:2017
6	Fluorides	mg/L	2.03	15	APHA 4500-F-D, 23 rd Ed:2017
7	Oil & Grease	mg/L	< 2.0	10	APHA 5520-B, 23 rd Ed.:2017
8	Sulphide	mg/L	< 1.0	5.0	APHA 4500-S-2-F, 23 rd Ed.:2017
9	Hexavalent Chromium	mg/L	< 0.1	0.1	APHA 3500Cr-B, 23 rd Ed:2017
10	Total Chromium	mg/L	< 0.5	2.0	APHA 3111-B, 23 rd Ed:2017
11	Copper	mg/L	0.16	3.0	APHA 3111-CU-B, 23 rd Ed:2017
12	Nickel	mg/L	0.07	3.0	APHA 3111-Ni-B, 23 rd Ed:2017
13	Zinc	mg/L	1.06	15	APHA 3111-Zn-B, 23 rd Ed:2017
14	Iron	mg/L	0.78	3.0	IS:3025(Part-53)2024
15	Manganese	mg/L	0.08	2.0	APHA 3111-A, 23 rd Ed:2017
16	Mercury	mg/L	< 0.01	0.01	APHA 3112-Hg-B, 23 rd Ed:2017
17	Lead	mg/L	< 0.5	0.1	APHA 3111-Pb-B, 23 rd Ed:2017
18	Arsenic	mg/L	< 0.01	0.2	APHA 3111-AS-B, 23 rd Ed:2017
19	Vanadium	mg/L	< 5.0	0.2	APIIA 3500-V-B, 23 rd Ed:2017
20	Cadmium	mg/L	< 0.1	0.05	APHA 3111-Cd B, 23 rd Ed:2017
21	Selenium	mg/L	< 0.01	0.05	APHA 3500-Se, B-C, 23 rd Ed:2017
22	Color	Hazen	9275	100	APHA 2120-C, 23 rd Ed:2017
23	Sulphate	mg/L	2632	1000	APHA 4500-SO ₄ -E, 23 rd Ed:2017
24	Insecticide/Pesticides	mg/L	Absent	Absent	Pesticides & Insecticides Ref, USEPA 508, 525.2

Remark: Results shown in Bold are found above Permissible Limit.

SRICT

SRICT ENVIRONMENTAL LABORATORY

(SHROFF S R ROTARY INSTITUTE OF CHEMICAL TECHNOLOGY)

(Managed by ANKLESHWAR ROTARY EDUCATIONAL SOCIETY)

(Block No. 402, At & Post: Vataria, Ta: Valia, Dist.: Bharuch, Pin code: 393135. Phone No.:02643-290825)

Page 2 of 2


Terms and conditions governing the test report issued

1. Sample is not drawn by SEL; the results are applicable only to the drawn samples.
2. The test report shall not be reproduced in full or part without the written approval of the SRICT Environmental Laboratory.
3. The test report in full or part shall not be used for promotional or publicity purpose without the written consent of SRICT Environmental Laboratory.
4. Water/Waste water samples shall be stored for the period of one month after the date of issue of Report.

END OF REPORT

For SRICT Environmental Laboratory

Authorized Signatory


Dr. Snehal Lokhandwala
(Quality Manager)

SRICT

SRICT ENVIRONMENTAL LABORATORY

(SHROFF S R ROTARY INSTITUTE OF CHEMICAL TECHNOLOGY)
(Managed by ANKLESHWAR ROTARY EDUCATIONAL SOCIETY)

(Block No. 402, At & Post: Vataria, Ta: Valia, Dist.: Bharuch, Pin code: 393135. Phone No.:02643-290825)



TC-13941

Page 1 of 1

ULR No. : TC139412600000118F

Group : Waste Water
Discipline : Chemical

TEST REPORT

Customer's Name & Address: M/s. Enviro Technology Ltd Plot no. 2426/14, GIDC Estate, Ankleshwar, Dist: Bharuch. Contact Person: Mr. Dipak Meghapara	Report No : SEL/20260313/A1-001 Issue Date : 19/03/2026
---	--

Lab Id Code	:	SRICT/20260313/A1-001
Sample Description	:	Final O/L-001
Date of Sample Received	:	13/03/2026
Date of Starting Analysis	:	16/03/2026
Date of Completion Analysis	:	19/03/2026
Purpose	:	Testing
Test parameter	:	As mentioned by customer
Quantity	:	2 Lit
Packed/Seal	:	Sealed

Sr. No.	Parameter	Unit	Result	Acceptable Criteria	Test Method
1	pH	--	6.8	6.5 to 8.5	IS:3025(Part-11)2022
2	Total Suspended Solids	mg/L	98	150	IS:3025(Part-17)2022
3	Total Dissolved Solid	mg/L	15362	10000	IS:3025(Part-16)2023
4	COD	mg/L	792	1000	IS:3025(Part-58)2023
5	BOD	mg/L	21	200	IS:3025(Part-44)2023
6	Total Phenol	mg/L	0.31	5	APHA 5530-D, 23 rd Ed.:2017
7	Ammonical Nitrogen	mg/L	28	50	IS:3025(Part-34/Section 1)2023
8	Chloride	mg/L	9073.07	1000	IS:3025(Part-32)2025

Note: Results shown in Bold are found above Permissible Limit.

Terms and conditions governing the test report issued

1. Sample is not drawn by SEL; the results are applicable only to the drawn samples.
2. The test report shall not be reproduced in full or part without the written approval of the SRICT Environmental Laboratory.
3. The test report in full or part shall not be used for promotional or publicity purpose without the written consent of SRICT Environmental Laboratory.
4. Water/Waste water samples shall be stored for the period of one month after the date of issue of Report.

END OF REPORT

For, SRICT Environmental Laboratory

Authorized Signatory

Dr. Snehal Tokhandwala
(Quality Manager)

Block No:402, At: Vataria, Ankleshwar-Valia Road, Ta: Valia, Dist: Bharuch
Phone No:02643-290825,9712177799, Mo: 9727745875/876 E-mail:hr.srict@gmail.com, www.srict.in

SRICT

SRICT ENVIRONMENTAL LABORATORY

(SHROFF S R ROTARY INSTITUTE OF CHEMICAL TECHNOLOGY)

(Managed by ANKLESHWAR ROTARY EDUCATIONAL SOCIETY)

(Block No. 402, At & Post: Vataria, Ta: Valia, Dist.: Bharuch, Pin code: 393135. Phone No.:02643-290825)

Page 1 of 2

Group : Waste Water
Discipline : Chemical

TEST REPORT

Customer's Name & Address: M/s. Enviro Technology Ltd Plot no. 2426 14, GIDC Estate, Ankleshwar, Dist: Bharuch. Contact Person: Mr. Dipak Meghapara		Report No : SEL/20260313/A1-001 Issue Date : 19/03/2026	
Lab Id Code	:	SRICT/20260313/A1-001	
Sample Description	:	Final O/L-001	Purpose : Testing
Date of Sample Received	:	13/03/2026	Test parameter : As mentioned by customer
Date of Starting Analysis	:	16/03/2026	Quantity : 2 Lit
Date of Completion Analysis	:	19/03/2026	Packed/Seal : Sealed

Sr. No.	Parameter	Unit	Result	Permissible Limit (If Applicable)	Test Method
1	Temperature	°C	27	40	APHA 2550, 23 rd Ed:2017
2	Total Kjeldahl Nitrogen	mg/L	34.72	50	APHA-4500-N _{org} -B, 23 rd Ed:2017
3	Phosphate	mg/L	0.74	5.0	IS3025(P-31):1988
4	Cyanide	mg/L	< 0.1	0.2	APHA 4500-B, 23 rd Ed:2017
5	Fluorides	mg/L	2.05	15	APHA 4500-F-D, 23 rd Ed:2017
6	Oil & Grease	mg/L	< 2.0	10	APHA 5520-B, 23 rd Ed:2017
7	Sulphide	mg/L	< 1.0	5.0	APHA 4500-S-2-F, 23 rd Ed:2017
8	Hexavalent Chromium	mg/L	< 0.1	0.1	APHA 3500Cr-B, 23 rd Ed:2017
9	Total Chromium	mg/L	< 0.5	2.0	APHA 3111-B, 23 rd Ed:2017
10	Copper	mg/L	0.11	3.0	APHA 3111-CU-B, 23 rd Ed:2017
11	Nickel	mg/L	0.05	3.0	APHA 3111-Ni-B, 23 rd Ed:2017
12	Zinc	mg/L	1.06	15	APHA 3111-Zn-B, 23 rd Ed:2017
13	Iron	mg/L	0.69	3.0	IS:3025(Part-53):2024
14	Manganese	mg/L	0.06	2.0	APHA 3111-A, 23 rd Ed:2017
15	Mercury	mg/L	< 0.01	0.01	APHA 3112-Hg-B, 23 rd Ed:2017
16	Lead	mg/L	< 0.5	0.1	APHA 3111-Pb-B, 23 rd Ed:2017
17	Arsenic	mg/L	< 0.01	0.2	APHA 3111-AS-B, 23 rd Ed:2017
18	Vanadium	mg/L	< 5.0	0.2	APHA 3500-V-B, 23 rd Ed:2017
19	Cadmium	mg/L	< 0.1	0.05	APHA 3111-Cd B, 23 rd Ed:2017
20	Selenium	mg/L	< 0.01	0.05	APHA 3500-Se, B-C, 23 rd Ed:2017
21	Color	Hazen	9365	100	APHA 2120-C, 23 rd Ed:2017
22	Sulphate	mg/L	2631	1000	APHA 4500-SO ₄ -E, 23 rd Ed:2017
23	Insecticide Pesticides	mg/L	Absent	Absent	Pesticides & Insecticides Ref, USEPA 508, 525.2

Remark: Results shown in Bold are found above Permissible Limit.

SRICT

SRICT ENVIRONMENTAL LABORATORY

(SHROFF S R ROTARY INSTITUTE OF CHEMICAL TECHNOLOGY)

(Managed by ANKLESHWAR ROTARY EDUCATIONAL SOCIETY)

(Block No. 402, At & Post: Vataria, Ta: Valia, Dist.: Bharuch, Pin code: 393135. Phone No.:02643-290825)


Page 2 of 2

Terms and conditions governing the test report issued

1. Sample is not drawn by SEL; the results are applicable only to the drawn samples.
2. The test report shall not be reproduced in full or part without the written approval of the SRICT Environmental Laboratory.
3. The test report in full or part shall not be used for promotional or publicity purpose without the written consent of SRICT Environmental Laboratory.
4. Water Waste water samples shall be stored for the period of one month after the date of issue of Report.

END OF REPORT

For SRICT Environmental Laboratory
Authorized Signatory


Dr. Sneha Lokhandwala
(Quality Manager)

ANNEXURE-1(B)

BHARUCH ENVIRO INFRASTRUCTURE LIMITED



March 5, 2013

Enviro Technology Ltd.
Plot No.2413/2414,
GIDC, Ankleshwar.

Sub : Membership Certificate for Common Solid Waste Disposal Facility.

Dear Sir,

We hereby certify that you have become member for the common Solid/Hazardous waste disposal facility of Bharuch Enviro Infrastructure Ltd., at GIDC, Ankleshwar. You have booked solid waste quantity of 36,000 MT / Year. Your Membership No. is **Ank/048.**

Thanking you,

Yours faithfully,
For BHARUCH ENVIRO INFRASTRUCTURE LTD.

AUTHORISED SIGNATORY

Plot No. 9701-15 GIDC Estate, Post Box No. 62, Ankleshwar 393 002, Dist. : Bharuch (Gujarat)
Phones (02646) 253135, 225228 • Fax : (02646) 222642 • E-mail : panjwani@uniphos.com



Dakshin Gujarat Vij Company Limited

(A Government of Gujarat Undertaking) CIN U40102GJ2003SGC042909

Industrial Division, Ankleshwar

Hall No. 02, Office No. 411, 412, 421 & 422, Forth Floor, Sargam Complex,
ONGC Road, Nr. Tran Rasta, Ta. Ankleshwar-393001, Dist. Bharuch, Gujarat.Toll Free No.: 1800-233-3003, E-mail: esank.dgvcl@gmail.com

Registered Office: "Urja Sadan" Nana Varachha Road, Kapodara, Nr. Gajjar Petrol Pump, Surat-395006 (Gujarat)



Certificate

To Whomsoever It May Concern

This is to certify, **ENVIRO TECHNOLOGY LIMITED**, at Plot No. 2413/2414 & 2211, GIDC Ankleshwar, Ankleshwar-393002, Bharuch, Gujarat. HT Connection having Consumer No. **39564**, Having Contract Demand **700 KVA**, Power release on dated **28-11-1996** is high tension has been assessed and meets the requirements for adequacy and reliability as per the applicable standards and regulations.

Executive Engineer
DGVCL, Ankleshwar

(REF.: Consumer letter dated 20-11-2024)

To,

ENVIRO TECHNOLOGY LIMITED

Plot No. 2413/2414 & 2211, GIDC Ankleshwar,

Ta. Ankleshwar-393002,

Dist. Bharuch, Gujarat.

(This document has been digitally signed, no physical signature is required.)

Signature valid

Signed by: Hemant
Rameshchandra Modi
Executive Engineer
Date: 2024.11.21 18:24:40
+05:30

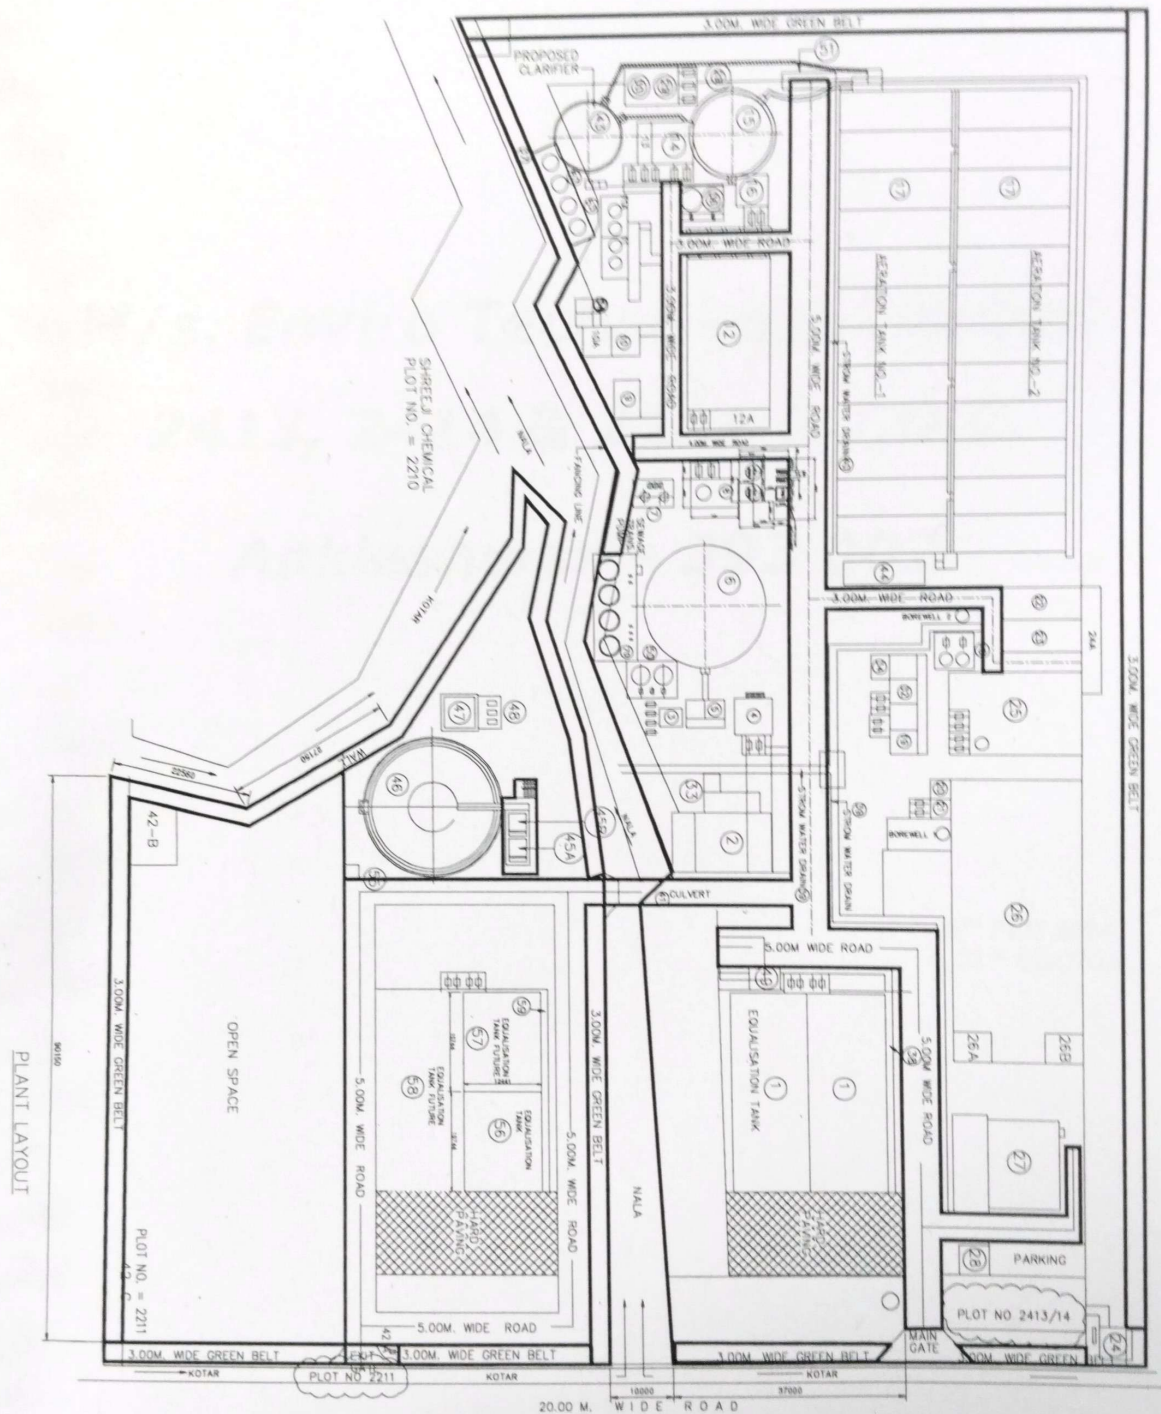
File No: DGVCLDANKI/Revenue/e-file/4441/2024/1243/Account

Approved By: Executive Engineer, Technical, DGVCLDANKI

Open the document in Adobe Acrobat DC to verify the E-sign



1/1



ON SITE EMERGENCY PLAN

Of

M/s. Enviro Technology Limited

2413, 2414 & 2211 G.I.D.C.

Ankleshwar – 393 002

**5TH FEB 2024
21th EDITION**

"On Site Emergency Plan for Enviro Technology Ltd."

1

F O R E W O R D

The "On Site Emergency Management Plan" is prepared with the objective of defining the functions and responsibilities of all concerned managerial, operational and supporting services department personnel with respect to detection and effective implementation of action plan.

The ultimate goal is the effective containment of the situation by proper mitigation action at the place of occurrence, cautioning people in adjoining affected localities, prompt rescue and medical aid to affected persons and communications to civil authorities for rushing in help from outside.

All concerned are hereby requested to carefully study and thoroughly familiarize themselves with in, in order to ensure its effectiveness in times of emergency.

Date : 5th FEB-2024

Unit Head

"On Site Emergency Plan for Enviro Technology Ltd."

2

ABOUT THE COMPANY

Ankleshwar Industrial Estate is one of the largest chemical industrial zones of Asia. It is located in the prosperous South Gujarat Industrial Belt. The city is in between Surat and Baroda on the side of National Highway No.8. It is supported by a stable infrastructure and has shown excellent growth in the last few years. More than 1000 small, medium and large scale industries are manufacturing chemicals, pharmaceuticals, pesticides, dyes, pigments, textiles etc., have come up in the estate.

Along with industrialization, environmental problems also cropped up. Most of the large and medium scale industries are having their own effluent water treatment facilities. Whereas most of the small scale industries are unable to provide effluent treatment facilities of their own due to lack of space, capital, expertise and other operation problems. Also treatment by individual small scale units were found to be not viable taking into consideration of manufacturing technologies being employed.

Ankleshwar Industries Association (AIA) along with other social / professional organizations like Ankleshwar Environmental Preservation Society (AEPS), Rotary Pollution Control Cell (RPCC) etc, was trying to find out a solution for the problem. After detailed studies and discussion at various forums, it was decided to go ahead with a "Common Effluent Treatment Plant" for small scale / medium / large scale industries. Taking into consideration the success and failure of different CETPs in India and abroad, a Company "ENVIRO TECHNOLOGY LIMITED (ETL)" was promoted.

ENVIRO TECHNOLOGY LTD

The Company is promoted by Ankleshwar Industries Association through some of the major industries in the estate. Tatva Global (A group of United Phosphorous Limited) is the main promoter holding 75% of the equity.

This Company is a professionally managed one, which is operating on commercial basis.

The Board of Directors of the company are very experienced and committed. They are:

LIST OF BOARD OF DIRECTORS

Sr. no.	Name of Director	DIN	Designation
1	RAJNIKANT DEVIDAS SHROFF	180810	DIRECTOR
2	SANDRA RAJNIKANT SHROFF	189012	DIRECTOR
3	ARUN CHANDRASEN ASHAR	192088	DIRECTOR
4	ASHOK AMARLAL PANJWANI	200220	DIRECTOR
5	PRABODHKUMAR BHAILALBHAI PATEL	2790654	DIRECTOR
6	RASHMIKANT NATWARLAL SHUKLA	6468013	DIRECTOR
7	VIMALKUMAR GOPALDAS GANDHI	7950427	INDEPENDENT DIRECTOR
8	SACHIN PRAKASHBHAI PARIKH	7957074	INDEPENDENT DIRECTOR
9	VIPULBHAI VALLABHBHAI GAJERA	30338	DIRECTOR
10	JIGAR BHARATBHAI DAVE	8863860	NOMINEE DIRECTOR
11	JASUBHAI CHAUDHARY	7723599	ADDITIONAL DIRECTOR

UNIQUE FEATURES OF THE COMPANY

1. The Company is a commercial venture, professionally managed.
2. Back – up of major industries – Tatva Global (A group of United Phosphorous Limited) is the main promoter holding 75% of the equity.
3. Membership for small scale industries / medium scale / large scale.
4. Total solution for the effluent problem of members. Acidic, Alkaline, Neutral & High Ammonical nitrogen effluents are received by the Company. Primary, Secondary, tertiary & MAP treatment Facilities are provided.

COMMON EFFLUENT TREATMENT PLANT

1. Design Details
 - a. Capacity : 2200 m³ / day
 - b. Total No. of industries giving effluent : 250 Nos.
 - c. Treatment Scheme : Primary, Secondary, Tertiary & MAP Treatment
 - d. Effluent characteristics : Major parameters

Parameters	Unit	Raw Effluent	Treated Effluent
PH		6.5-8.5	6.5 – 8.50
COD	mg / l	5000	< 1000
BOD	mg / l	1500	< 200
SS	mg / l	500	< 150
NH4-N	mg / l	300	< 50
 - e. Transportation of Raw Effluent : Through rubber lined tankers
 - f. Total plot area : 18725 sq. meters & 7819 sq. meters
 - g. Monitoring Facility : Full – fledged Laboratory
 - h. Auxiliary power supply : 1010 KVA DG Set

BRIEF PROCESS DESCRIPTION

The Small Scale Industries who are members of the CETP will store their raw effluent in storage tanks. These effluents will be transported by rubber lined tankers from the industries to the CETP by ETL. On receipt at CETP, samples will be checked and then it will be unloaded in Equalization Tanks. Equalization Tanks - 2 Nos. are provided, each with 1000 M³ capacity and diffused aeration system to provide mixing. Other two nos. of equalization tanks are also provided for collection of having High Ammonical nitrogen effluent, each tank capacity is 580 M³. They are operated on fill and draw basis.

(The Equalization effluent is being received in neutral form (pH 6.5-8.5)) Online Fenton treatment is introduced as pre-treatment as per the studies conducted by various institutes like IITs, Kanpur/Mumbai & CLRI, and Chennai. Then pH is raised to 8.5 to 9.5 to precipitate heavy metals present in the effluent. In primary clarifier, where solids are settled at the bottom of the clarifier. The equalized high Ammonical nitrogen stream is being treated in MAP reactor. After MAP treatment effluent goes to primary clarifier. After PSF effluent goes to the secondary treatment. The sludge from the bottom of the primary clarifier is sent to the Decanter for the removal of moisture. The sludge cake from the Decanter is sent to the secured landfill site (BEIL).

Since it is difficult to treat more effluent with the same technology of Extended Aeration Activated Sludge process which require large foot print, a two-stage process with advance biological treatment (ASP + MLE) is implemented based on extensive pilot plant study. In this process, the aeration system is operated in series whereas in the earlier system it was operated in parallel. In this two stage process, the COD and BOD will be removed in the first stage while in the second stage, some refractory COD and ammonia will be removed.

In the existing two stages process, major portion of COD and BOD (organic carbon) will be removed in the first stage high rate activated sludge process along with some amount of ammonical nitrogen. Specific consortia of bacteria developed in the micro biology laboratory of ETL will be used for bio-augmentation in this reactor to enhance the process of removal. In the second stage MLE process consisting of a combination of Anoxic and Aerobic reactors, some refractory COD and remaining ammonia nitrogen will be treated. Specific bacterial consortia for refractory COD removal and ammonia nitrogen removal will be used for bio-augmentation in the 2nd stage. Since in the MLE process, nitrogen is removed by a combination of nitrification and denitrification, total nitrogen load in the effluent will go down significantly as the nitrate (product of

nitrification) will be converted to gaseous nitrogen and recycled back to the atmosphere.

Continuous addition of culture is being done as Bio-augmentation. The air is being added using tubular diffusers. In the biological treatment, the dissolved organic matter is degraded by the microorganisms. The retention time of the ASP+MLE is around 5 days. Domestic sewage is added at the Inlet of ASP tank. MLSS is being controlled by proper recycle of biomass and daily wasting of biomass. The primary treated effluent goes to ASP tank and then transferred to the Secondary Clarifier-1 for the settlement of the biological solids. The overflow of the secondary Clarifier-1 transferred to MLE tank (Anoxic + Aerobic) for further process and overflow of the MLE tank collected in Secondary clarifier -2 (A+B) for the settlement of the biological solids.

The overflow of the Secondary clarifier -2 (A+B) is collected in a sump for further tertiary treatment.

The effluent collected in the sump is subjected to the tertiary treatment. There are two types of the tertiary treatment provided.

Pressure sand Filters with latest distribution and collection system. Aerated activated carbon filters.

After tertiary treatment effluent is discharged to G.I.D.C drainage line through online magnetic flow meter, pH meter for further treatment at NCT and then disposal to deep sea discharge.

BOD Reduction:

ETL is having Sophisticated Microbiology Laboratory and detailed Treatability Studies are conducted. Special bacterial cultures have been developed by the laboratory of ETL. Some of the cultures are procured from IMTECH and National Chemical Laboratory (Pune). Daily specific doses of acclimatized bacterial culture are dosed to aeration tanks for maintaining required consortium regularly in the biological reactor. With this bio augmentation, BOD reduction is consistently above 95 % and resultant BOD in outlet is as low as 20 mg/l. However, COD reduction is only up to 500 to 800 mg / l due to refractory COD present.

MAP Process:

Removal of Ammonical Nitrogen is difficult problem and detailed studies have been conducted by IITs; to finalize the treatment scheme. Subsequently, treatment scheme is developed with segregated stream with Magnesium Oxide at an initial phase but after conducting detailed research study now magnesium Oxide switched over to Magnesium chloride and Di Sodium Hydrogen Phosphate

"On Site Emergency Plan for Enviro Technology Ltd."

7

to precipitate Magnesium Ammonium Phosphate. MAP is insoluble compound and can be separated. ETL has developed capacity to segregate and treat up to 600 KLD of such high Ammonical Nitrogen containing stream. Treatment operations have been started from February 2011. After segregation, Treatment at ETL and other control measures by member industries, now average Ammonical Nitrogen is reduced up to permissible limit.

OTHER INFRASTRUCTURAL FACILITIES PROVIDED

A full – fledged laboratory is provided to monitor and control the operation of CETP. Acidity, COD, BOD, Ammonical Nitrogen, SS, TDS. Heavy Metals, Oil & Grease, Cyanide, Phenol etc and other parameters are analyzed in the laboratory on a regular basis. Treatability studies are also conducted in the laboratory.

Auxiliary power supply is available for full operation of plant in case of power failure 1010 KVA D. G. Set is installed. In the adjacent plot to CETP, Solid Waste Storage Facility is developed with impervious liners and leachate collection and transfer arrangement.

Road has been developed properly and parking space is provided for tankers and other vehicles. 10 meters width green belt is being developed at the entire periphery of the plot. Chemical House and Stores are provided to keep lime, chemicals and miscellaneous spares.

Administrative Office with computer facility will help day – to – day management.

OPERATION

The CETP is operated under the control of ETL. All required operating personnel are appointed. Additional support required is provided by M/s. UPL Ltd. & Bharuch Enviro Infrastructure Ltd.

The operation charges are recovered from member industries based on effluent characteristics – Acidity, COD & Ammonical Nitrogen.

CETP STATUS

The Project Report was approved by GPCB, NEERI and The World Bank. Construction work was started in January 1996 and completed in November 1996.

Secondary Treatment was commissioned in December 1996. The required bacterial mass was developed within one month's time. The Primary Treatment was commissioned in February 1997. Tertiary Treatment System is also taken into line fully by 3rd week of April 1997. The plant capacity was increased from 1.0 MLD to 1.8 MLD in the year 2007. It was further increase from 1.8 MLD to 2.2 MLD in 2019 by modification of process.

INDEX

1. Introduction
2. Scope and Applicability
3. Concept of Operation
4. Duties of Key Personnel
5. Emergency Procedures
6. Emergency Capabilities

CHAPTER - 1

INTRODUCTION

Emergency Planning is an integral part of the overall loss control programme and is essential for any well run organization. This is important for effective management of an accident / incident to minimize losses to people and property, both in and around the facility. The important aspect in emergency management is to prevent by technical and organization measures, the unintentional escape of hazardous materials out of the facility and minimize accidents and losses. Not only are recognized hazardous conditions which could aggravate an emergency situation be discovered, the emergency response. Emergency planning also demonstrates the organization's commitment to the safety of employees and increases the organization's safety awareness.

The plan can work smoothly and effectively only if the instructions are correctly and promptly followed and action taken at various levels is well co-ordinate.

OBJECTIVES

The objectives of emergency response plan are :

1. Rapid identification, control and containment of the hazardous situation
2. Minimizing the risk and impact of event / account
3. Effective rehabilitation of the affected persons and prevention of damage to property.

To achieve the above stated objectives of emergency planning, the critically elements that form the backbone of the ERP are:

1. Reliable and early detection of an emergency and careful planning.
2. The command, co-ordination and response organization structure along with efficient trained personnel.
3. The availability of resources for handling emergencies
4. Appropriate emergency response actions
5. Effective notification and communication facilities
6. Regular review and updating of the ERP
7. Proper training of the concerned personnel

CHAPTER - 2

SCOPE AND APPLICABILITY

The On Site Emergency Plan describes the organizational structure, facilities, equipment, services, infrastructure etc., necessary to respond to emergency situation which could have On Site and Off Site Implications at the Facility. The Plan also applies to those participating governmental agencies that are responsible for emergency response within the immediate area surrounding the facility and to those agencies, organization, contractors and facilities providing assistance to the facility during an emergency.

Facility Description

Address - Enviro technology Limited
2413 / 14, 2211 G.I.D.C., Ankleshwar – 393 002
Gujarat

Total Area - 18724 sq meters & 7819 sq. meters

Telephone nos - (02646) 299121, 299108

Major Substances handled

Sr. No	Chemical	Quantity Stored	MOC Tank	Storage Condition
1	HCl tank (30%) Hydrochloric Acid	15 m ³	PP FRP	NTP
2	Dilute HCl (10%)	10 m ³ x 2 nos.	PP FRP	NTP
3	Hydrogen Peroxide H ₂ O ₂	10 m ³ x 2 nos.	PP	NTP
4	Polyelectrolyte Tank	10 m ³ x 2 nos.	PP FRP	NTP
5	Lime (in HDPE bags)	Chemical House	--	--
6	Raw Waste water Eq.- Tanks	32 x12.5 x2.5 mtrs	Acid Proof Lined	NTP
7	Raw Waste Water Eq.- Tanks for Ammo.N ₂	15.80 x 12.25 x 3 + 0.5 FB	Acid Proof Lined	NTP
7	Underground Water Tank	650 m ³	RCC	--
8	Ferrous Sulphate Tanks	20 m ³ x 2 nos.	HDPE	NTP
9	Polyelectrolyte Tank (Decanter)	20 m ³ x 2 nos	HDPE	NTP
10	Tank- I & II for MAP	1.6 (dia) x 1.5 + 0.33 m	PP FRP	NTP
10	Flash Mixing Tank	2.2 x 2.2 x 2.5 Ht.	PP FRP	NTP
11	MAP crystal Tank	3.8 X 3.8 x 5.0	PP FRP	NTP
12	Primary Sand Filter	2.5(Dia.) x 3.0 Ht.	MS	NTP

Shift – wise manpower distribution.


Category	G	I	II	III	Total
Shift Timing (in hrs)	0900 to 1730 hrs	0700 to 1500 hrs	1500 to 2300 hrs	2300 to 0700 hrs	
Managerial	4	-	-	-	4
Staff	14	3	3	3	23
Contract Labor	08	17	17	17	59
Total	26	20	20	20	86

"On Site Emergency Plan for Enviro Technology Ltd."

Enviro Technology Ltd.

ORGANOGRAM

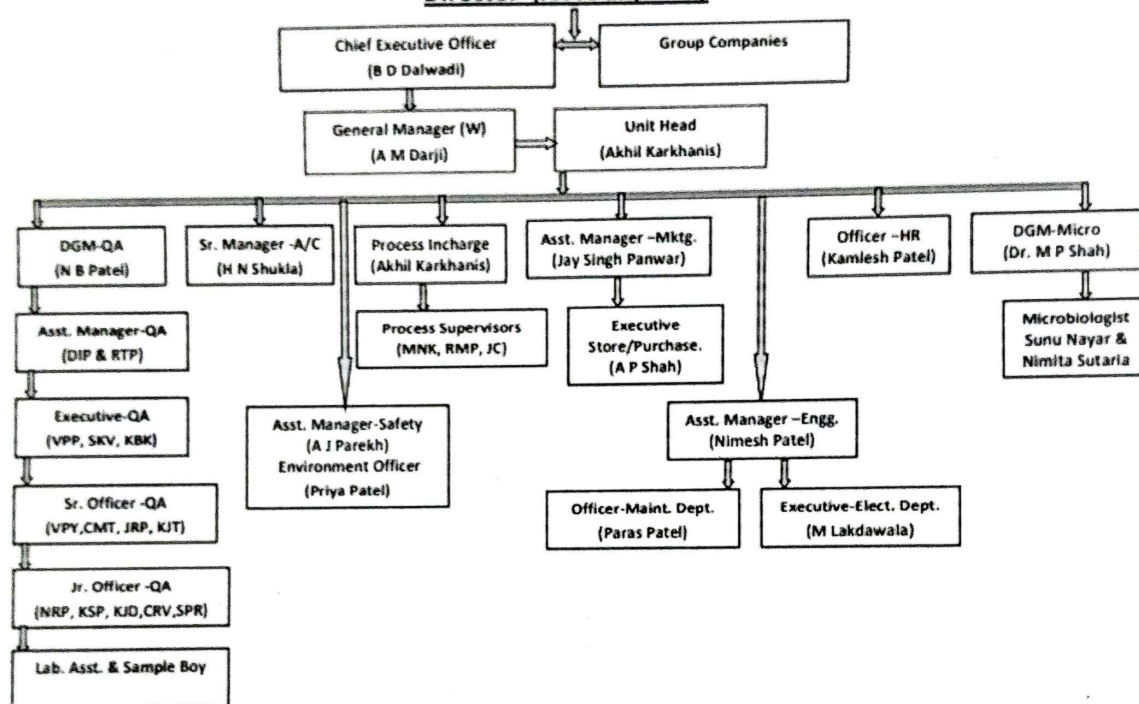Director (A A Panjwani)



Defining an Emergency

An emergency can be defined as an "Occurrence of such magnitude so as to create a situation in which normal pattern of life within a facility is suddenly disrupted, adversely affecting not only the personnel and property within the facility, but also in its vicinity."

Such an occurrence may result in On Site Implication like:

1. Fire and / or explosion
2. Leakage of toxic / corrosive chemicals
3. Electrical shocks and flash fires.

"On Site Emergency Plan for Enviro Technology Ltd."

Incidents having Off Site origins can be:

1. Natural calamity like earthquake, cyclone etc
2. Air raids / marine attack
3. Crashing of aircraft's or flying objects

Other incidents which can also result in a disaster are :

1. Agitation / forced entry by external group of people
2. Sabotage

CHAPTER – 3

CONCEPT OF OPERATIONS

Concept of operations deals with the possible steps associated with an emergency response assuming the most severe emergency scenario. This includes:

1. Accident initiation and rising of alarm
2. Accident evaluation and emergency declaration
3. Off Site and external agency/ neighbor Industry notification / Situation
4. Implementation of On Site response actions
5. Implementation of protective action and evacuations
6. Co – ordination of response actions with external agencies
7. Management of emergency resources
8. Recovery and facilitate re-entry procedures

First Action Plan

To identify an emergency at any location in the factory premises and to acknowledge the same to everybody present in the premises at that time, is known as FIRST ACTION PLAN.

1. A first person who observes an emergency viz. fire, short circuit, heavy leak or spill of / corrosive liquids. After observing the emergency, he will assess the same, the situation as to whether to alert everybody within the plant or in vicinity area. If the first observer is not able to assess the emergency, he will inform plant supervisor about the emergency.
2. After assessment, he will inform Security personnel at main gate by dialing internal telephone no. 112 & 113 or by approaching personally.
3. The security personnel at the main gate will receive the message and initiate the emergency siren (Bell). On hearing the siren (Bell), all employees within the premises will hear carefully to details of emergency.
4. The security personnel will announce the emergency on the public address system about (a) type of emergency (b) exact location of emergency (c) Severity of emergency if information available.
5. On hearing about location and type of emergency, all concern key personnel will stop their activity in a safe manner and move to their respective locations based on the duties described in the plan.

Siren (Bell) Codes

1. Declaration of Emergency: - A long short wailing siren (Bell) for one minute, will mean that there is an emergency within the premises.
2. All Clear Siren (Bell):- A long siren (Bell) for one minute will mean that the emergency declared is under control, i.e. all clear.

This siren (Bell) code will mean All Clear, normal condition. Hence this code will be used to test the siren (Bell) every week.
3. Evacuation: - A long short wailing siren (Bell) for 3 (three) minutes, will mean that emergency declared cannot be controlled. Hence all persons in the premises will evacuate as per the plan.

Communications

For controlling an emergency, communication system plays a vital role.

- (1) Within the premises
 1. Intercom
 2. Messengers
- (2) Outside agencies – Fire Service. Medical neighboring companies. Police. GPCB. Factory Inspector
 1. Telephone
 2. Mail

List of Telephone Nos of Key Persons

Sr. No.	Name / Location	Office Intercom	Office (P&T)	Mobile No.
1	Mr. Akhil karkhanis– Unit Head	103	252768	9825403247
2	Mr. Nimesh patel– Plant Head	131		8140649338
3	Dr.M P Shah –Micro Lab	110		9099965504
4	Mr. Jaysingh panwar – Mktg.	105		6359968968
5	Mr.Kamlesh Patel P & A	115		7874711817
6	Heena Shukla - Accourt	104		9909994990
7	Mr. Mohamad lakdawala -DG. Room	116		7984874962
8	Mr.A J Parekh Plant-Office	131		9909994921
9	Mr.N B Patel –Q.A	102/109		9909994980
10	Mr. Ashish Shah -Stores	108		9909994979
11	Security	112 &	253104	9909994998

"On Site Emergency Plan for Enviro Technology Ltd."

		113		
12	Canteen	117		

List of External Agency Phone Nos.

Sr. No.	Agency	Contact No.	Purpose
1	FCT EPABX (ETL)	9909994998	
2	MR. Ashok Panjwani	9909994902	
3	MR. B.D. Dalwadi	9909994959	
4	DR. P.N. Parmeshwaran	9909994203	
5	MR. A.M. Darji	9825403247	
6	MR. N.B. Patel	9909994980	
7	MR. Jaysingh Panwar	6359968968	
8	MR. Ajay Parekh	9909994921	
9	MR. Ashish Gurjar	9913064336	
10	UPL Unit – 1	02646- 251249 / 251223	Fire Brigade
11	UPL Unit – 2	02646- 250563 / 250578	Fire Brigade
12	UPL Unit – 3	02646- 251189 / 250615	Fire Brigade
13	UPL Unit – 5	02646- 226011 / 226018	Fire Brigade
14	BEIL-Ankleshwar	02646- 253135 / 225228	Ambulance
15	Ankleshwar Industries Association	02646- 221000 / 222000	
16	Fire Station- Ankleshwar Nagrapalika	02646- 245101 / 247201	Fire Brigade
17	Fire station (GIDC-Ankleshwar)	02646- 224100 / 226101	Fire Brigade
18	DPMC Bharuch	02642- 241101	Fire Brigade
19	Police Station (GIDC)	02646- 225551	
20	GPCB Bharuch	02646- 228969 / 246333	
21	GPCB Ankleshwar	02646- 222933	
22	GPCB Head Office, Gandhinagar	079-23232152	
23	Narmada Clean Tech- NCT	02646- 645285 / 645635	
24	Factory Inspector, Bharuch	02642-240421 / 263272	
25	District Collector, Bharuch	02642-240600	
26	Labour Commissioner-Bharuch	02642- 242214 / 269073	
27	DGVCL- Ankleshwar	02646- 220451 / 220551	
28	DGVCL- Bharuch	02642- 255590	
29	Railway Station- Ankleshwar	02646- 255131	
30	Smt. Jayaben Modi Hospital Ambulance	02646- 222220 / 224550 02646- 250871 / 250659	Medical Aid
31	Dr. Mahesh Mistry	9825282789	Medical Aid
32	Dr. Pratik Patel – Orange Hospital Dr. Jigar Zariwala – Orange Hospital	02646- 232432 9016203390	Medical Aid

CHAPTER – 4

DUTIES OF KEY PERSONNEL

Observer

Any person noticing a fire, leakage of chemicals or an unusual occurrence will contact the security personnel at main gate and Plant Supervisor by :

1. Giving a telephone message by dialing telephone no. 112 /113 on the intercom
2. Sending message through a messenger
3. Rush personally

While giving the message, he will:

1. Identify him self
2. State briefly type of emergency
3. Location of incident / accident
4. Severity of emergency

After giving message, he will return to the scene / area of emergency by taking all personnel protection measures, if possible and awaits instructions from Plant Supervisor (Incident Controller)

Security Officer / Security Supervisor

1. Receive message from the observer
2. Initiate the emergency siren to declare the emergency
3. Announce on the Public Address System
4. Arrange to close all the gates and stop traffic
5. Keep vehicle / ambulance ready and keep track of casualty sent to hospital during off hours
6. Ensure that unauthorized persons / vehicles do not enter the premises
7. Organize the positioning and transport of vehicles near the main gate
8. Depute security guard for controlling traffic at the scene of emergency
9. Call up for additional help from the outside agency like fire brigade, hospitals during off hours

Chief Controller

He will be CEO / Unit Heads or in his absence HOD (Plant)/HOD (Maintenance) / HOD (QA) will assume charged of Chief Controller.

If an emergency occurs during off hours i.e. before 0900 hrs or after 1730 hrs, the plant supervisor will be the Chief Controller till any one of the above designated Manager arrives at site and assumes overall charge of the situation. His task will be to co-ordinate all internal and external activities from the Emergency Control Centre at main Security Gate from where all operations will be directed. He shall:

1. Relieve the Incident Controller from responsible of the Main Controller
2. Co-ordinates to avail services from external agencies like fire brigade, hospitals etc, if called for, following the declaration of major emergency. If necessary, major installation in the vicinity may also be informed of the situation.
3. Exercise direct operational control of the unaffected section of the plant
4. In consultation with the advisory team, expedite the shutting down of loading / unloading operations of tankers and if necessary, instruct the supervisor / security personnel to evacuate tankers.
5. Ensure that all employees are evacuated from the affected area and the casualties, if any, are given necessary medical attention. Instruct Executive P & A / Security for rushing casualties to hospitals if required.
6. Liaise with fire and police officials, pollution control board officials and other statutory bodies and advise them of all possible consequence effects outside the premises.
7. Arrange for relief of personnel when emergency is prolonged
8. Issue authorized statement or press release to the news – media
9. Ensure preservation of evidence for enquiries to be conducted by statutory authorities.
10. Authorize the sounding of "All Clear" and "Evacuation Siren"
11. Arrange for obtaining the head – count of all personnel within the premises and cross – checking with the data from records available for no. of persons within the premises.
12. Nominate a person from advisory team, to maintain chronological log of event during the entire period of emergency.

Incident Controller

He is shift supervisor of the Plant. Assume the role of the Incident controller and take charge of the situation. Keep the chief Controller informed of the situation from time to time.

1. Proceed to the scene of emergency and assess the situation
2. Direct all operation within the affected area with the following priorities
 - a) Safety of personnel
 - b) Minimize damage to property and loss of material
 - c) Arrange for rescue of trapped workers and those in a state of shock
 - d) Get all non – essential persons safely evacuated after stopping all the engineering / hot jobs
 - e) Set up a communication system with the main control centre at the main security gate through telephone of messenger system.
 - f) Pending arrival of the main controller, direct the shutting down and evacuation of the site
 - g) Allot jobs to the emergency squad
 - h) Report all developments to the main controller
 - i) Preserve all evidence for use in the subsequent enquiry
 - j) Intimate to the Emergency Control Centre (Main Security Gate) the head count of plant.

Advisory Team

- | | | | |
|-----|---------------|---|--------------------|
| 1. | HOD | - | Plant |
| 2. | HOD | - | Maintenance |
| 3. | HOD | - | QA |
| 4. | HOD | - | Marketing |
| 5. | HOD | - | P & A |
| 6. | HOD | - | Accounts |
| 7. | Asst. Manager | - | Electrical |
| 8. | Sr. Executive | - | QA |
| 9. | Sr. Executive | - | Plant |
| 10. | Officer | - | Commercial (Store) |

Duties

1. All Advisory Team Members should assemble at Emergency Control Centre located at Main Security gate Office.
2. They will provide essential information to the Main controller on his demand
3. If the Main Controller does not require any advice from the team, he can delegate any other jobs which may be more important at the time of emergency

HOD – P & A

- a) Will conduct the head count of non – affected persons assembled at the assembly point which includes non – required plant personnel, QA chemists, visitors, Stores and accounts Canteen employees and other staff.
- b) He will tally the head count with the data available from records such as gate pass, attendance etc and report to Chief Controller
- c) He will liaise with necessary statutory authorities as per instruction of Chief Controller
- d) He will arrange for transportation and medical treatment at hospitals and keep track record of casualties

Emergency Squad

Plant Supervisor (Incident Controller)	-	1 no.
Laboratory Chemist	-	2 nos.
Shift Electrician (Contract Employee)	-	1 no.
Shift Fitter (Contract Employee)	-	1 no.
Contractors' Helpers (who are working in plant) -		6 nos

		11 nos.

1. After hearing the emergency siren and the information about the emergency on the Public Address System, they will assemble in front of Supervisor's cabin with proper Personal Protective Equipment, i.e. underneath the primary clarifier, before this they will give charge of their jobs as per their standard operating procedure / close down the job safely.
2. After assembling, they will act as per the instructions of the incident Controller i.e. the Plant Shift In charge / Supervisor.
3. After handling the emergency, they will be engaged in salvage and operations if required, otherwise in normal case, they will go back to the plant and resume the work.
4. During off hours, Plant Supervisor who is an Incident Controller becomes the Main Controller, in that case the Laboratory Chemist, takes charge as Incident controller.

Plant Employees

They shall:

1. on hearing the siren, report to Plant Supervisor
- 2, do as directed by Plant Supervisor
3. Stop all hot works
4. Remove unwanted persons from the affected area to the "Assembly Point" near Main Security Gate viz. Visitors, Guests.
5. Stop all non – essential operations

Non – Plant Employees

1. On hearing the siren, shall stop their work and assemble at "Assembly Point" near Main Security Gate along with Guests and Visitors.

CHAPTER – 5

E M E R G E N C Y P R O C E D U R E S

Emergency Handling Procedure

1. On hearing emergency declaration siren and announcement of Public Address System, all key persons will rush to their nominated locations and start actions as laid down in Chapter - 4
2. The Main Controller will continuously assess the situation by taking feedback from the incident Controller. He will consult the advisory team members to get essential information if required but if does not required to take help from advisory team; he can assign other jobs to advisory team.
3. Once the emergency is brought under control, Main Controller will inform to Security to give "ALL CLEAR" siren and announce on Public Address System about termination of emergency.

In case, the emergency assumes off site dimensions and cannot be controlled, then if the Chief Controller with his advisory team decides to evacuate the plant, he will instruct the Security to sound "EVACUATION SIREN".

Procedure in case Emergency tends to have off site implications

1. As per the site plan and wind direction at the time of emergency, the likely affected area will be identified and population within will be estimated.
2. The Police will be informed so that in-coming traffic on highway can be controlled from both the ends. The Police force will be helpful in evacuation of villages, factories or other public places in the vicinity.
3. The fire brigade will be informed and ambulance will be called and kept ready to meet any eventuality.
4. Neighboring factories will be communicated for sending help
5. Statutory authorities such as Police, Factory Inspector, District Collector and other concerned to be intimated.

Procedure for salvage operations

The salvage operation will be carried out under the guidance of the Main Controller, his advisory team and Incident Controller.

They will conduct accident investigation, assess the damages / losses. Also they will chalk – out a detail procedure of salvage operations which will include the safety precautions and a time frame for completion of job to be carried out by emergency squad under the strict supervision of Main & Incident Controllers.

"On Site Emergency Plan for Enviro Technology Ltd."

23

CHAPTER – 6

E M E R G E N C Y C A P A B I L I T I E S

The primary emergency response facilities comprise the following :

01 Emergency Control Centre

Upon declaration of emergency, the Main Security Gate Office will become the Emergency Control Centre (ECC). The ECC is located in a low / minimal risk zone of the plant. It is manned round – the – clock by Security Supervisors.

During emergency, it will be manned by the Chief Controller and his advisory team.

The ECC has a D. G. backup power supply. It has following facilities:

1. Master plan of Facility and 5 kms surrounding area – displayed on wall
2. Layout of facility, equipment and storages, displayed on table and wall
3. Availability and location of firefighting equipment and material
4. Layout of fire extinguishers, indicating their type and numbers
5. First aid box
6. Availability and location of Personal Protective Equipment
7. Self – contained Breathing Apparatus sets and the spare cylinders
8. External telephone with direct dialing and STD facilities
9. Internal telephone
10. List of important internal and external telephone numbers displayed on table and wall
11. Stretches
12. Transport Facility
13. Extra copies of Plant Layout for marking during emergency
14. Telephone directory both local and surrounding district
15. General stationary like paper, pencil etc
16. Nominal roll and address of all employees with contract telephone nos. and blood Group.
17. List of first aiders and emergency squad members

"On Site Emergency Plan for Enviro Technology Ltd."

18. Details of all contractors and their employees
19. Details of meteorological information during different seasons such as wind speed, direction, temperature, humidity etc.

The location of ECC, Assembly Points, availability of first aid boxes, fire extinguishers, PPE should be marked on site plan

List of Fire Extinguishers

Sr. No.	Location	Type	Capacity
1	Lab QC	DCP	10 Kgs
2	Office Administration Building	DCP	10 Kgs
3	DG Room	DCP	10 Kgs
4	MCC-1 (Electrical)	DCP	10 Kgs
5	Transformers Area	CO2	22.5 Kgs
6	Maintenance Store Room	DCP	10 Kgs
7	MCC -2 (Electrical)	DCP	10 Kgs
8	Security Gate	DCP	10 Kgs.
9	Carbon bed Area	DCP	10 Kgs.
10	Decanter	DCP	10 Kgs.
11	Pilot plan R & D Plant	CO2	4.5 Kgs.
12	MCC- 3 (Electrical) New primary	CO2	4.5Kgs.
13	MCC– 2(Electrical)	CO2	4.5 Kgs.
14	MCC-1 Elect.	CO2	9Kgs.
15	MAP crystal Tank(Old RVDF shed)	DCP	10 Kgs.
16	Sewage Pumping station	DCP	10Kgs.
17	Nr Control room	DCP	06 Kgs
18	Nr. Store	DCP	06 Kgs
19	Switchyard	CO2	09 Kgs
20	VCB ROOM	CO2	09Kgs
21	PMCC ROOM	CO2	09KG
22	TRANSFORMER -H.T. YARD	CO2	22.5KG
23	NEW VFD ROOM F/F	CO2	4.5KG
24	Decanter -A & B Panel	CO2 flooding system	2.0 kgs(2 nos.)
25	PDB panel (MCC-1)	CO2 flooding system	2.0 kgs (1 no.)
26	MCC-6	CO2 flooding system	6.5 kgs (1 no.)

"On Site Emergency Plan for Enviro Technology Ltd."

DCP = Dry Chemical Powder, type of Fire Extinguishers

Maintaining Emergency Response Capabilities

In order to ensure a prompt and professional emergency response capability, facility personnel are required to be knowledgeable of the possibility of various emergencies and emergency actions.

Training and Education

Regular training should be provided to all personnel who have a role in planning and operational response to an emergency so as :

1. To familiarize them with the contents and manner of implementation of ERO and its procedures.
2. To maintain a high degree of preparedness at all levels of the emergency response organization
3. To train new employees
4. Update and modify the plan on the basis of experience acquired through exercise and drills.

The plan needs to be reviewed year, for validity of contents and lacunas in the plan noticed during mock drills.

Planning of Mock Drill

TYPE OF EMERGENCY:

Fire / Leakage of Chemicals /Electrical Shock :

- (1) Objectives of Mock Drill :
- (2) Accident initiation: Applicable or Not Applicable
- (3) Raising of alarm, siren or bell : Yes / No
- (4) Onsite communication: Yes / No
- (5) Offsite communication: Yes / No
- (6) Implementation of response / mitigation action : Yes / No
- (7) Whether evacuation, protective action required : Yes / No

"On Site Emergency Plan for Enviro Technology Ltd."

26

(8) Coordination with external agency required: Yes / No

(9) Evaluation of Mock Drill and report submission

Report sign by EHS Coordinator

SELF BREATHING APPRATUS

Sr. No.	Location	Type	Capacity
1	Plant control room	SBA	45 Min.

SAFETY SHOWERS

Sr. No.	Location
1	Laboratory
2	Under (Old) RVDF staircase
3	Chlorine Shed
4	Near Equalization tank-4

FIRST AID BOX

Sr. No.	Location
1	Laboratory
2	Security office
3	D G Room

List of first aiders

- (1) Mr.A.J.PAREKH
- (2) Mr.NIMESH PATEL
- (3) Mr.ASHISH SHAH
- (4) Mr. D I PATEL
- (5) Mr. RAHUL PATEL
- (6) Mr. KAMLESH PATEL
- (7) Ms. NIMITA SUTARIYA

"On Site Emergency Plan for Enviro Technology Ltd."

27

- (8) Mr. DEVYANG PATEL
- (9) Mr. JANAK PATEL
- (10) Mr. PARAS PATEL
- (11) Mr. MAHIPAL KOSADA
- (12) Mr. VINOD PARMAR



ENVIRO TECHNOLOGY LIMITED

Reference No.: ETL/ANK/01/2024/859
GPCB ID: 15074

Date: 16th December, 2024

To,
The Unit Head
Hazardous waste cell
Paryavaran Bhavan
Sector-10-A, Gandhinagar
382010

Subject: Compliance of condition 3.6.51 of CC&A No. AWH-113210 dated 07.08.21, with respect to information regarding change of Board of Directors.

Reference: CC&A No. AWH-113210 dated 07.08.21 and valid up to 18.03.24.

Respected Sir,

As mentioned in the general condition (3.6.51) of the above referred CC&A, we need to inform GPCB in case of change of owners/ partners/ directors/ proprietors. In this regard, we hereby inform that there is a change in our Directors and thus the latest Director's list is attached for your ready reference. We have uploaded the same on XGN.

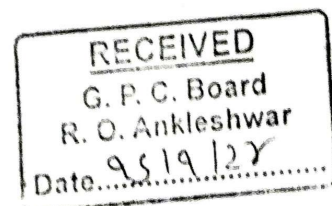
This is for your kind information please.

Thanking You,
Yours faithfully,

For, Enviro Technology Ltd

Authorized Signatory

C.C: Regional Officer- GPCB- Ankleshwar



CIN NO. :

Works Office :

Reg. Office :

U72200GJ1994PLC023786

2413/2414 & 2211, GIDC Estate, Ankleshwar - 393 002 Dist. : Bharuch (Gujarat)
Phone : (02646) 223569, 252768, 250707
Email : dalwadibd@bell.co.in, darjiam@bell.co.in

9701-16, GIDC Estate, Ankleshwar - 393 002 Dist. : Bharuch (Gujarat)



ENVIRO TECHNOLOGY LIMITED

LIST OF DIRECTORS' OF ENVIRO TECHNOLOGY LIMITED

SR. NO.	NAME OF DIRECTOR	DIN	ADDRESS	DESIGNATION	DATE OF APPOINTMENT
1	RAJNIKANT DEVIDAS SHROFF	00180810	UPL LTD, "UNIPHOS HOUSE", MADHU PARK, 11TH ROAD, KHAR (WEST), MUMBAI, MAHARASTHRA.	DIRECTOR	07/12/1994
2	SANDRA RAJNIKANT SHROFF	00189012	UPL LTD, "UNIPHOS HOUSE", MADHU PARK, 11TH ROAD, KHAR (WEST), MUMBAI, MAHARASTHRA.	DIRECTOR	07/12/1994
3	ARUN CHANDRASEN ASHAR	00192088	UPL LTD, "UNIPHOS HOUSE", MADHU PARK, 11TH ROAD, KHAR (WEST), MUMBAI, MAHARASTHRA.	DIRECTOR	23/03/2004
4	ASHOK AMARLAL PANJWANI	00200220	BEIL INFRASTRUCTURE LTD. PLOT NO. 9701-9716, GIDC, ANKLESHWAR - 393 002, GUJARAT.	DIRECTOR	06/05/1996
5	PRABODHKUMAR BHAILALBHAI PATEL	02790654	PLOT NO. 72, JAY BUNGLOW, NR MANAV MANDIR GIDC ANKLESHWAR 393002, GUJARAT.	DIRECTOR	13/05/2015
6	RASHMIKANT NATWARLAL SHUKLA	06468013	PLOT NO 1329/1, SECTOR NO - 7/D, GANDHINAGAR GANDHINAGAR 382007, GUJARAT.	DIRECTOR	29/12/2012
7	VIMALKUMAR GOPALDAS GANDHI	07950427	9, SHRIJIDARSHAN SOCIETY, NEAR SWAMI NARAYAN VIDHYALAY, NADIAD, GUJARAT.	INDEPENDENT DIRECTOR	26/09/2017
8	SACHIN PRAKASHBHAI PARIKH	07957074	23, GALAXY APARTMENT RACECOURSE ROAD, GALAXY- CINEMA, RACECOURSE RAJKOT, GUJARAT.	INDEPENDENT DIRECTOR	05/10/2017
9	VIPULBHAI VALLABHBHAI GAJERA	00030338	402/8/B ALKAPURI SOCIETY GIDC ESTATE ANKLESHWAR BHARUCH 390001 GUJARAT.	DIRECTOR	13/12/2018
10	JIGAR BHARATBHAI DAVE	08863860	E/223, SHASTRI NAGAR, NANA MAHUA MAIN ROAD, RAJKOT, GUJARAT 360004	NOMINEE DIRECTOR	08/09/2020
11	JASUBHAI CHAUDHARY	07723599	HOUSING PLOT NO. 760 "SHREE ARBUDA NIWAS" B/H SARDAR PATEL PRIMARY SCHOOL, ANKLESHWAR, GUJARAT 393002	ADDITIONAL DIRECTOR	29/08/2022

DATE : 09/12/2023

PLACE : ANKLESHWAR, GUJARAT.



CIN NO. :

Works Office :

Reg. Office :

U72200GJ1994PLC023786

2413/2414 & 2211, GIDC Estate, Ankleshwar - 393 002 Dist. : Bharuch (Gujarat)

Phone : (02646) 223569, 252768, 250707

Email : dalwadibd@beil.co.in, darjiam@beil.co.in

9701-16, GIDC Estate, Ankleshwar - 393 002 Dist. : Bharuch (Gujarat)

ENVIRO TECHNOLOGY LIMITED

REF: ETL/ANN/2020/1000

Date: 11.01.2020
PCB ID: 15074

To,
Dr H V C Chary Guntapalli, Scientist D
Ministry of Environment, Forest & Climate Change
Western Region Office,
Kendriya Paryavaran Bhavan,
Link Road No.3, E-5 Ravishankar Nagar
Bhopal-462016

Sub: Compliance of newspaper advertisement for the Ec No. 10-82/2018-1A-III dated 16th December, 2019.

Ref: Environmental Clearance F. No. 10-82/2018-1A-III dated 16th December, 2019.

Dear Sir,

With Reference to the aforesaid Environmental Clearance F. No. 10-82/2018-1A-III dated 16th December, 2019, has been received on 25-December-2019 for proposed expansion with modification of existing common effluent treatment plant of M/s Enviro Technology limited (ETL), Ankleshwar.

As mentioned in the EC condition No. X (i), Ec receipt has to be published in newspaper within 7 days from the date of receipt of the clearance letter in at least two local newspapers.


We would like to inform that we have published in English (Times of India) on 01st January, 2020 and a vernacular language, Gujarati (Divya Bhaskar) Newspapers on 31st December, 2019.

The copies of the stated two newspapers are attached herewith for your reference and record.

Thanking you.

Yours Faithfully,

For, Enviro Technology Limited


B. D. Dalwadi
Chief Executive Officer

C.C: (1) Member Secretary
Gujarat Pollution Control Board
Paryavaran Bhavan, Sector-10/A, Gandhinagar-382010
(2) Regional Officer
Gujarat Pollution Control Board
Ankleshwar

CIN NO.:
Works Office:

U72200GJ1994PLC023786
2413/2414 & 2211, GIDC Estate, Ankleshwar - 393 002 Dist. : Bharuch (Gujarat)
Phone : (02646) 223569, 252768 Fax : (02646) 250707
Email : dalwadibd@bell.co.in, darjiyam@bell.co.in

Reg. Office:

973146, GIDC Estate, Ankleshwar - 393 002 Dist. : Bharuch (Gujarat)


18/01/2020
Gujarat Pollution Control Board
Head Office
Sector No. 10-A,
Gandhinagar-382010

Received
Gujarat Pollution Control Board
RO Ankleshwar
16/1/2020

ter beans and several other vegetables have risen too. According to Krishnakant Pawar, deputy secretary of APMC, Vaslui, "Climate change happens to be the major factor for loss of production. The extended monsoon has badly hit farmers and destabilized the demand-

supply chain." At the wholesale APMC market in Vaslui, supplies of onions have halved since September, say traders. The shortage of old onions and delay in harvesting the winter crop has kept prices high.

"Mumbai market needs at least 100-125 truckloads of

sale market. During September and November last year, the prices were Rs 25-35 per kg, which jumped to Rs 50-130 per kg this year.

To check prices, government stopped exports in September. This saw a slight dip in prices from Rs 50-60 per kg in the wholesale market to Rs 40-50 in October.

TO BEAT A RECORD AS A REFINER in one of the HDIL Group companies according to chargesheet submitted in court by the Enforcement Directorate (ED) in the PMC Bank scam. The ED questioned her about the source of funds for the purchase of a bungalow in Bandra along with flats in Golf Links Building, and bungalows in Alibaug and Vasai.

Man kills his ailing 62-yr-old mother to 'relieve' her of pain

Sandhya Nair
@timesgroup.com

Mumbai: A 30-year-old man allegedly killed his ailing 62-year-old mother to 'relieve' her of pain. The incident took place in the Bhabha Atomic Power Station (BARC) Colony at Tarapur on Sunday. The complainant, accused Jayprakash Dholi's brother, has told the police his younger sibling was mentally unstable.

According to the complaint, the victim, Chandravati, was preparing breakfast for Jayprakash when he hit her on the head with an iron rod. The accused is single and unemployed.

The complainant came to visit his mother after 11 am and saw Jayprakash sitting beside her body. An iron rod was lying near him. Jayprakash told the police his mother was suffering from arthritis, blood pressure, diabetes

and cataract.

He told the police she often complained of pain and he killed her to liberate her. The victim lived along with her 70-year-old husband, a retired Tarapur Atomic Power Station (TAPS) employee and a daughter, who teaches at the NPCIL School in Vasai. Jayprakash and his older brother resided in different homes in Dattatraya Nagar in Borisar. They would visit their mother every Sunday.

Gift of life: City set for record, 79 transplants in one year

TIMES NEWS NETWORK

Mumbai: The city witnessed 14 life-saving transplants in the last one week thanks to four families who donated the organs of their loved ones.

As the year ends, the city is set to witness a heartening record of 79 organ donations, the highest ever since cadaver donation programme started in 1997. Over 200 organ failure patients could undergo transplants owing to the cadaver donations.

The Zonal Transplant Coordination Committee data shows that the number of donations increased by 65% in 2019 when compared with 2018 (48). T

The number of donated organs too rose by 60% as compared to the previous year. This year also witnessed more bone donations and the first pancreas transplant in the city. Overall, 121 kidneys, 68 livers, 21 hearts, 10 lungs and one pancreas were donated.

"The programme has seen unprecedented success this year, but the challenge now would be to sustain the momentum," said Dr S Mathur, president of

VALSAD

ESI ACT 2002

repayment of the loans have e notices were financial Assets but they have filed notice.

Date of NPA

067.00 30/06/2019

Four fully as interest rate

267.00 19/03/2017

None as on 31 and

162.00 31/12/2018

Interest 19 with detail

32.00 16/05/2019

None Eight under rises

ret(s) and for payment of failing which notice under u Assets and

ICR IT Branch

PUBLIC NOTICE FOR TITLE CLEARANCE REPORT

That Virenbhai Kurjibhai Bhrollya is absolute owner of below mentioned properties and he have obtained Title Clearance Report from me to obtain bank loan. Thereafter he informed that below original documents are lost. Therefore if any person, society, institution, group, trust, banks etc. Owing any right, interest, lien or claim of whatsoever nature in respect thereof are hereby informed to raise any such rights or claims within a period of 15 days from this notice along with all documentary proof, thereafter no any rights or claims shall be entertained and additional report will be issued.

Property Details:- All that piece and parcels of the immovable property of Industrial Plot No. 79, 80 totally admeasuring 265.52 sq.mtrs. in the industrial estate which is known as "Swaminarayan Industrial Estate" situated on the land bearing Revenue Survey No. 385, 386, 387, 389 paiki having its Block No. 304 of Village: Talithaiya, Sub District: Palsana, District: Surat.

Lost Documents:- (1) Original sale deed No. 292 dated 27.03.2002, (2) Original sale deed No. 291 dated 27.03.2002 & (3) Original sale deed No. 475 dated 30.03.1994 alongwith original registration receipts of above all sale deeds.

Rakesh A. Wadhvani (Advocate) No. 39, Datt Ch... Ph. 9823191297

PUBLIC NOTICE ENVIRONMENTAL CLEARANCE


It is hereby informed that the Ministry of Environment, Forest and Climate change (IA, III Section), Indira Paryavaran Bhawan, Jor Bagh Road, New Delhi - 3, has accorded Environmental Clearance for Proposed Expansion with modification of existing Common Effluent treatment Plant of M/s. **Enviro Technology Limited. (ETL)** at Plot no.2413/2414 & 2211, GIDC Ankleshwar-393002 (Gujarat) vide letter No. F. No. 10-82/2018-IA-III dated 16/12/2019 under the provision of EIA Notification dated 14th September 2006, which we have received on 25/12/2019.

Copies of Clearance letter are available on website of MoEFCC/SEIAA.

Date: 30/12/2019

B D Dalwadi
(CHIEF EXECUTIVE OFFICER)

CADAVER DONATIONS IN MUMBAI



ZTCC. "Our next aim would be increase the donor pool and that could be achieved by recognizing more Non-transplant organ retrieval centres and encouraging them to identify donors," he said. TNN

સેપીઆંકના મુલ્યાંકન માટે મોનીટરીંગ ટીમ આગામી મહિને આવી રહી છે. પૂર્વજ એન.સી.ટીનું ઈનલેટ-આઉટ લેટની માન વધુ આવતા દોડધામ મચી છે. છેલ્લા 2 મહિના ઈન-આઉટ ડેતા પરિણામ બગડ્યા છે. પર્યાવરણવાદી દ્વારા ઉચ્ચસ્તરીય રજુઆત કરી છે. એનસીટીમાં નિયત માત્રા કરતા વધુ સ્લજ સંગ્રહ દુર્ગંધ ફેલાતા આજુબાજુ

કચરા રચ્યા છે. અકલચરના (FETP) ફાઈનલ એક્ઝ્યુએન્ટ ટ્રીટમેન્ટ પ્લાન્ટ (NCT) જીપોસીબી ના માપ દરે મુજબ કામના કરતા થિતામાં વધારો જોવા મળી રહ્યો છે. અંકલેશ્વર, પાનોલી અને ઝગડિયા વિસ્તારમાં આવેલા ઓધોગિક એકમોના ગંદા પાણીને શુદ્ધ કરી દરિયા સુધી લઈ જવાનું કાર્ય NCT દ્વારા થાય છે. જે છેલ્લા 2 મહિના થી માપ દરે

(આધ્યાગક વસ્ત) નિર્ધારિત માત્રા થી વધુ જમા થયેલ છે જેનાથી પીરામણ અને અંકલેશ્વર સહિત આસપાસ ના વિસ્તારોમાં દુર્ગંધ ફેલાઈ રહી છે અને હવાના આ પ્રદુષણને લીધે આસપાસ આવેલ માનવ વસાહતોની પ્રજાના સ્વસ્થાપ પર ગંભીર અસરો ઉભી થઈ રહી છે. સ્થાનિક પ્રકૃતિ સુરક્ષા મંડળ દ્વારા આ અંગે જીપોસીબીમાં લેખિત ફરિયાદ કરી છે. ફાઈનલ એક્ઝ્યુએન્ટ

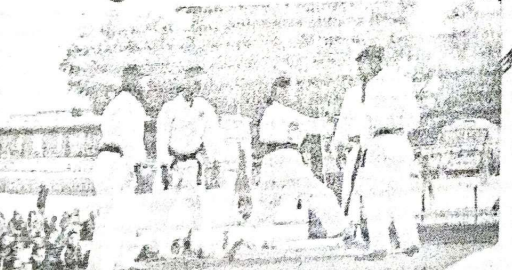
બે મહિના થી જીપોસીબીએ નિર્ધારિત કરેલ માપદંડો મુજબ કાર્ય કરતું નથી જેમાં મુખ્યત્વે કેમિકલ ઓક્સીજન ડીમાન્ડ (COD) અને એમોનીકલ નાઈટ્રેટ (NH3-N) ટ્રીટમેન્ટ થયા પછી પણ તેના નિયત માત્રા થી વધુ NCT ના આઉટ લેટ માં નોંધવાથી આવેલ છે. અને આ પાઈપલાઈન દ્વારા કંટીયાજાળના દરિયા સુધી જાય છે.

ખેતરો વીલા મોઢે પરત ફર્યા રિ-હર કોમ્પ્લેક્ષના મેનિશાન બનાવ્યા

મુખ્યમંત્રી હરિ-હર કોમ્પ્લેક્ષના મકાન નંબર-39, 40માં હર્મતસિંહ કરિમસાદ ઠાકોરનાઓ રહે છે. નિવાર તેમના બંધ બે મકાનોને યત્રી દરમિયાન તસ્કરોએ નિશાન નાવી મકાનના દરવાજાના નકુચા પોડી મકાનમાં પ્રવેશ કર્યો હતો. તસ્કરોએ મકાનમાં મુકેલી તિજોરી ઇલેક્ટ્રીક કબાટો પોલીને સમાનને મસ્તવસ્ત કરી નાખ્યો હતો. જોકે

તસ્કરોને કોઈ પણ કિમતી ચીજ વસ્તુ હાથ નહિ લાગતા માત્ર 5 જેટલી સાડીઓ લઈને પલાયન થઈ ગયા હતા. બનાવની જાણ થતાં જ પરિવારે મકાનમાં તપાસ કરતા સાડી સિવાય કોઈ પણ વસ્તુ નહીં ગઈ હોવાથી રાહતનો શ્વાસ લીધો હતો. સી ડિવિઝન પોલીસે તસ્કરોને ઝડપી પાડવાના ચક્રોગતિમાન કર્યા છે.

ઓપે સેલ્ફ ડિક્લેન્સની તાલીમ આપી અને મેગા ડેમોન્સ્ટ્રેશન 2000 યુવતીઓએ શક્તિનું પ્રદર્શન કર્યું



ભરૂચના હોસ્ટેલ ગ્રાઉન્ડ ખાતે સ્કૂલ, કોલેજની વિદ્યાર્થીનીઓ માટે એ.બી.વી.પી દ્વારા મિશન સાહસીનું આયોજન કરાયું હતું. અગેષ્ઠ

6 હજાર ઉપરાંતનો ઈંગ્લિશ દારૂ જપ્ત કર્યો અંકલેશ્વર GIDCમાં પાનના ગલ્લામાંથી દારૂ ઝડપાયો LCBએ ચામુંડા પાન કોર્નરમાં દારૂ ઝડપી પાડ્યો

અંકલેશ્વર જીઆઈડીસી પાનના ગલ્લા માંથી ઈંગ્લીશ દારૂ એલ.સી. બી ઝડપી પાડ્યો હતો. 31 ડિસેમ્બર પૂર્વ પોલીસ એકીંગ દરમિયાન જી.આઈ. એલ.ચોકડી પર ચામુંડા પાન પડે છે. કોર્નરમાં દારૂ મળી આવ્યો હતો. 6 હજાર ઉપરાંતનો ઈંગ્લીશ દારૂ જપ્ત કર્યો હતો. તેમજ પાનના ગલ્લા સંચાલક ધરપકડ કરી હતી. અંકલેશ્વર પોલીસ દ્વારા 31 ડિસેમ્બરની ઉજાણીને લઈ ઈંગ્લીશ દારૂનો જથ્થો








ઝડપી પાડવાની કવાયત હાથ ધરી હતી. દરમિયાન ભરૂચ એલસીબી પોલીસ દ્વારા ચોક્કસ ખાતમી આધારે જી.આઈ.એલ. ચોકડી શાકમાર્કેટ પાસે ચામુંડા પાન કોર્નર પર સર્ચ કરતા અંદર થી ઈંગ્લીશદારૂ નો જથ્થો મળી આવ્યો હતો. પોલીસે વિવિધ બ્રાન્ડની ઈંગ્લીશ દારૂ બોટલ જપ્ત કરી હતી. તેમજ પાનના ગલ્લા સંચાલક જીતેન્દ્ર ઈશ્વર ચાવડાની ધરપકડ કરી હતી.

કેનેડા-ઓસ્ટ્રેલિયા
3 વર્ષ વર્ક પરમીટ(2 લાખ પગાર)
અમેરીકા
10 વર્ષના વિઝીટર વિઝા
૮૧૪૦૯૫૫૯૨૦

ગ્રાહક સુચના
પર્યાવરણીય મંજૂરી
આ સાથે જણાવવામાં આવે છે કે, મિનિસ્ટ્રિ ઓફ એન્વાયરોમેન્ટ, ફોરેસ્ટ એન્ડ ક્લાયમેટ ચેન્જ(IA, III section) ઇન્ટિરા પર્યાવરણ ભવન, નોર બાગ રોડ, નવી દિલ્હી-3, દ્વારા એનવીસી રેકોર્ડોરુ લિમિટેડ, પ્લોટ નં.૨૪૧૩/૨૪૧૪ & ૨૨૧૧, જી.આઈ.ડી.સી. ઇન્ડસ્ટ્રીયલ ઇસ્ટેટ, અંકલેશ્વર-૩૯૩૦૦૨ (ગુજરાત) ખાતે હાલના કોમ્પ્લેક્સ ટ્રીટમેન્ટ પ્લાન્ટ માં ફેરફાર સાથે સુચીત પધારો કરવા માટેની પર્યાવરણીય મંજૂરી ક્રમાંક નં. F.NO. 10-82/2018-IA-III તારીખ ૧૭-૧૨-૨૦૧૯ દ્વારા ઈ.આઈ.એ.નોટીફિકેશન તારીખ ૧૪ સપ્ટેમ્બર ૨૦૦૬ મેગવાઈ ફેઝ આપેલ છે, જે અમલ તારીખ ૨૭-૧૨-૨૦૧૯ ના રોજ મળેલ છે. કલિયરન્સ પત્રની નકલ મિનિસ્ટ્રિ ઓફ એન્વાયરોમેન્ટ, ફોરેસ્ટ એન્ડ ક્લાયમેટ ચેન્જ ની વેબસાઈટ ઉપર ઉપલબ્ધ છે.
બી.કી.દલવાડી
(ચીફ એક્ઝીક્યુટીવ ઓફીસર)
તા.૩૦-૧૨-૨૦૧૯

ANNEXURE-1(H)

Environment Clearance for proposed expansion with modification of CETP – ETL Ankleshwar

Sr. No.	Address	Sign
1	Jilla Panchayat office, Bharuch	 16.11.2020
2	Taluka Panchayat Office Ankleshwar	 20-11-20
3	Taluka Panchayat Office Jhagadia	 15/02/2020
4	The Sarpanch Gram Panchayat – Dadhal	
5	The Sarpanch Gram Panchayat – Kosambdi	 16.11.2020
6	The Sarpanch Gram Panchayat – Kapodara	
7	The Sarpanch Gram Panchayat – Bhadkodara	 16.11.2020
8	The Sarpanch Gram Panchayat – Andada	
9	The Sarpanch Gram Panchayat – Jitali	
10	The Sarpanch Gram Panchayat – Gadkhoi	 16.11.2020

11	The Sarpanch Gram Panchayat – Piraman, Piraman, Ankleshwar	આચાર્યશ્રી રમેશ પીરમાન ગ્રામ પંચાયત તા. અંકલેશ્વર જિ. સુરત 15-1-2020
12	The Sarpanch Gram Panchayat – Sarangpur	પ્રમીલ તા. અંકલેશ્વર જિ. સુરત
13	Mr. Yogesh P. Panua Safety Health and Environment Association	Bhumen જિય
14	Mr. Jayesh Patel Centre For Environment Science and Community,	
15	Manish Rana Paryavaran Mitra	P
16	Ankleshwar Nagar Palika,	આચાર્યશ્રી રમેશ 15-1-2020 અંકલેશ્વર નગર પાલિકા
17	Notified Area Office, Ankleshwar	NOTIFIED AREA RECEIVED તા. 13/1/2020
18	Notified Area Office, Panoli	Date:- 15/1/2020 Notified Area Office GIDC, Panoli.
19	Notified Area Office, Jhagadia	જાગડા 15/1/20
20	Collector District Collector office, Bharuch	અચાર્યશ્રી રમેશ સુરત 15/1/20
21	The principle, Footwear Design & Development Institute	જયજય
22	The Principle, Pioneer School, Jitali	ILC Belim MS. આચાર્યશ્રી પાયોનિયર માધ્યમિક અને ઉચ્ચતર માધ્યમિક શાળા જિતાલી તા. અંકલેશ્વર જિ. સુરત



23	The Principle, P. S School, Jitali	E/C BL 21/12/20
24	The Principle Shree Gattu Vidyalaya, Ankleshwar	Principal SHREE GATTU VIDYALAYA ANKLESHWAR
25	The Principle, Smt Puspavati Devidas Shroff Sanskardeep Vidhyalaya Ankleshwar	SHROFF SMT PUSPAVATI DEVIDAS SHANKARDEEP VIDYALAYA ANKLESHWAR
26	The Principle Lions International Academy, Ankleshwar	Principal LIONS INTERNATIONAL ACADEMY ANKLESHWAR 13/01/2020 8530950076
27	The Principle Lion School Ankleshwar	R.D. 10/1/20
28	The Principle, Chandrabala Modi, academy, Ankleshwar	Principal CHANDRABALA MODI ACADEMY P.O. KONDH WADIA ROAD, ANKLESHWAR - 390 001 DIST. BANARJAN (GUJARAT)
29	The Principle, R.B.L.P.S School, Ankleshwar	
30	Dr. A. K. Patel Ankleshwar	Dr. A.K. Patel 02646-246535
31	Dr. Mahesh Mistry Ankleshwar	
32	Administration office, ESIC Hospital	ESIC 15/01/2020
33	Smt. Jayaben Modi Hospital	Smt. 13/1/20



ANNEXURE- 1(I)

O/c copy

ENVIRO TECHNOLOGY LIMITED

Ref: ETL/ANK/JUNE/2025/312
GPCB ID: 15074

Date: 26th June 2025

To,
The Member Secretary
Gujarat Pollution Control Board
Paryavaran Bhavan
Sector - 10 / A,
Gandhinagar

Sub: Environmental Statement for the year 2024-25

Dear Sir,

We are forwarding herewith an Environmental Statement (Form V) for our Common Effluent Treatment Plant situated at Plot No.2413 / 2414 & 2211 G.I.D.C., Ankleshwar - 393 002, Dist. Bharuch, for the year 2024-2025. The treated effluent is being sent to FETP of NCT for further treatment and disposal.

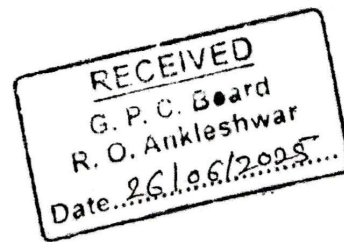
Thanking you.

Yours faithfully,

For, Enviro Technology Ltd


A. P. Karkhanis
(Unit Head)

CC: The Regional Officer, GPCB, Ankleshwar



CIN NO. :
Works Office :

Reg. Office :

U72200GJ1994PLC023786
2413/2414 & 2211, GIDC Estate, Ankleshwar - 393 002 Dist. : Bharuch (Gujarat)
Phone : (02646) 223569, 252768, 253104
Email : dalwadibd@bell.co.in, akhilkarkhanis@bell.co.in
9701-16, GIDC Estate, Ankleshwar - 393 002 Dist. : Bharuch (Gujarat)

ENVIRONMENTAL STATEMENT

PART - A


01	Name and address of the owner / occupier of the industry / operation or process		Director – Mr. Ashok Panjwani Unit Head – Mr. A. P. Karkhanis Enviro Technology Ltd. 2413 – 2414, & 2211 GIDC Estate Ankleshwar – 393 002
02	Industry Category	Primary – STC Code	
		Secondary–SIC Code	
03	Production capacity	Units	Not applicable, it is a Common Effluent Treatment Plant
04	Year of establishment		1997
05	Date of the last Environmental Statement submitted		15 th June, 2024

PART - B

Water and Raw material Consumption

01	Water Consumption	≈ 64.53 m ³ / day	
	Process	28.49 m ³ / Day	Water is consumed for DI sodium Hydrogen phosphate & Magnesium chloride solution preparation, Primary & Tertiary Sand Filter & Activated Carbon Filter Backwash, Bioaugmentation and domestic purpose.
	Cooling	14.98 m ³ / Day	
	Domestic	21.06 m ³ / day	

Sr. No.	Name of Products (*)	Process Water Consumption per unit of product output	
		During the previous financial year	During the current financial year
1.	There is no manufacturing activity as this is a Common Effluent Treatment Plant. Our design capacity is to treat 2200 m ³ / day of Industrial effluent.		
(*)	Industry may use codes if disclosing details of raw material would violate contractual obligations, otherwise all industries must name the raw material used.		



02: Raw Material Consumption

Sr. No.	Name of Products (*)	Consumption of raw material (In Kgs)	
		During the previous financial year 2023 -2024	During the current financial year 2024 -2025
1.	Hy. Lime	544093.90	630089
2.	Hydrogen Peroxide	200	0
3.	Ferrous Sulphate (Solid)	0	4513
4.	Deforming Agent	2039	3706
5.	Polyelectrolyte (Type - 2)	108	131
6.	Phosphoric Acid	7025	11600
7.	Magnesium Salt	9837	22131
8.	Sodium Salt	5334.82	9873
9.	Sodium Tri-poly Phosphate (STPP)	1612	1998
10.	Poly Aluminum Chloride (PAC)	4400	13204
11.	Deformer (Silicon Base Fin-18)	54760	59020
12.	C.S. Lye (30%)	449315.40	670651

PART - C

Pollution discharged to environment / unit of output.
(Parameters as specified in the Consent issued)

Sr, No.	Pollutants	Quantity of pollutants discharged. (mass / day)		Concentrations of pollutants in discharges (mass / volume)	Percentage of variation from prescribed Standards with reasons
a	Water	COD	2655 Kg/ day	966 mg/l	-3.4%
		BOD	28 Kg/day	10 mg/l	-95%
		Ammonical Nitrogen	136 Kg/day	49 mg/l	-2%
b	Air	All parameters specified In consent for D.G.set stack & ambient air are within limit.			



PART – D
HAZARDOUS WASTE
(as specified under Hazardous Wastes [Management Handling & Trans – boundary Movement] Rules, 2008)

Hazardous Wastes		Total Quantity	
Category	Hazardous waste	During the previous financial year-23-24	During the current financial year-24-25
A) From Process			
35.3	Chemical Sludge from wastewater treatment	3592.600 MT	4668.420 MT
33.1	Discarded Containers	0 Nos.	3.34 MT
5.1	Used Oil	187 Liters	192 Liters
B) From Pollution Control Facilities			
Nil			

PART – E
SOLID WASTE

Hazardous Wastes		Total Quantity in M ³ /MT	
		During the current financial year 2023-2024	During the current financial year 2024-2025
a	From Process	NIL	NIL
b	From pollution control facilities (generation)	NIL	NIL

PART – F

- Please specify the characteristics (in terms of composition and quantum) of hazardous as well as solid wastes and indicate disposal practices adopted for both these categories of wastes.
- The major source of solid waste generation in the CETP is from primary treatment & MAP treatment of effluent from the member industries. The sludge generated is dewatered with the help of a super decanter.
- ETP sludge is disposed to the Centralized Secured Landfill Facility at BEIL-Ankleshwar.





PART - I

Any other particulars for improving the quality of the environment.

- 1 Display of information with respect to operation, at the front of the Company, for the public
- 2 Students / Community are permitted to visit the CETP. Required guidance are given to the students who are doing Environmental Courses
- 3 Tree plantation is taken up as an important activity.
- 4 ETL has integrated system for ISO 14001:2015 & ISO 45001:2018.
- 5 ETL Laboratory has got NABL accreditation as per ISO 17025:2005.
- 6 Microbiological laboratory is set up and is in operation.
- 7 Treatability studies are conducted, and it is an on-going activity.
- 8 GPS System installed on tankers and helps in tracking.
- 9 Manifest system for transporting effluent from member industry to ETL.
- 10 Studies are conducted through IIT Kanpur / Mumbai for improving performance.
- 11 Electrochemical oxidation studies are carried out through SRICT Ankleshwar.
- 12 We have installed Solar panels above office building and generating approximately 3571.4 Units per month.

For, Enviro Technology Limited


A.P. Karkhanis
Unit Head




Date: 26.06.2025
Place :- Ankleshwar

PART – G

- Impact of the pollution abatement measures taken on conservation of natural resources and on the cost of production.
- CETP was started to sort out the environmental problems faced by industries especially small-scale industries in this region. With commissioning and operation of the CETP, the waste disposal problem of member industries has been solved.
- As suggested by NEERI, we are adding Sewage to secondary treatment which helps better reduction of organics.
- The treated effluent is sent to FETP of NCT for further treatment and disposal up to deep sea through closed pipeline system. ETL is making a payment of approximately Rs.56.90 Lacs per month to NCT for further treatment and disposal of the treated effluent.
- Under the guidance of IIT Mumbai & Kanpur Improved the performance of the CETP including bio-augmentation by implementing new ASP + MLE system.
- With the segregation and treatment of effluent for removal of Ammonical Nitrogen with physico chemical treatment, the Ammonical Nitrogen at the CETP outlet is maintained 25 to 45 mg/l consistently.
- Implemented ASP + MLE system in biological process.

PART – H

- Addition measures / investment proposal for environmental protection including abatement of pollution, prevention of pollution.
- The sludge generated will be disposed off at the secured landfill of BEIL and Monthly expenditure will be approx. Rs. 15.14 Lacs.
- Engaged IIT (Kanpur + Mumbai) for further studies to reduce refractory COD & Improve CETP performance. Approximately Rs 118.94 Lacs is spent on studies.
- We have Installed TOC/TN Meter at a cost of Rs 35 Lacs in November- 2012 and updated the new TOC-4200 meter at a cost of Rs. 29 Lacs in July-2024 & Connected to CPCB.
- ETL has sponsored a project on "Electro Chemical Oxidation "studies with Engg. College, SRICT. Annual expenditure Rs. 6 lacks.
- We are displaying COD/BOD/pH/TSS & Flow on vendor's server by which real time monitoring by GPCB/CPCB.
- We are planning to install solar panels above aeration tank of 257.985 kW capacity.




ENVIRO TECHNOLOGY LTD., ANKLESHWAR

EFFLUENT RECEIPT DATA APRIL-2024 TO MARCH-2025

Month	Total No. of Tankers received	Average COD ppm	Average NH4-N ppm
April 2024	5122	4091	66
May 2024	5229	4013	63
June 2024	5128	4017	52
July 2024	5241	3593	53
August 2024	5392	3741	54
September 2024	5215	3963	57
October 2024	5630	4041	74
November 2024	4571	4431	113
December 2024	5520	4388	94
January 2025	5537	4140	87
February 2025	5014	4086	87
March 2025	4783	4011	82

HAZARDOUS WASTE DETAILS (CETP SLUDGE) ALL QTY. IN KGS

Month	Opening Balance	Generation	Dispatched to BEIL for Landfilling	Closing Balance
April 2024	0	364600	364600	0
May 2024	0	340680	340680	0
June 2024	0	333330	333330	0
July 2024	0	389120	389120	0
August 2024	0	434160	434160	0
September 2024	0	387350	387350	0
October 2024	0	454760	454760	0
November 2024	0	473180	473180	0
December 2024	0	420020	420020	0
January 2025	0	446640	446640	0
February 2025	0	379490	379490	0
March 2025	0	485050	485050	0
Total		4668420	4668420	




SLUDGE ANALYSIS REPORT

Sr. No.	Parameters	Unit	Result	Method Ref.
ETP SLUDGE ANALYSIS				
1	CaSO ₄	%	7.12	IS-4256
2	CaCO ₃	%	71.23	IS 2720: Part 23
3	LOD at 105 °C	%	56.06	APHA 2540 B
4	Total Inorganic Solids	%	95.69	APHA 2540-G
ETP SLUDGE 10 % LEACHATE ANALYSIS				
5	Total Acidity	mg/L	NIL	APHA 2310-B
6	Total Alkalinity	mg/L	761	APHA 2320-B
7	COD	mg/L	582	APHA 5220-B
8	Oil % Oil emulsion	mg/L	2.09	APHA 5520 - B
9	Cyanide	mg/L	BDL	APHA 4500-CN -G
10	Fluoride	mg/L	0.82	APHA 4500-F -D
11	Phenolic Compound	mg/L	BDL	APHA 5530 - D
12	Iron	mg/L	2.0562	APHA 3111-Fe- B
13	Total Chromium	mg/L	0.3847	APHA 3111-Cr-B
14	Manganese	mg/L	0.1963	APHA 3111-Mn- B
15	Zinc	mg/L	0.3174	APHA 3111-Zn- B
16	Copper	mg/L	0.0963	APHA 3111-Cu-B
17	Lead	mg/L	0.2189	APHA 3111-Pb-B
18	Nickel	mg/L	0.3763	APHA 3111-Ni- B

SOIL ANALYSIS REPORT

Sr.No.	Parameters	Results of sampling Done on 31.08.24	Results of sampling Done on 28.02.25
1	pH	7.62	7.74
2	Conductivity (mS/m)	504.2	597.6
3	Organic Matter (%)	12.43	13.74
4	Phosphorous (P) (mg/kg)	682.2	607.5
5	Copper (Cu) (mg/kg)	0.382	0.446
6	Nickel (N) (mg/kg)	0.624	0.517
7	Manganese (Mn) (mg/kg)	0.887	0.961
8	Zinc (Zn) (mg/kg)	4.89	5.03

BDL = Below Detectable Limit



AMBIENT AIR MONITORING DATA APRIL 2024 TO MARCH 2025

Sr.No.	Month	PM10	PM2.5	SO2	NOx
		$\mu\text{g} / \text{Nm}^3$			
1	April 2024	66.74	23.28	22.57	36.4
2	May 2024	68.13	23.23	22.91	36.62
3	June 2024	66.70	22.41	21.48	34.99
4	July 2024	59.05	20.66	20.17	31.38
5	August 2024	55.45	20.23	19.32	30.13
6	September 2024	56.48	21.39	20.22	33.03
7	October 2024	64.62	22.2	21.55	35.27
8	November 2024	73.23	22.58	22.01	36.22
9	December 2024	75.39	22.49	21.94	36.36
10	January 2025	76.56	22.83	21.87	36.41
11	February 2025	77.73	22.8	21.63	36.56
12	March 2025	78.36	23.02	22.1	36.92

D.G STACK MONITORING APRIL 2024 TO MARCH 2025

Sr.No.	Month	SPM milligram/NM3	SO2 ppm	NOx ppm
1	April 2024	32.53	12.74	18.63
2	May 2024	30.78	13.69	19.02
3	June 2024	32.47	11.93	17.39
4	July 2024	36.32	12.41	18.69
5	August 2024	39.17	11.28	19.23
6	September 2024	37.42	10.94	17.26
7	October 2024	35.72	11.82	15.33
8	November 2024	34.21	10.26	16.04
9	December 2024	36.47	12.08	18.13
10	January 2025	35.28	11.98	17.18
11	February 2025	33.57	12.21	18.04
12	March 2025	36.38	14.27	19.81



Shroff S.R. Rotary Institute of Chemical Technology

UPL

Principal Supporter & Sponsor – UPL Ltd & Shroff Family
 Managed by Ankleshwar Rotary Education Society
 Constituent Institute of UPL University of Sustainable Technology

Rotary
 Ankleshwar

Group : Waste Water
 Discipline : Chemical


TEST REPORT

Customer's Name & Address: M/s. Enviro Technology Ltd Plot no. 2413/14, GIDC Estate, Ankleshwar, Dist: Bharuch. Contact Person: Mr. Dipak Meghapara	Report No : SEL/20241008/A-001 Issue Date: 14/10/2024
---	--

Lab Id Code	:	SRICT/20241008/A-001			
Sample Description	:	Final O/L-001	Purpose	:	Testing
Date of sample received	:	08/10/2024	Test parameter	:	As-mentioned by customer
Date of starting Analysis	:	09/10/2024	Quantity	:	2 Lit
Date of completion Analysis	:	14/10/2024	Packed/Seal	:	Sealed

Sr No	Parameter	Unit	Result	Permissible Limit (If Applicable)	Test Method
1	Temperature	°C	25.2	40	APHA (23rd Ed) 2550
2	Total Kjeldahl Nitrogen	mg/l	34.16	50	APHA-4500-Norg-B, Macro- Kjeldahl Method, 23rd Eddi.
3	Phosphate	mg/l	1.75	5	IS: 3025(P-31)1988Re-2003, Stannous chloride Method.
4	Cyanide	mg/l	BDL	0.2	APHA(23rd Ed)4500-D, Titrimetric method
5	Fluorides	mg/l	BDL	15	APHA 4500-F- D, 4-90 TO 4-91, 23rd Ed., : 2017, SPADNS Method
6	Hexavalent Chromium	mg/l	BDL	0.1	APHA(23rd Ed) 3500Cr-B, Colourimetric Method
7	Total Chromium	mg/l	0.26	2	AAS-APHA (23rd Ed) 3111-B ₃ Colourimetric Method APHA 3111-CU-B ₃ -20 TO 3-31, 23 rd. ED.2017
8	Copper	mg/l	0.78	3	AAS
9	Nickel	mg/l	0.52	3	AAS-APHA 3111-Ni-B ₃ -20 to 3-21, 23 rd. ED.2017
10	Zinc	mg/l	0.54	15	AAS-APHA, 3111-Zn-B ₃ -20 TO 3-21, 23 rd. ED.2017
11	Iron	mg/l	1.04	3	APHA-3111-Fe.B ₃ -20 to 3-21, 23 rd. ED.2017

Block No :402, At & Po : Vataria, Ankleshwar-Valia Road, Ta: Valia, Dist: Bharuch, Pin: 392135,
 Ph. no : +91-9712177799, Mo :+91-9727745875/76, E-mail: hr@sriect.in, Website: www.sriect.in





Shroff S.R. Rotary Institute of Chemical Technology

UPL

Principal Supporter & Sponsor – UPL Ltd & Shroff Family
Managed by Ankleshwar Rotary Education Society
Constituent Institute of UPL University of Sustainable Technology

Rotary
Ankleshwar

12	Manganese	mg/l	0.64	2	APHA 3111 A, 23 rd. ED.2017-AAS
13	Mercury	mg/l	BDL	0.01	APHA-3112-Hg-B,23 rd. ED.2017-AAS
14	Lead	mg/l	BDL	0.1	AAS-APHA 3111-Pb-B,3-20 to 3-21,23 rd. ED.2017
15	Arsenic	mg/l	BDL	0.2	APHA 3111-AS-B,23 rd. ED.2017-AAS
16	Vanadium	mg/l	BDL	0.2	APHA-3500-V.B-AAS
17	Cadmium	mg/l	BDL	0.05	APHA 3111-Cd B, 23 rd. ED.2017-AAS
18	Selenium	mg/l	BDL	0.05	APHA-3500-Se, B-C-23 rd. ED.2017-AAS
19	Color	Hazen	5895	100	APHA 2120 C, 2-7 to 2-8, 23rd Ed.: 2017,Spectrophotometric Single Wavelength Method
20	Sulphate	mg/l	2318	1000	APHA ,4500-SO4-E, 4-199 to 200, 23rd Ed.: 2017,Turbidimetric Method
21	Insecticide/ Pesticides	mg/l	Absent	Absent	Pesticides &Insecticides Ref. USEPA 508,525.2

BDL: Below Detection Limit

Note: Results shown in Bold are found above Permissible Limit.

Prepared and checked By

Authorized Signatory

Terms and conditions governing the test report issued

1. Sample is not drawn by SEL; the results are applicable only to the drawn samples.
2. The test report shall not be reproduced in full or part without the written approval of the SRICT Environmental Laboratory.
3. The test report in full or part shall not be used for promotional or publicity purpose without the written consent of SRICT Environmental Laboratory.
4. Water/Waste water samples shall be stored for the period of one month after the date of issue of Report.

END OF REPORT

Block No :402, At & Po : Vataria, Ankleshwar-Valia Road, Ta: Valia, Dist: Bharuch, Pin: 393135,
Ph. no : +91-9712177799, Mo : +91-9727745875/76, E-mail: hr@srict.in, Website: www.srict.in



SRICT

SRICT ENVIRONMENTAL LABORATORY

(SHROFF S R ROTARY INSTITUTE OF CHEMICAL TECHNOLOGY)
(Managed by ANKLESHWAR ROTARY EDUCATIONAL SOCIETY)
(Block No. 402, At & Post: Vataria, Ta: Valia, Dist.: Bharuch, Pin code: 393135. Phone No.: 02643-290825)



TC-13941

Page 1 of 1

Group : Waste Water
Discipline : Chemical

ULR No. : TC1394124000000205F

TEST REPORT

Customer's Name & Address: M/s. Enviro Technology Ltd Plot no. 2413/14, GIDC Estate, Ankleshwar, Dist: Bharuch. Contact Person: Mr. Dipak Meghapara	Report No : SEL/20241008/A-001 Issue Date: 14/10/2024
---	--

Lab Id Code	:	SRICT/20241008/A-001			
Sample Description	:	Final O/L-001	Purpose	:	Testing
Date of sample received	:	08/10/2024	Test parameter	:	As mentioned by customer
Date of starting Analysis	:	09/10/2024	Quantity	:	2 Lit
Date of completion Analysis	:	14/10/2024	Packed/Seal	:	Sealed

Sr No	Parameter	Unit	Result	Acceptable Criteria	Test Method
1	pH	--	7.51	6.5 to 8.5	IS 3025(P-11) : 2022, Electrometric Method
2	Total Suspended solids (TSS)	mg/l	78.2	150	IS3025(P-17) 2022, Gravimetric Method
3	Total Dissolved Solid (TDS)	mg/l	13110	10000	IS3025(P-16), 2023, Gravimetric Method
4	BOD	mg/l	24.0	200	IS:3025 (Part 44), 2023, Oxygen Depletion Method
5	COD	mg/l	720	1000	IS: 3025-Part 58, 2023, Open Reflux Method
6	Oil & Grease	mg/l	BDL	10	APHA 5520-B, 5-42 to 44, 23rd Ed.: 2017, Liquid Partition Gravimetric Method
7	Total Phenol	mg/l	0.15	5	APHA, 5530-D, Page No. 5-52, 23rd Ed.: 2017, Direct Photometric Method
8	Sulphide	mg/l	BDL	5	APHA 4500-S-2-F, 4-187, 23rd Ed.: 2017, Iodometric Method
9	Ammonical Nitrogen	mg/l	26.88	50	IS: 3025-Part 34, 1988, Titrimetric Method
10	Chloride	mg/l	4607.79	1000	IS: 3025-Part 32, 1988, Argentometric Method

BDL: Below Detection Limit, Note: Results shown in Bold are found above Permissible Limit.

Terms and conditions governing the test report issued

1. Sample is not drawn by SEL; the results are applicable only to the drawn samples.
2. The test report shall not be reproduced in full or part without the written approval of the SRICT Environmental Laboratory.
3. The test report in full or part shall not be used for promotional or publicity purpose without the written consent of SRICT Environmental Laboratory.
4. Water/Waste water samples shall be stored for the period of one month after the date of issue of Report.

END OF REPORT

Prepared and checked By
Dr. Pratibha Gautam
(Technical Manager)

Authorized Signatory
Dr. Snehal Lokhandwala
(Quality Manager)

Block No:402, At: Vataria, Ankleshwar-Valia Road, Ta: Valia, Dist: Bharuch
Phone No:02643-290825, 9712177799, Mo: 9727745875/876 E-mail: hr.srict@gmail.com, www.srict.in

